

**UMMC PROJECT NO. 409-007
FIRE PROTECTION CENTRAL CORE
UNIVERSITY OF MISSISSIPPI MEDICAL CENTER
JACKSON, MISSISSIPPI**

**From: Foil Wyatt Architects & Planners, PLLC
Suite 101
4316 Old Canton Road
Jackson, MS 39211**

Addendum No. 1

August 5, 2026

This addendum forms a part of the contract documents and modifies the original plans and specifications dated June 12, 2026.

General:

Specifications:

Item 1.1: Section 095100 – Acoustical Ceilings, Paragraph 2.02.A.12

- Change:** a. ACT-1 to read “equal to Armstrong #746, 12" x 12" x 5/8" “ beveled tongue and groove concealed spline fine fissured ceiling tile glued to gypsum board. Use 15,000 sq.ft. for Base Bid.
- Change:** b. ACT-2 to read “equal to Armstrong #1732, 24" x 24" x 5/8" “ beveled tegular fine fissured lay-in ceiling tile in 15/16" white suspended aluminum grid. Use 20,000 sq.ft. for Base Bid.
- Change:** c. ACT-3 to read “equal to Armstrong #1729, 24" x 48" x 5/8" “ square edge fine fissured lay-in ceiling tile in 15/16" white suspended aluminum grid. Use 30,000 sq.ft. for Base Bid.

Item 1.2: Asbestos-Containing Materials Survey and Assessment

Add: The attached ACM Survey and Assessment into the specifications.

Item 1.3: Section 211200 – Fire Suppression Stand Pipes, 213000 – Fire Pumps And 211313 – Wet Pipe Sprinkler Systems

Add: The attached Mechanical Addendum #1 Revisions shown in red for each section.

Drawings:

Item 1.4: Drawing Sheet A-208

Change: The size of the new roof hatch in Stairway H-01 on the east end of the east wing to 30" x 36".

Item 1.5: Drawings A-SB, A-100, A-101, A-102, A-103, A-104, A-105, A-106, A-107, A-108, and A-109

Clarification: That all of these drawings are accurately shown at the scale of 1" = 30', as indicated on each sheet.

Clarification: The approximate sq. ft. that needs sprinklering in the Legend on each sheet is as follows:

Sheets A-SB (1,426 sf), A-100 (30,305 sf), A-101 (78,312 sf), A-102 (44,383 sf), A-103 (43,505 sf), A-104 (33,848 sf), A-105 (34,045 sf), A-106 (33,663 sf), A-107 (22,248 sf), A-108 (10,809 sf) and A-109 (3,044 sf)

Item 1.6: Structural Drawings S101 And S102 for Alternate #1

Add: These two attached Structural Drawings.

Item 1.7: Revised Fire Protection Drawings

Add: The attached revised Fire Protection Drawings FP201, FP201-D, FP202, FP211, FP401, FP401-D, FP601 and FP602.

Item 1.8: Revised Electrical Drawings

Add: The attached revised Electrical Drawings ADE001, ADE200, ADE300 and ADE400.

Item 1.9: Architectural Drawing A-SB.3

Delete: Delete Drawing A-SB.3 in its entirety.

End of Addendum No. 1

Addendum #1

SECTION 211200 FIRE SUPPRESSION STANDPIPES

2.02 STEEL PIPE AND FITTINGS

- A. Standard Weight Schedule 40 and Schedule 10, Black-Steel Pipe: ASTM A53, Type E, Grade B. Pipe ends may be factory or field formed to match joining method.

3.11 PIPING SCHEDULE

- B. Wet-type, fire-suppression standpipe piping shall be of the following:
 - 1. Standard-weight Schedule 40, UL listed black-steel pipe with threaded ends; uncoated, gray-iron threaded fittings; and threaded joints.
 - 2. Standard-weight Schedule 40, UL listed black-steel pipe with roll-grooved ends; uncoated, grooved-end fittings for steel piping; grooved-end-pipe couplings for steel piping; and grooved joints.
 - 3. Standard-weight Schedule 10 (for pipe 2 ½" and larger), UL listed black-steel pipe with roll-grooved ends; uncoated, grooved-end fittings for steel piping; grooved-end-pipe couplings for steel piping; and grooved joints.

SECTION 213000 FIRE PUMPS

2.03 ABOVEGROUND PIPING COMPONENTS

- A. Pipe Sizes 2.5 inches and Larger for Pump Suction and Discharge Manifold.
 - 1. Pipe
 - a. Piping shall be ASTM A53/A53M, Weight Class STD (Standard), Schedule 40, Type E or Type S, Grade A; black steel pipe. Steel pipe shall be joined by means of flanges welded to the pipe or mechanical grooved joints only. Piping shall not be joined by welding or weld fittings. Suction piping shall be galvanized on the inside in accordance with NFPA 20.

SECTION 211313 WET PIPE SPRINKLER SYSTEMS

2.2 STEEL PIPE AND FITTINGS

- A. Standard Weight Schedule 40 and schedule 10 Black Steel Pipe: ASTM A 53/A 53M. Pipe ends may be factory or field formed to match joining method. Nonstandard weight pipe and fittings shall not be used.

**ASBESTOS-CONTAINING MATERIALS
SURVEY AND ASSESSMENT
THE UNIVERSITY OF MISSISSIPPI MEDICAL CENTER
CENTRAL CORE FIRE PROTECTION
CEILINGS INSPECTION**



PREPARED FOR:

**FOIL WYATT ARCHITECTS & PLANNERS PLLC
4613 OLD CANTON ROAD, SUITE 101
JACKSON, MISSISSIPPI 39211**

PREPARED BY:

**PICKERING FIRM, INC.
2001 AIRPORT ROAD
SUITE 201
FLOWOOD, MISSISSIPPI 39232**



**June 29, 2026
Pickering Project No. 23758.15**

Table of Contents

SECTION	PAGE
1.0 EXECUTIVE SUMMARY	1
2.0 FINDINGS	1
3.0 RECOMMENDATIONS	3
4.0 APPENDICES	
Appendix 4.1 Analytical Results -Asbestos	
Appendix 4.2 Floor Plans -Asbestos Sample Locations	
Appendix 4.3 Certification -Mississippi Asbestos Inspector Certifications	

1.0 EXECUTIVE SUMMARY

Pickering Firm, Inc. (Pickering) performed an inspection on June 22, 23, and 24th, 2026 at the University of Mississippi Medical Center, located at 2500 North State Street, Jackson, Mississippi 39216. to identify Asbestos-Containing Materials (ACM) that will be affected during an upcoming renovation project. This report describes the inspection tasks and presents our findings and recommendations. A diagram of the building surveyed is included in Appendix 4.2 - Sample Locations Drawing.

Prior to the initial walk-through inspection of the facility, special precautions and security/access requirements were coordinated with Mr. Dick David of Foil Wyatt Architects & Planners, LLC.

During our inspection, areas to be renovated were visually inspected and the locations of suspected ceiling materials were noted. After suspect ceiling materials were identified, a minimum of two (2) samples of each homogeneous material were collected for analysis. The samples were subsequently labeled and submitted to an accredited laboratory for asbestos analysis by Polarized Light Microscopy (PLM).

2.0 FINDINGS

During the asbestos inspection, a total of thirteen (13) homogenous materials were identified that could possibly contain asbestos. According to the analytical results, none of the homogenous materials sampled were identified to contain asbestos. This conclusion is based on the Environmental Protection Agency (EPA) definition of an ACM as material composed of "...greater than 1% asbestos." Laboratory data is located within Appendix 4.1, Analytical Results.

Sample analyses indicate that no asbestos or less than 1% asbestos was detected in the following Homogenous Materials:

- 2X4 Fissured Ceiling Tile Homogenous Area (HA) (UMC-01)
- Gypsum Board Ceiling HA (UMC-02)
- 2X2 Rough Ceiling Tile HA (UMC-03)

- 1X1 White Fissured Ceiling Tile HA (UMC-04)
- 1X1 Holed Ceiling Tile HA (UMC-05)
- Glue Dot HA (UMC-06)
- Plaster HA (UMC-07)
- 1X1 Ceiling Tile with Large Rips HA (UMC-08)
- 2X2 Buckshot Ceiling Tile HA (UMC-09)
- 2X2 Wormhole Ceiling Tile HA (UMC-10)
- 2X4 Large Rips Ceiling Tile HA (UMC-11)
- 2X4 Buckshot Ceiling Tile HA (UMC-12)
- 2X2 Large Rips Ceiling Tile HA (UMC-13)

During our inspection activities, the locations of samples collected were charted on a floor plan of the building. The sample location drawing is included in Appendix 4.2 - Sample Locations Drawing.

This inspection was conducted by an inspector who is currently in good standing with the State of Mississippi and certified to perform asbestos inspections. The supporting documentation is included in Appendix 4.3 - Mississippi Asbestos Inspector Certifications.

3.0 RECOMMENDATIONS

Based on the results of the visual inspection, representative bulk sampling, and laboratory analytical results, no asbestos containing materials were identified among the ceiling materials included in this inspection. Therefore, no asbestos abatement is recommended for the ceiling materials evaluated as part of the planned renovation. However, this inspection was limited to the representative ceiling materials identified within the project scope and should not be interpreted as a comprehensive asbestos survey of all building materials or areas outside the scope of this inspection. Should renovation activities expand beyond the areas evaluated or if previously inaccessible suspect materials are encountered, additional asbestos inspection and sampling may be warranted before those materials are disturbed.

4.0 APPENDICES

APPENDIX 4.1
Analytical Results



EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / cinnasblab@EMSL.com

EMSL Order: 042612882

Customer ID: POWE54

Customer PO: 21208

Project ID:

Attention: Josh Dunn

Pickering Firm, Inc.

6363 Poplar Avenue

Suite 300

Memphis, TN 38119

Phone: (601) 956-3663

Fax: (601) 956-7817

Received Date: 06/26/2026 9:30 AM

Analysis Date: 06/26/2026 - 06/27/2026

Collected Date: 06/23/2026

Project: 23758.15 / UMMC Central Core Fire Protection Asb. Inspection / Hospital

Test Report: Asbestos Analysis of Bulk Materials via AHERA Method 40CFR 763 Subpart E Appendix E supplemented with EPA 600/R-93/116 using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
UMC-01-01 <i>042612882-0001</i>	2x4 Fissured Ceiling Tile	Tan/White Fibrous Homogeneous	30% Min. Wool	10% Perlite 60% Non-fibrous (Other)	None Detected
UMC-01-02 <i>042612882-0002</i>	2x4 Fissured Ceiling Tile	Tan/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-01-03 <i>042612882-0003</i>	2x4 Fissured Ceiling Tile	Tan/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-01-04 <i>042612882-0004</i>	2x4 Fissured Ceiling Tile	Gray/Tan/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-02-01 <i>042612882-0005</i> <i>Result includes a small amount of inseparable attached Joint Compound.</i>	Gypsum Board Ceiling	Brown/White Fibrous Heterogeneous	10% Cellulose 2% Glass	10% Ca Carbonate 60% Gypsum 18% Non-fibrous (Other)	None Detected
UMC-02-02 <i>042612882-0006</i> <i>Result includes a small amount of inseparable attached Joint Compound.</i>	Gypsum Board Ceiling	Brown/White Fibrous Heterogeneous	10% Cellulose 2% Glass	10% Ca Carbonate 60% Gypsum 18% Non-fibrous (Other)	None Detected
UMC-02-03 <i>042612882-0007</i> <i>Result includes a small amount of inseparable attached Joint Compound.</i>	Gypsum Board Ceiling	Brown/White Fibrous Heterogeneous	10% Cellulose 3% Glass	10% Ca Carbonate 60% Gypsum 17% Non-fibrous (Other)	None Detected
UMC-02-04 <i>042612882-0008</i>	Gypsum Board Ceiling	Brown/White Fibrous Homogeneous	8% Cellulose	75% Gypsum 17% Non-fibrous (Other)	None Detected
UMC-03-01 <i>042612882-0009</i>	2x2 Rough Ceiling Tile	Tan/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-03-02 <i>042612882-0010</i>	2x2 Rough Ceiling Tile	Tan/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-03-03 <i>042612882-0011</i>	2x2 Rough Ceiling Tile	Tan/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-03-04 <i>042612882-0012</i>	2x2 Rough Ceiling Tile	Gray/Tan/White Fibrous Homogeneous	40% Cellulose 40% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-04-01 <i>042612882-0013</i>	1x1 White Fissured Ceiling Tile	Gray/White Fibrous Homogeneous	50% Min. Wool	20% Ca Carbonate 30% Non-fibrous (Other)	None Detected
UMC-04-02 <i>042612882-0014</i>	1x1 White Fissured Ceiling Tile	Gray/White Fibrous Homogeneous	50% Min. Wool	20% Ca Carbonate 30% Non-fibrous (Other)	None Detected
UMC-04-03 <i>042612882-0015</i>	1x1 White Fissured Ceiling Tile	Gray/White Fibrous Homogeneous	85% Min. Wool	15% Non-fibrous (Other)	<1% Chrysotile

Initial report from: 06/27/2026 10:20:30



EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / cinnasblab@EMSL.com

EMSL Order: 042612882

Customer ID: POWE54

Customer PO: 21208

Project ID:

Test Report: Asbestos Analysis of Bulk Materials via AHERA Method 40CFR 763 Subpart E Appendix E supplemented with EPA 600/R-93/116 using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
UMC-05-01 <i>042612882-0016</i>	1x1 Holed Ceiling Tile	Tan/White Fibrous Homogeneous	60% Cellulose	20% Ca Carbonate 20% Non-fibrous (Other)	None Detected
UMC-05-02 <i>042612882-0017</i>	1x1 Holed Ceiling Tile	Brown/White Fibrous Homogeneous	90% Cellulose	10% Non-fibrous (Other)	None Detected
UMC-06-01 <i>042612882-0018</i> <i>Inseparable paint / coating layer included in analysis</i>	Glue Dot	Brown/Gray/Tan Fibrous Heterogeneous	10% Cellulose	10% Ca Carbonate 80% Non-fibrous (Other)	None Detected
UMC-06-02 <i>042612882-0019</i>	Glue Dot	Brown/Tan Fibrous Homogeneous	10% Cellulose	90% Non-fibrous (Other)	None Detected
UMC-06-03 <i>042612882-0020</i>	Glue Dot	Brown Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
UMC-07-01-Plaster <i>042612882-0021</i>	Plaster	Tan Fibrous Homogeneous	10% Cellulose	20% Ca Carbonate 15% Vermiculite 55% Non-fibrous (Other)	None Detected
UMC-07-01-Skim Coat <i>042612882-0021A</i> <i>Inseparable paint / coating layer included in analysis</i>	Plaster	White/Green Non-Fibrous Heterogeneous		50% Ca Carbonate 50% Non-fibrous (Other)	None Detected
UMC-07-02-Plaster <i>042612882-0022</i>	Plaster	Tan Fibrous Homogeneous	10% Cellulose	20% Ca Carbonate 10% Vermiculite 60% Non-fibrous (Other)	None Detected
UMC-07-02-Skim Coat <i>042612882-0022A</i> <i>Inseparable paint / coating layer included in analysis</i>	Plaster	White/Green Non-Fibrous Heterogeneous		50% Ca Carbonate 50% Non-fibrous (Other)	None Detected
UMC-07-03-Plaster <i>042612882-0023</i>	Plaster	Tan Fibrous Homogeneous	10% Cellulose	20% Ca Carbonate 8% Vermiculite 62% Non-fibrous (Other)	None Detected
UMC-07-03-Skim Coat <i>042612882-0023A</i> <i>Inseparable paint / coating layer included in analysis</i>	Plaster	Tan/White Non-Fibrous Heterogeneous		50% Ca Carbonate 50% Non-fibrous (Other)	None Detected
UMC-07-04-Plaster <i>042612882-0024</i>	Plaster	Tan Fibrous Homogeneous		35% Vermiculite 65% Non-fibrous (Other)	None Detected
UMC-07-04-Skim Coat <i>042612882-0024A</i>	Plaster	White Non-Fibrous Homogeneous		40% Ca Carbonate 60% Non-fibrous (Other)	None Detected
UMC-08-01 <i>042612882-0025</i>	1x1 Ceiling Tile w/ Large Rips	Tan/White Fibrous Heterogeneous	30% Cellulose 50% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-08-02 <i>042612882-0026</i>	1x1 Ceiling Tile w/ Large Rips	Gray/White Fibrous Homogeneous	30% Cellulose 50% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-08-03 <i>042612882-0027</i>	1x1 Ceiling Tile w/ Large Rips	Gray/White Fibrous Homogeneous	30% Cellulose 50% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-08-04 <i>042612882-0028</i>	1x1 Ceiling Tile w/ Large Rips	Gray/White Fibrous Homogeneous	40% Cellulose 40% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-09-01 <i>042612882-0029</i>	2x4 Buckshot Ceiling Tile	Tan/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected

Initial report from: 06/27/2026 10:20:30



EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com / cinnasblab@EMSL.com>

EMSL Order: 042612882

Customer ID: POWE54

Customer PO: 21208

Project ID:

Test Report: Asbestos Analysis of Bulk Materials via AHERA Method 40CFR 763 Subpart E Appendix E supplemented with EPA 600/R-93/116 using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
UMC-09-02 042612882-0030	2x4 Buckshot Ceiling Tile	Tan/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-10-01 042612882-0031	2x2 Wormhole Ceiling Tile	Tan/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-10-02 042612882-0032	2x2 Wormhole Ceiling Tile	Gray/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	15% Perlite 5% Non-fibrous (Other)	None Detected
UMC-11-01 042612882-0033	2x4 Large Rips Ceiling Tile	Tan/White/Pink Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-11-02 042612882-0034	2x4 Large Rips Ceiling Tile	Gray/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-12-01 042612882-0035	2x4 Buckshot Ceiling Tile	Tan/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-12-02 042612882-0036	2x4 Buckshot Ceiling Tile	Gray/White Fibrous Homogeneous	50% Cellulose 35% Min. Wool	10% Perlite 5% Non-fibrous (Other)	None Detected
UMC-13-01 042612882-0037	2x2 Large Rips Ceiling Tile	Tan/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-13-02 042612882-0038	2x2 Large Rips Ceiling Tile	Tan/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
UMC-13-03 042612882-0039	2x2 Large Rips Ceiling Tile	Gray/White Fibrous Homogeneous	50% Cellulose 30% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected

Analyst(s)

Brian Napper II (14)

Giavanna Marcolongo (29)


Samantha Sweeney, Laboratory Manager
or Other Approved Signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. The above analyses were performed in general compliance with Appendix E to Subpart E of 40 CFR (previously EPA 600/M4-82-020 "Interim Method") but augmented with procedures outlined in the 1993 ("final") version of the method. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-friable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Estimation of uncertainty is available on request.

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ NVLAP Lab Code 101048-0, AIHA LAP, LLC-IHLAP Lab 100194, PA ID# 68-00367, LA #04127

Initial report from: 06/27/2026 10:20:30

APPENDIX 4.2
Sample Locations Drawing

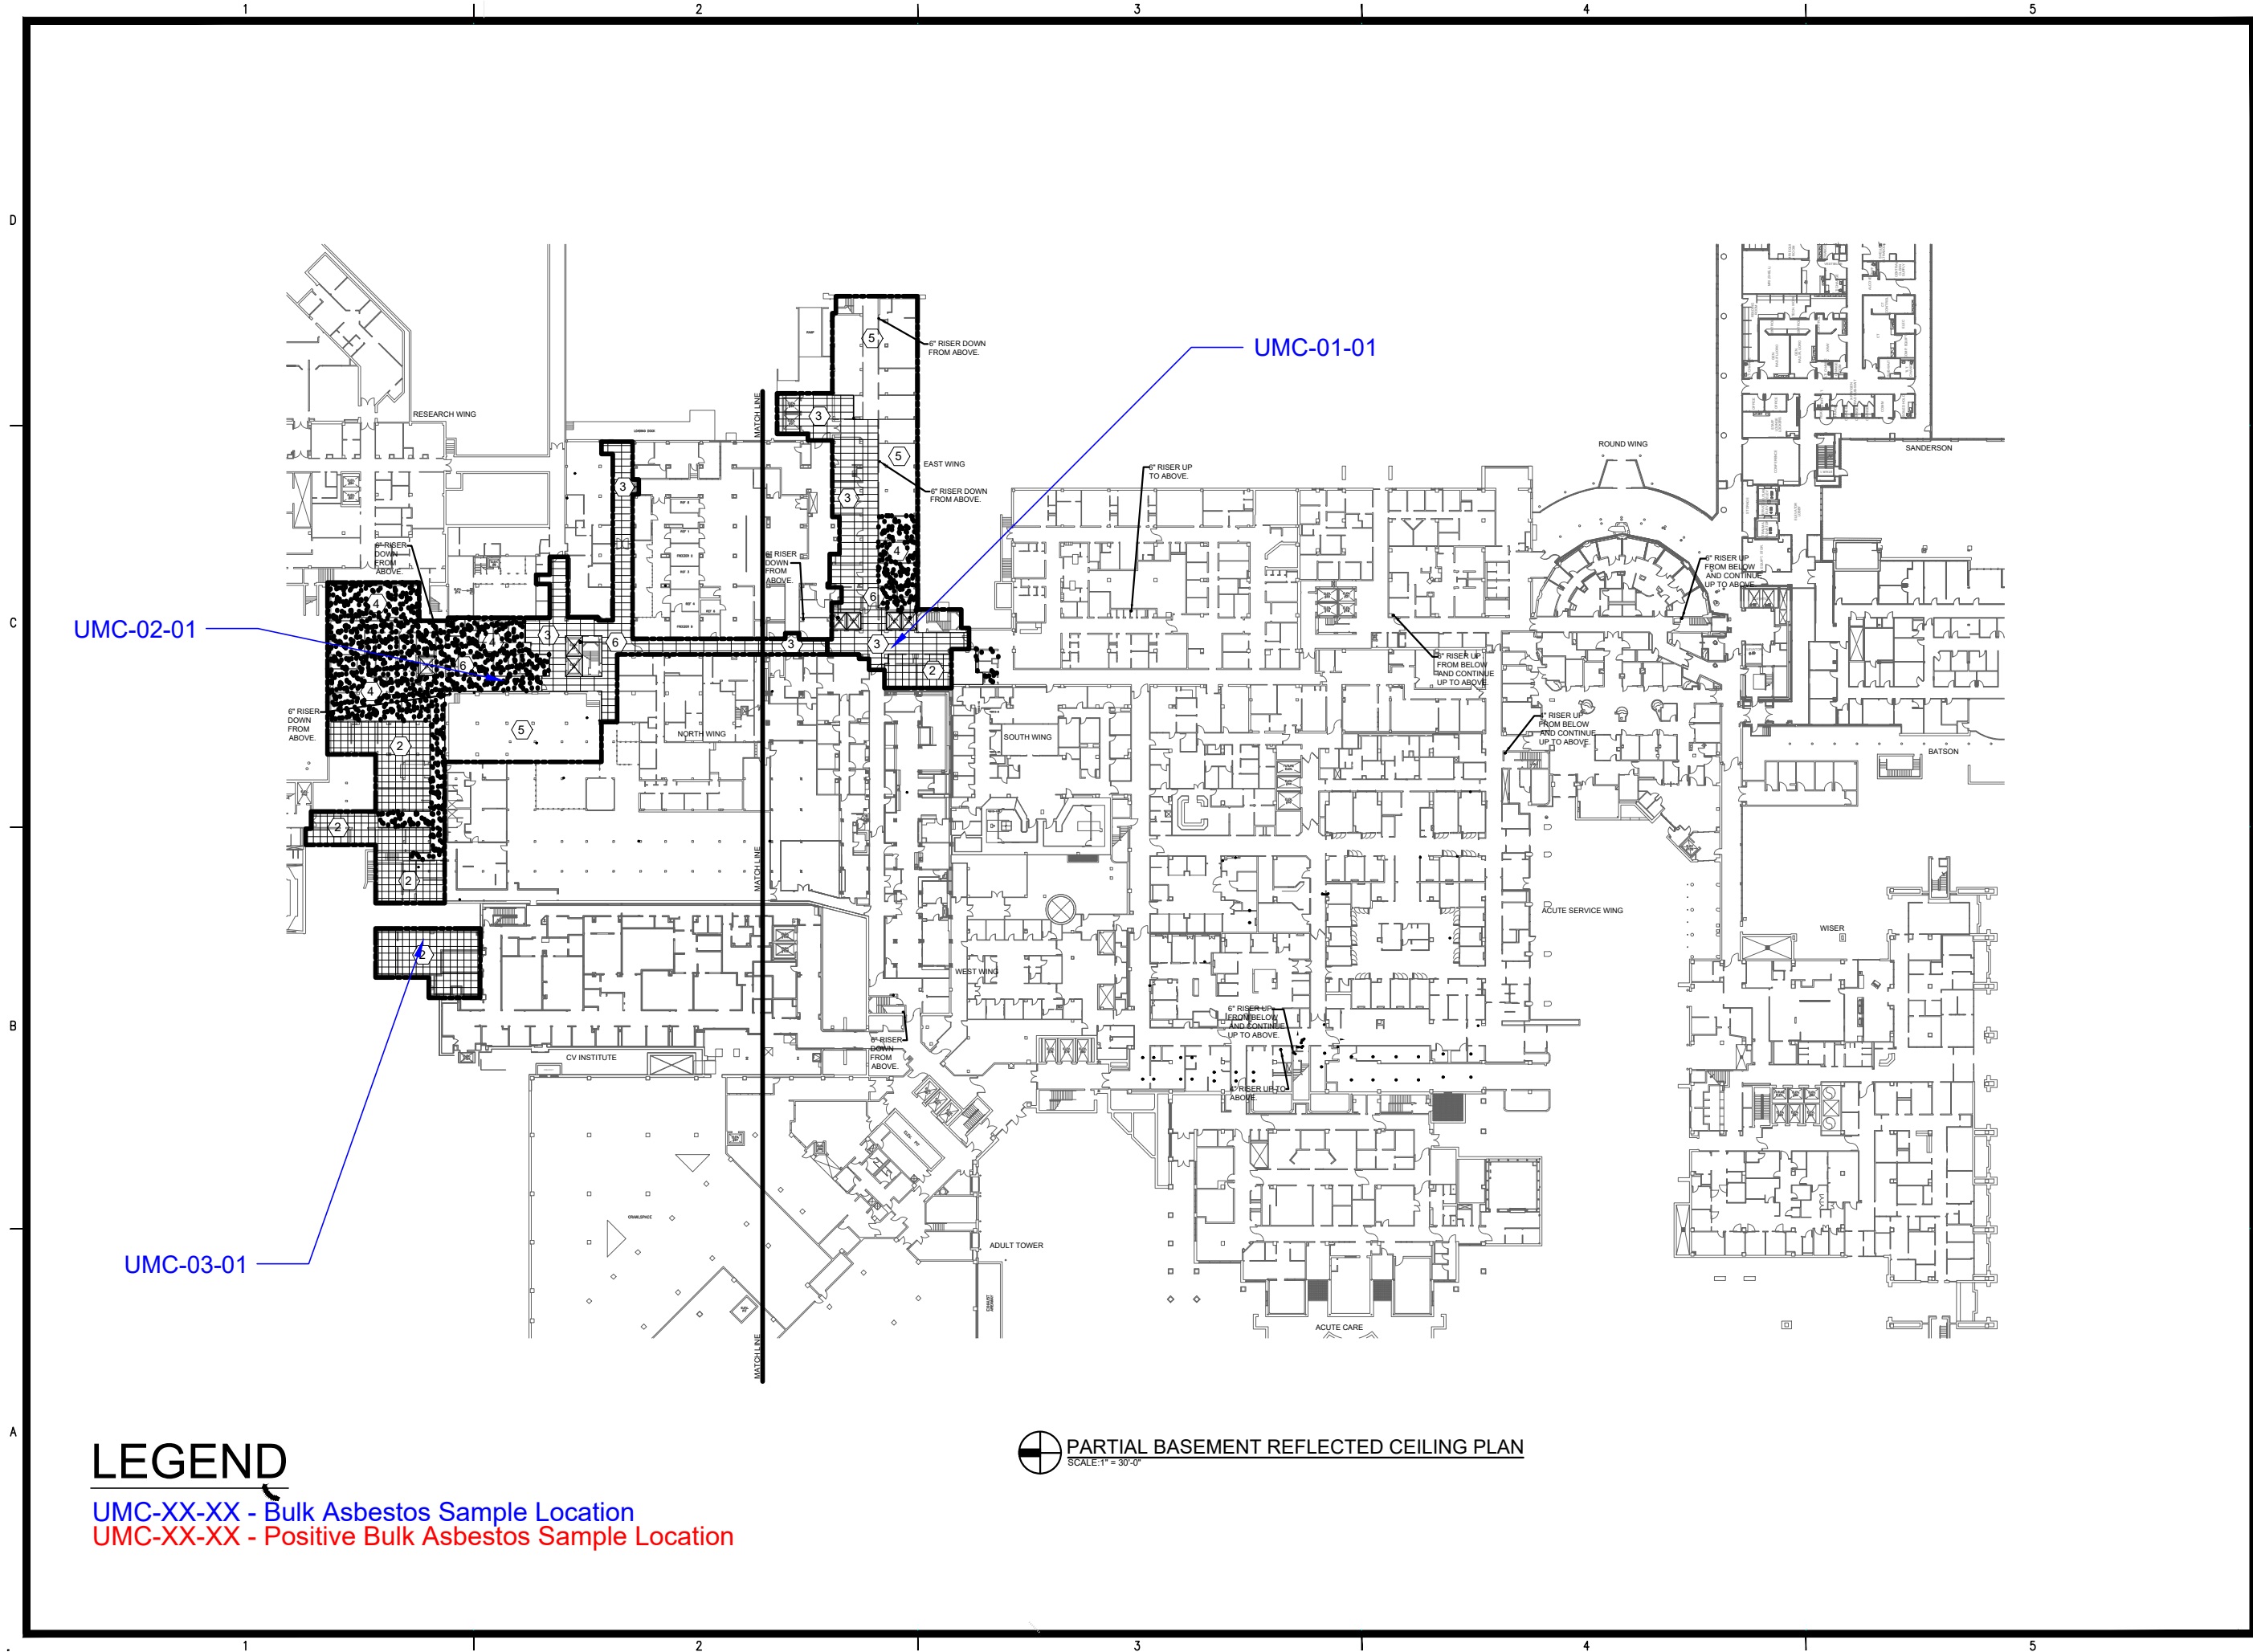

REVISIONS:		

PROJECT #:	23758.15
DATE:	JUNE 2026
DRAWN BY:	JD
DESIGNER:	
CHECKED BY:	MC




Basement
Fire Protection Central Core
University of Mississippi Medical Center

SHEET NUMBER:

1

DESCRIPTION:
Sample Locations

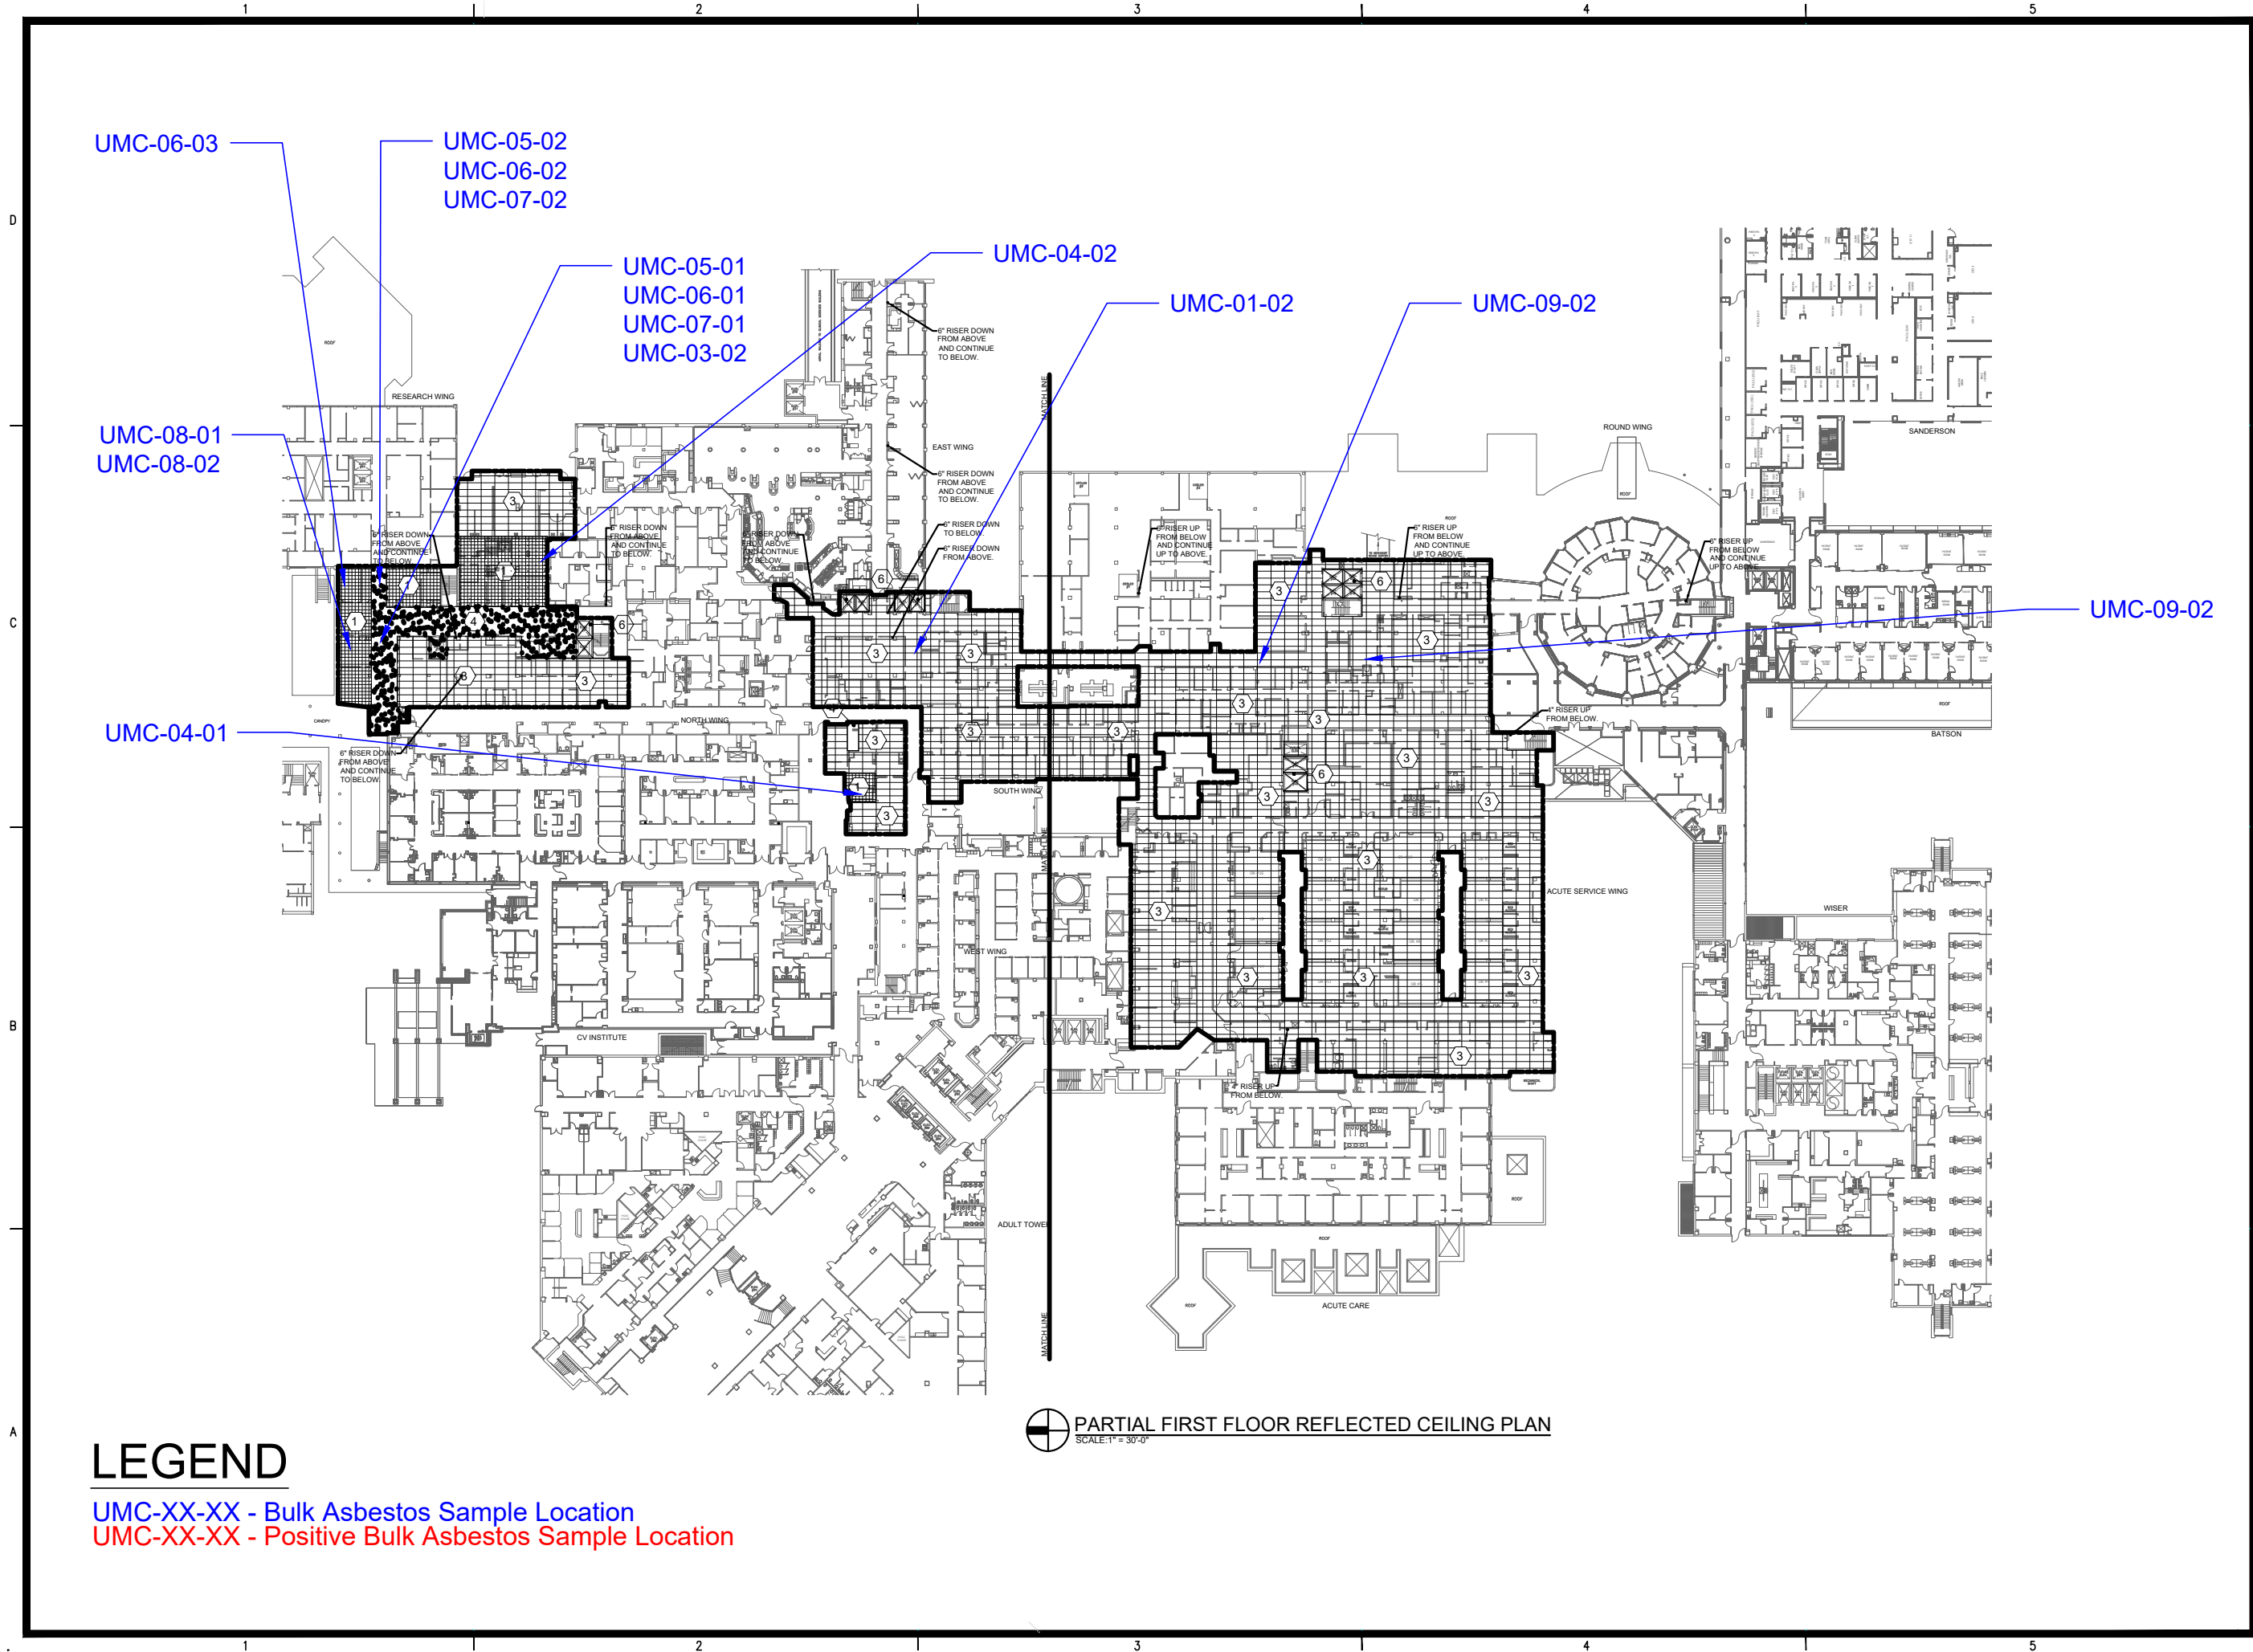

REVISIONS:		

PROJECT #:	23758.15
DATE:	JUNE 2026
DRAWN BY:	JD
DESIGNER:	
CHECKED BY:	MC




First Floor
Fire Protection Central Core
University of Mississippi Medical Center

SHEET NUMBER:

2

DESCRIPTION:
Sample Locations

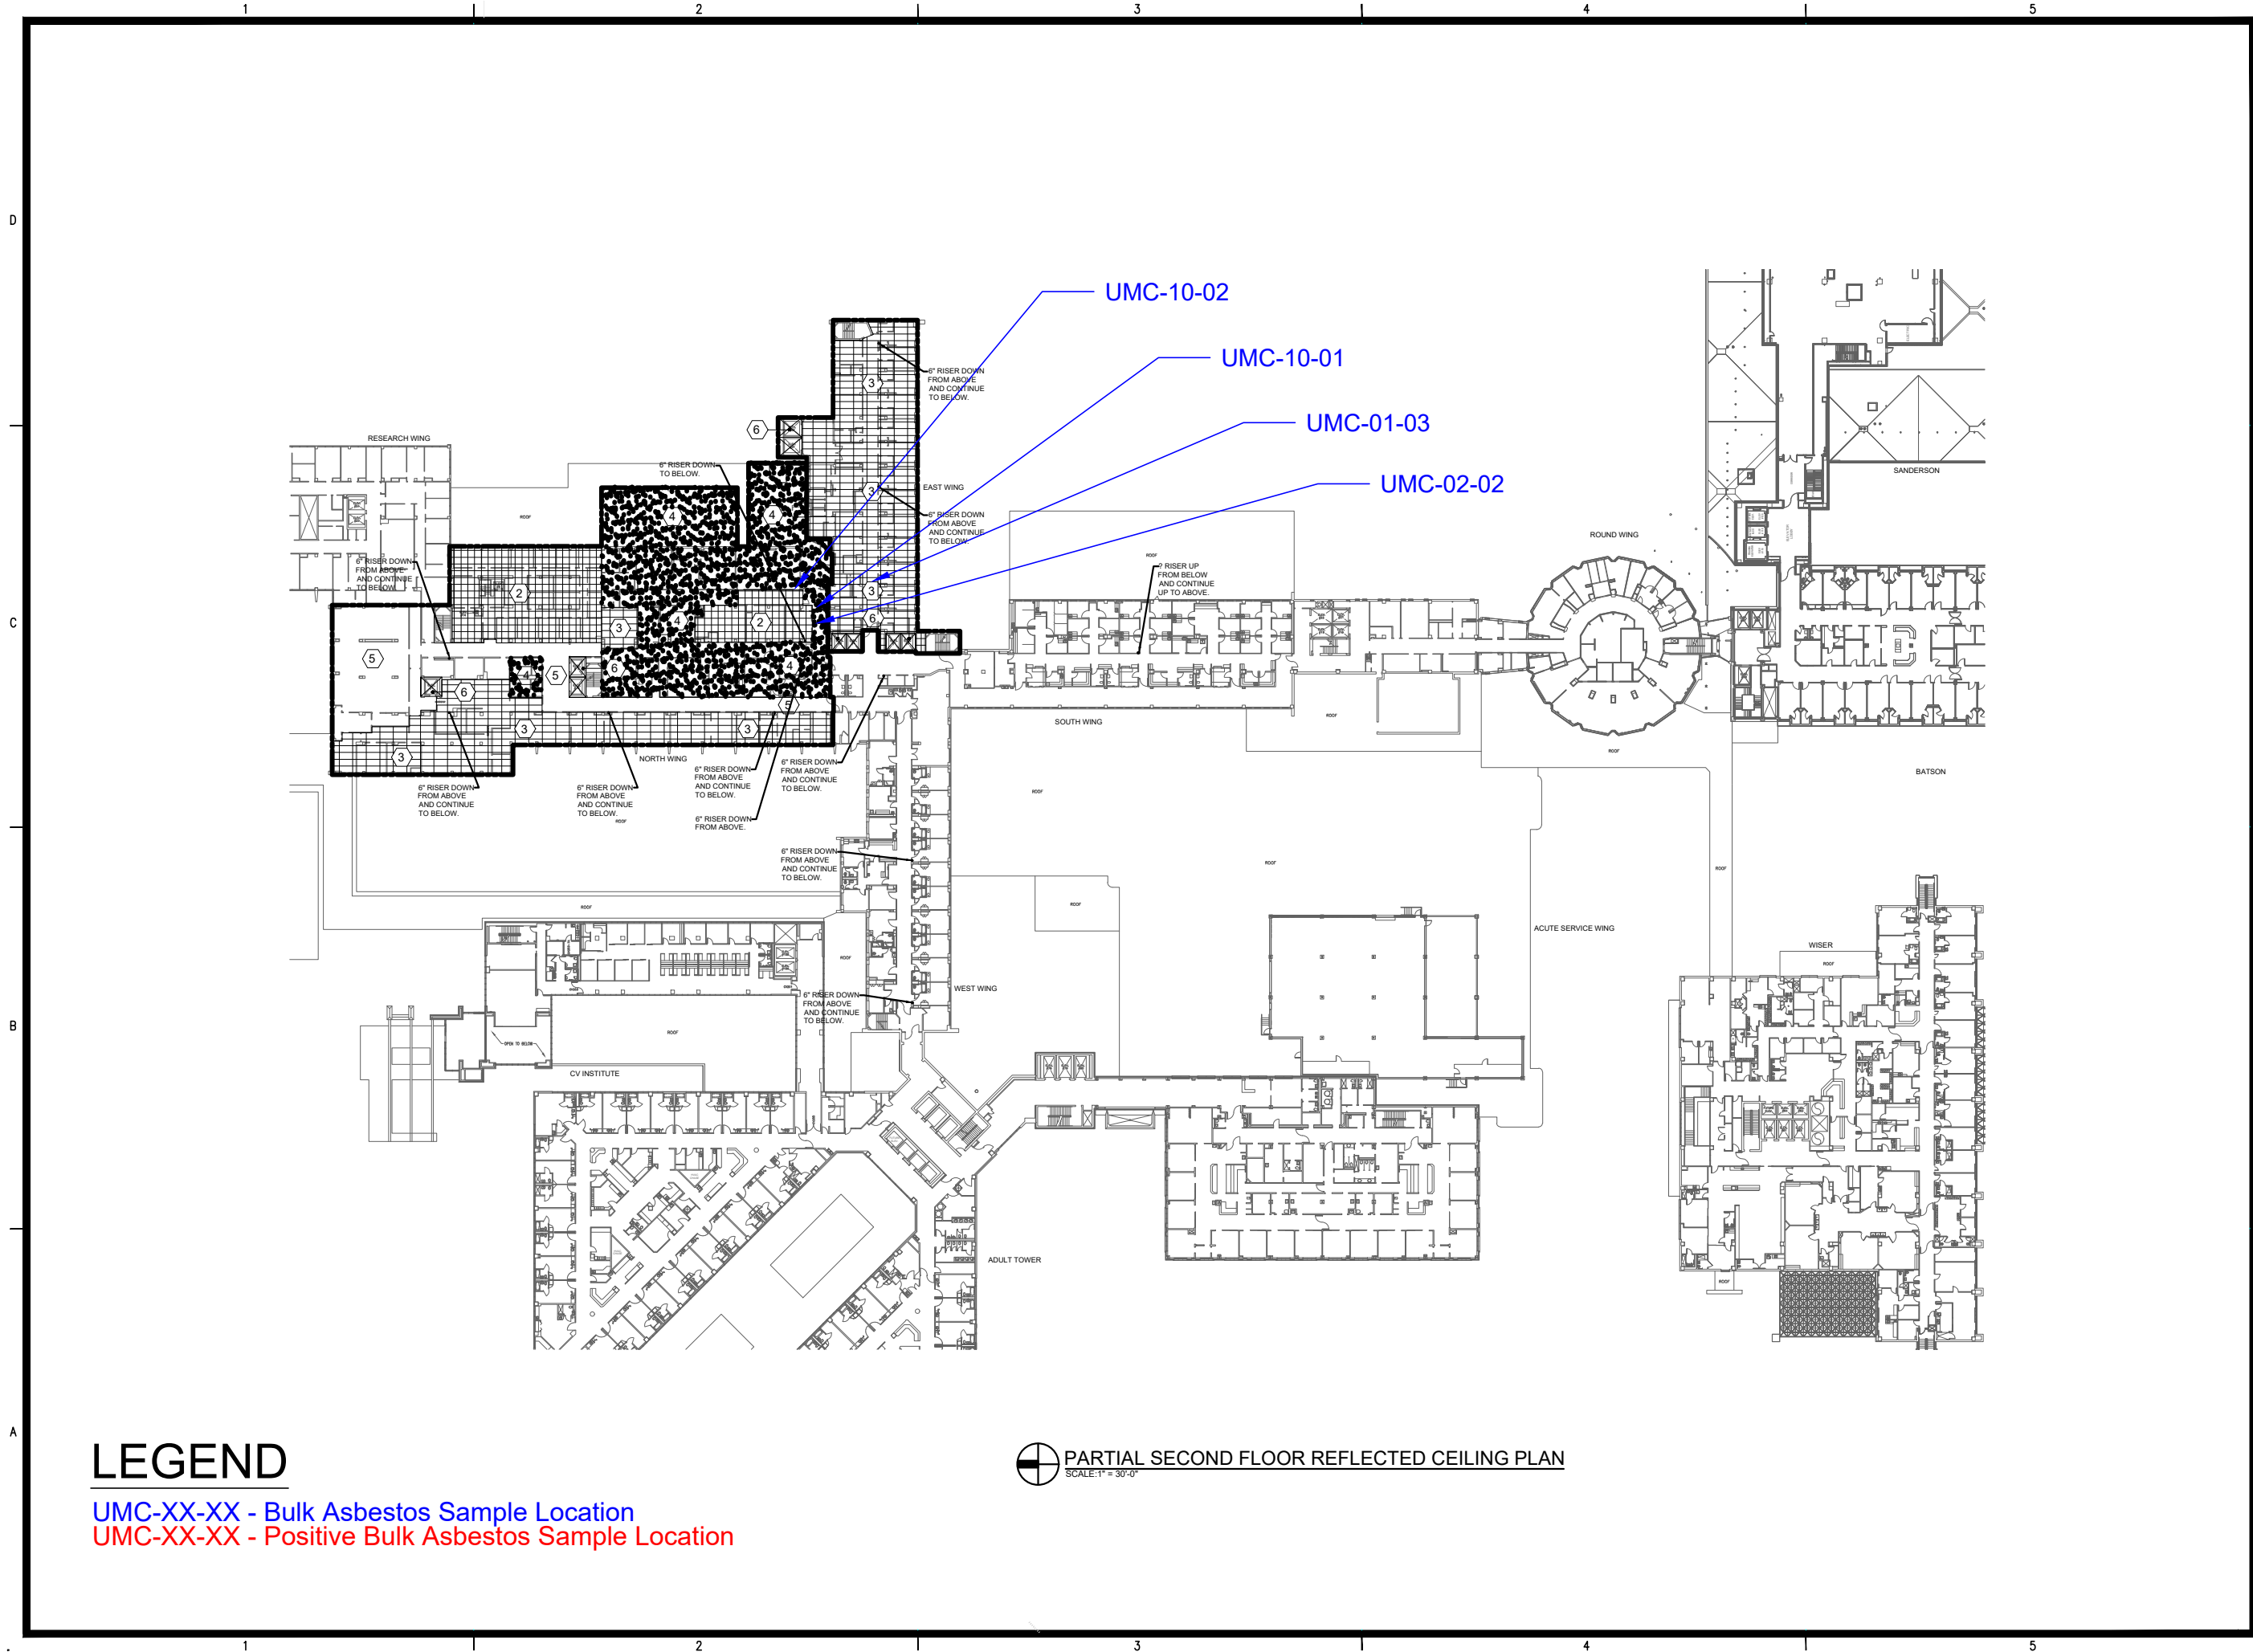

LEGEND

UMC-XX-XX - Bulk Asbestos Sample Location
UMC-XX-XX - Positive Bulk Asbestos Sample Location



PARTIAL SECOND FLOOR REFLECTED CEILING PLAN
SCALE: 1" = 30'-0"

REVISIONS:

PROJECT #: 23758.15

DATE: JUNE 2026

DRAWN BY: JD

DESIGNER:

CHECKED BY: MC




Second Floor
Fire Protection Central Core
University of Mississippi Medical Center

SHEET NUMBER:

3

DESCRIPTION:

Sample Locations

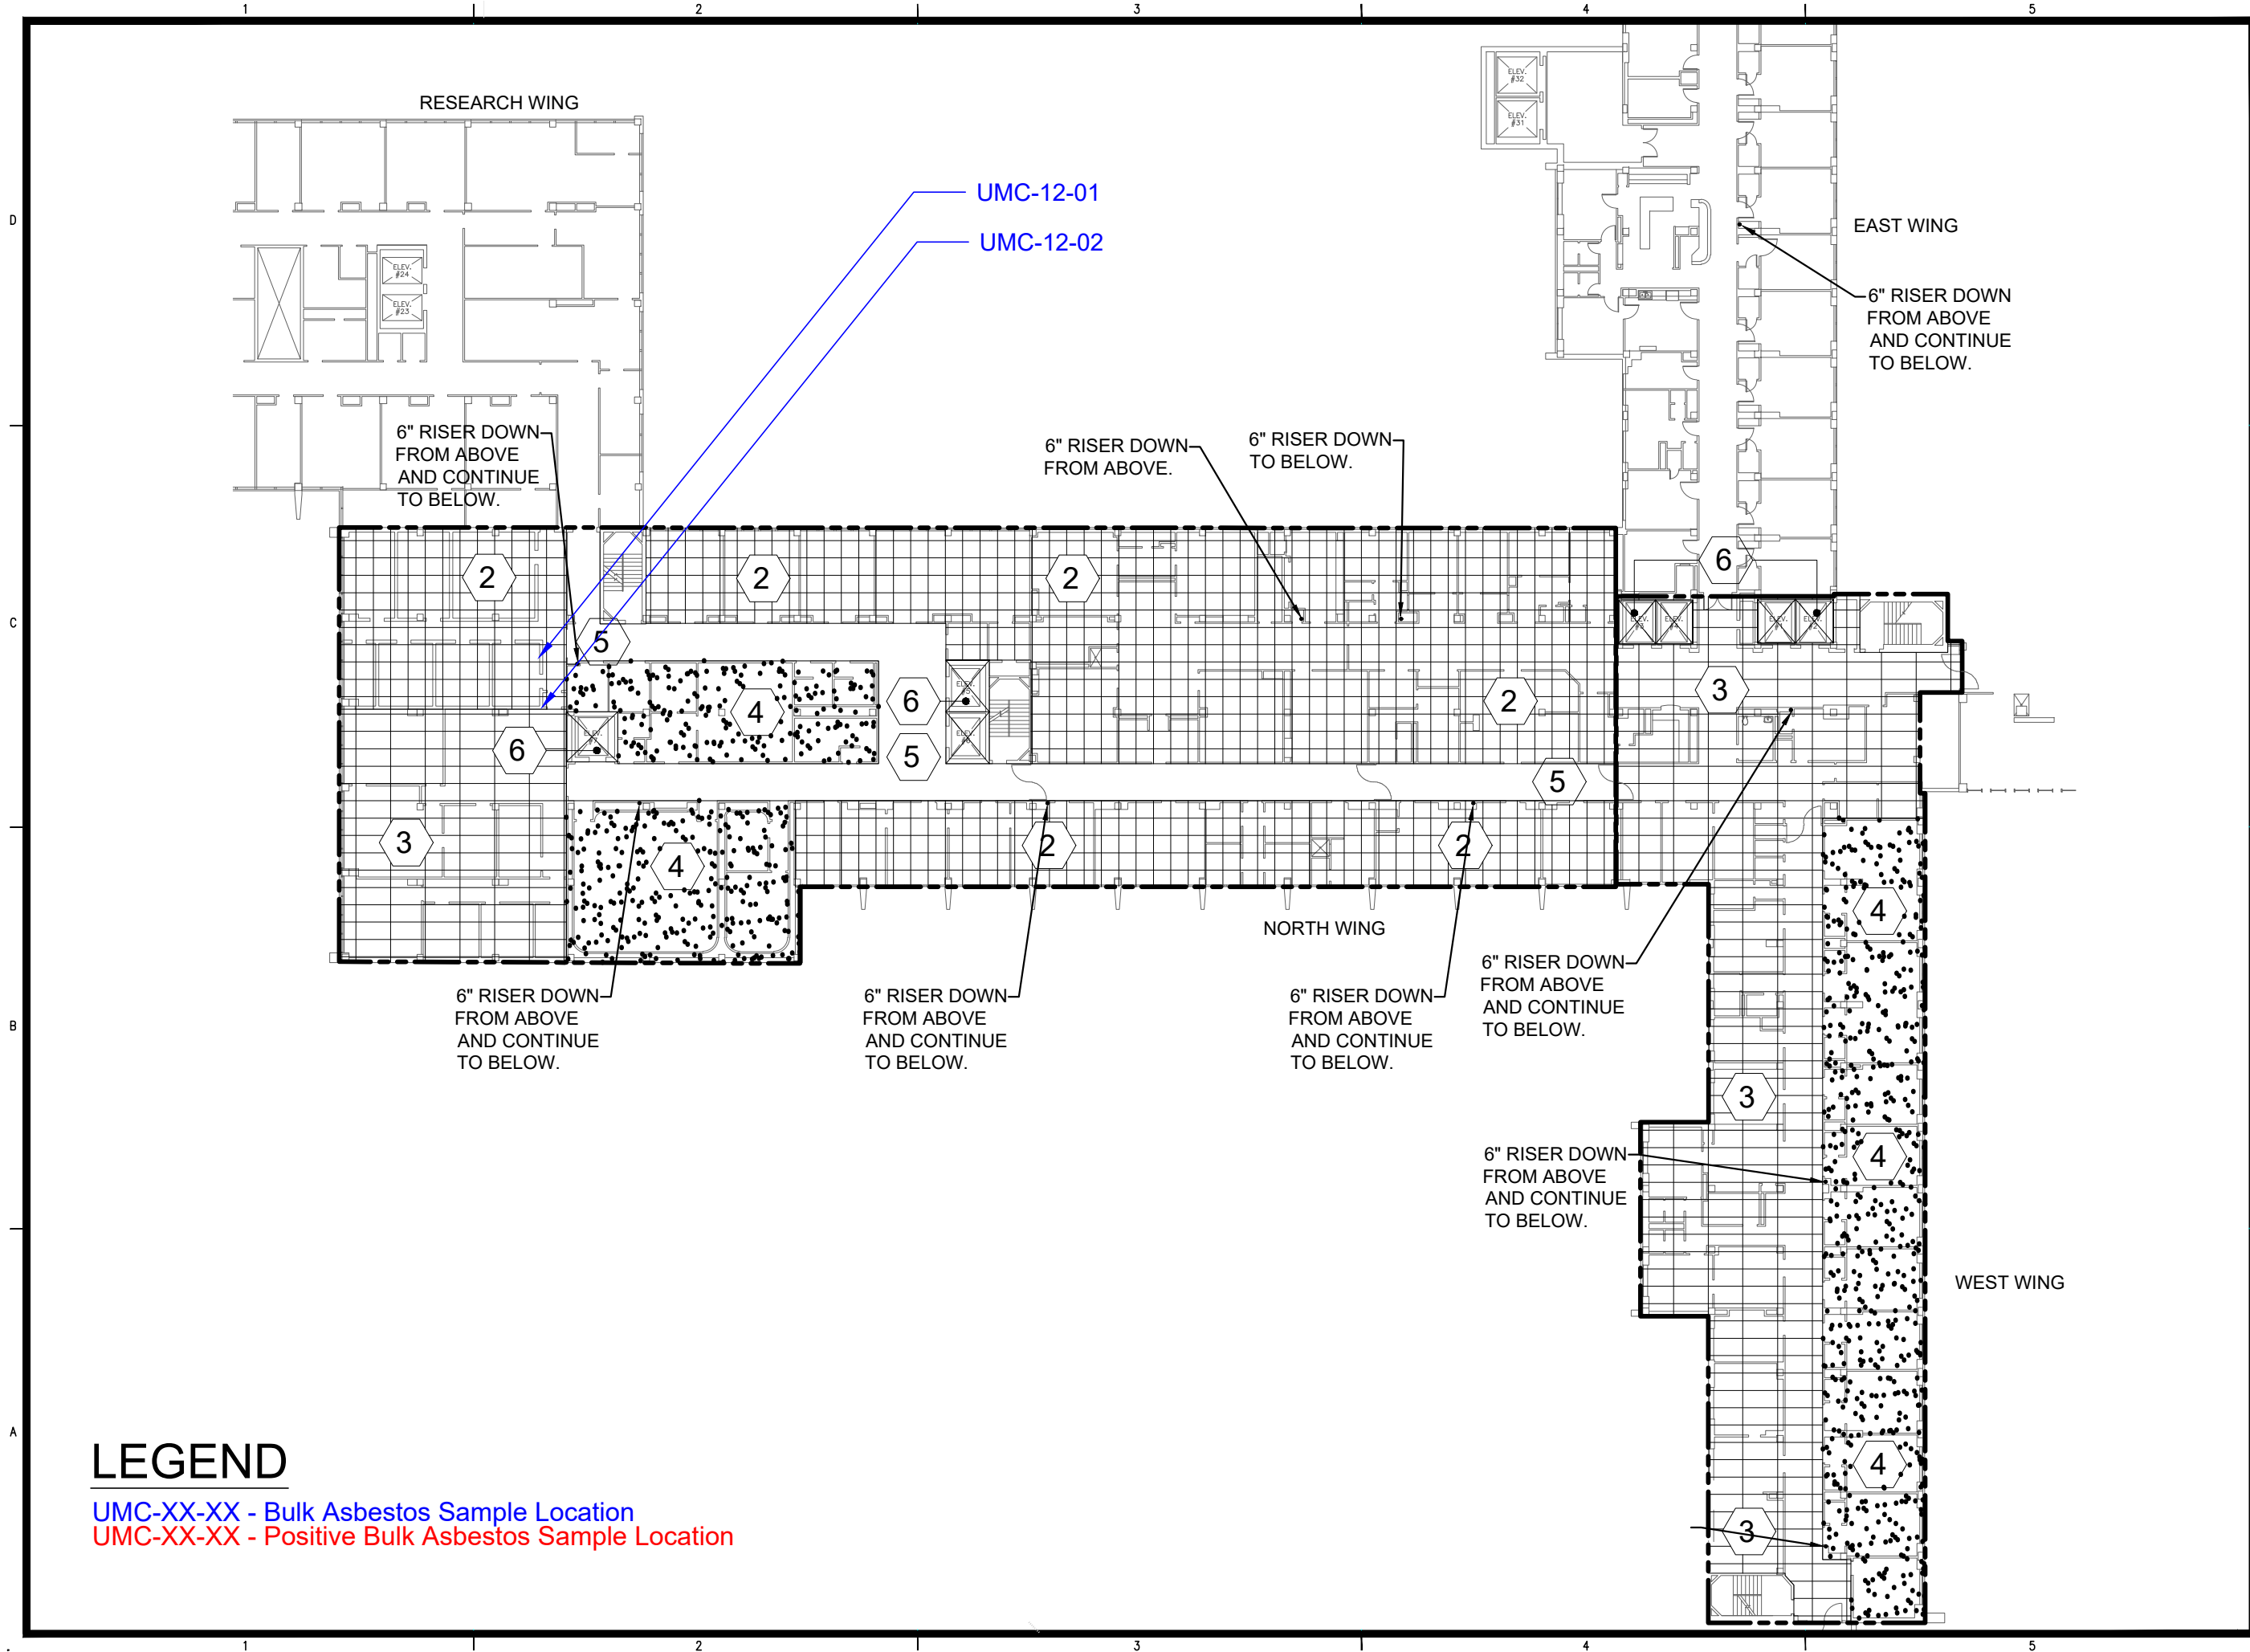

LEGEND

- UMC-XX-XX - Bulk Asbestos Sample Location
- UMC-XX-XX - Positive Bulk Asbestos Sample Location

REVISIONS:		

PROJECT #:	23758.15
DATE:	JUNE 2026
DRAWN BY:	JD
DESIGNER:	
CHECKED BY:	MC




Fourth Floor Fire Protection Central Core University of Mississippi Medical Center

SHEET NUMBER:

5

DESCRIPTION:

Sample Locations

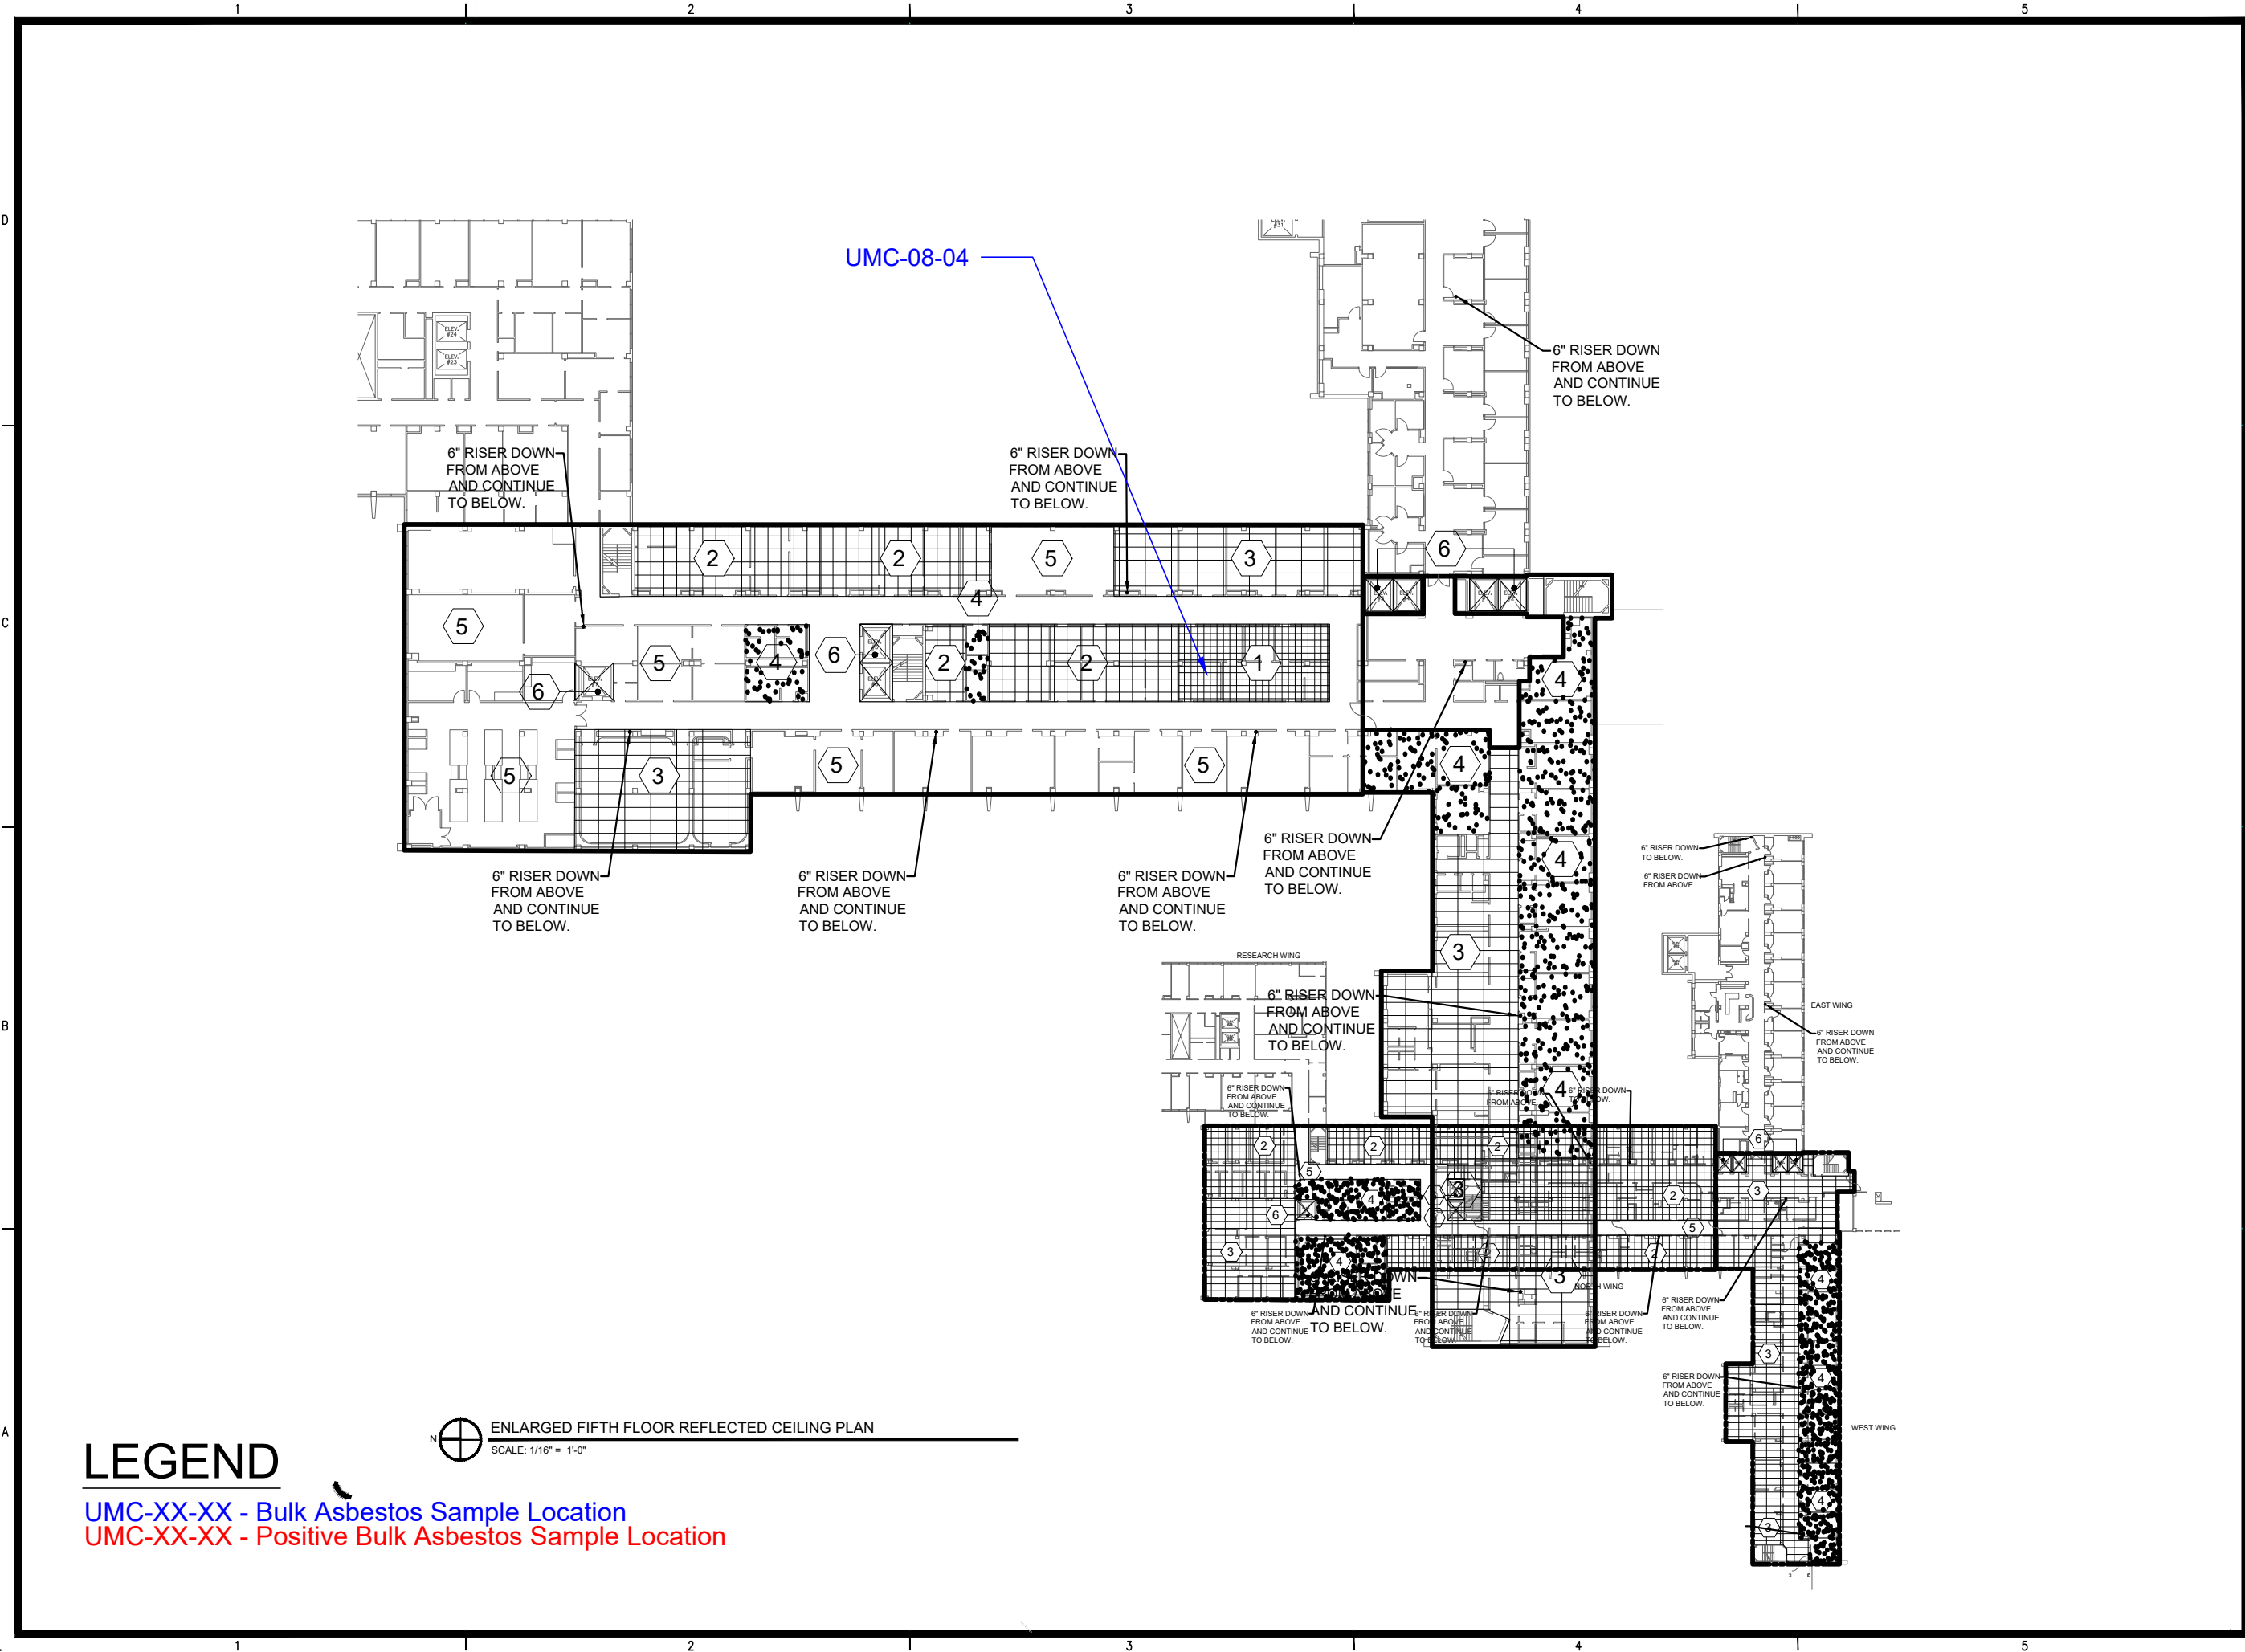

REVISIONS:

PROJECT #: 23758.15

DATE: JUNE 2026

DRAWN BY: JD

DESIGNER:

CHECKED BY: MC




Fifth Floor
Fire Protection Central Core
University of Mississippi Medical Center

SHEET NUMBER:

6

DESCRIPTION:

Sample Locations

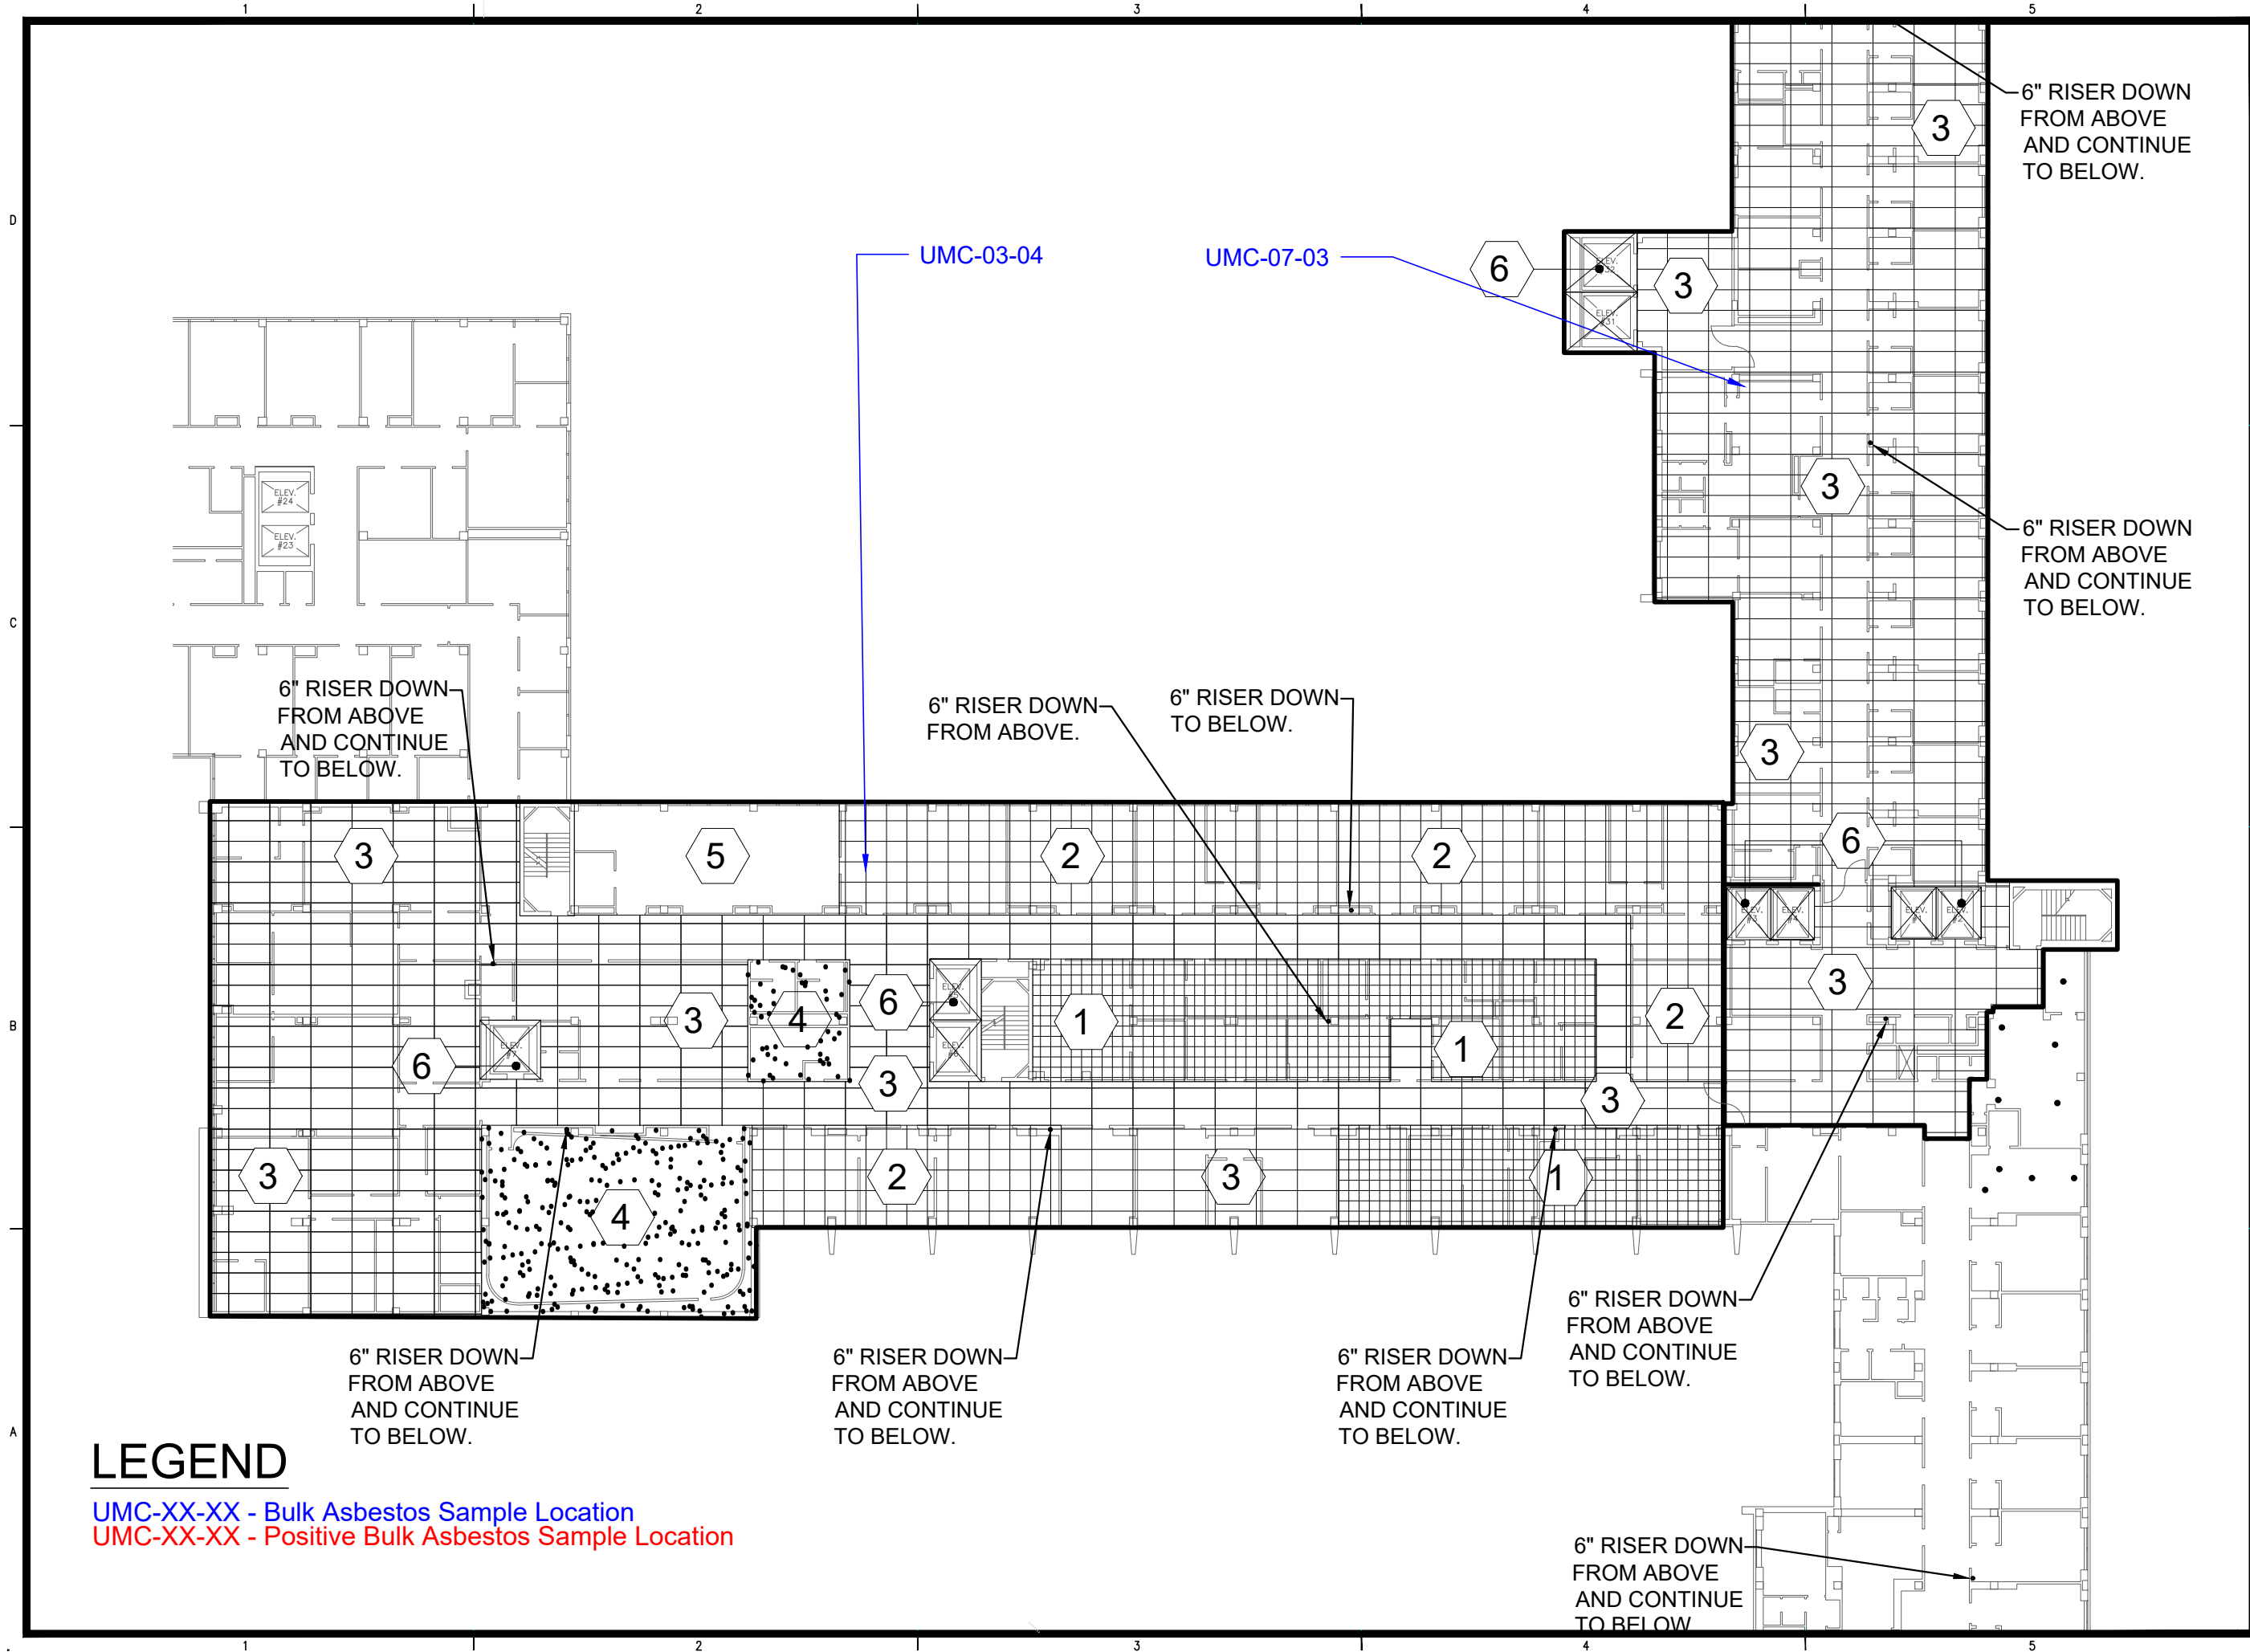

REVISIONS:		


PROJECT #:	23758.15
DATE:	JUNE 2026
DRAWN BY:	JD
DESIGNER:	
CHECKED BY:	MC



Sixth Floor
Fire Protection Central Core
University of Mississippi Medical Center

SHEET NUMBER:
7

DESCRIPTION:
Sample Locations

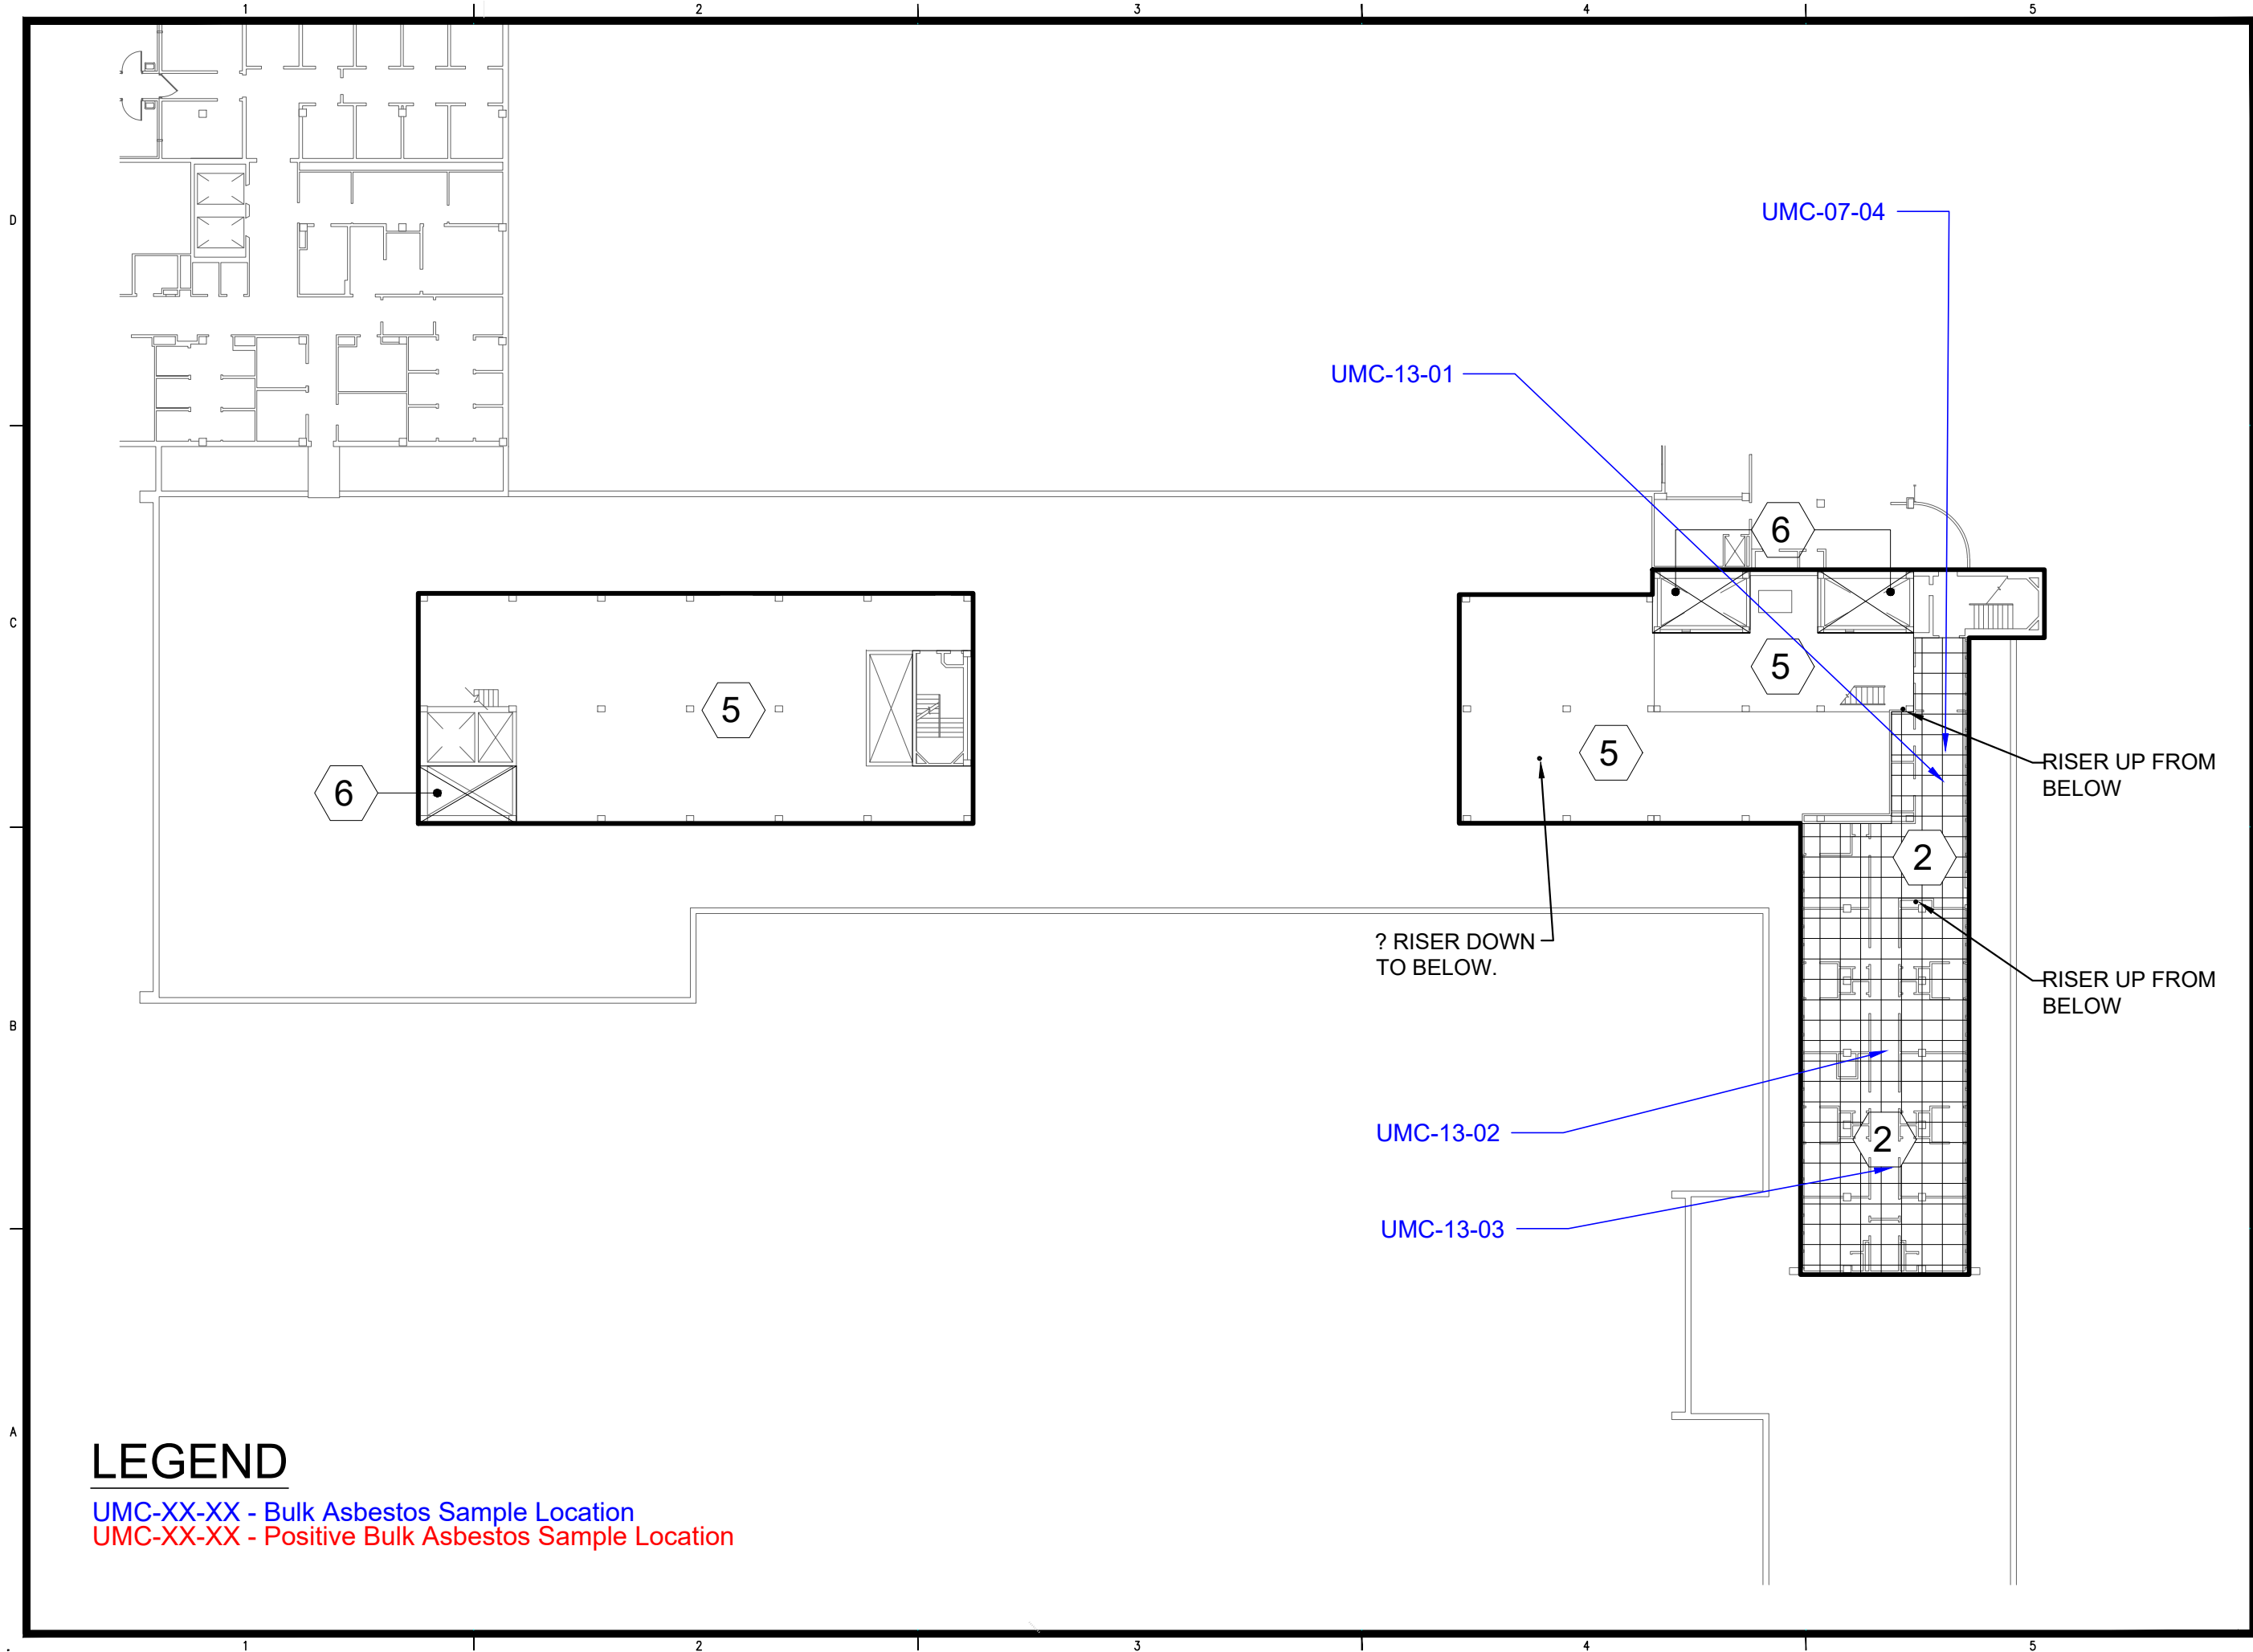

REVISIONS:

△		
△		
△		
△		

PROJECT #: 23758.15

DATE: JUNE 2026

DRAWN BY: JD

DESIGNER:

CHECKED BY: MC



**Eighth Floor
Fire Protection Central Core
University of Mississippi Medical Center**

SHEET NUMBER:

8

DESCRIPTION:

Sample Locations

APPENDIX 4.3
Mississippi Asbestos Inspector Certification

State of Mississippi

*Department of Environmental Quality
Office of Pollution Control*

Certificate of Licensure

In accordance with the Asbestos Abatement Accreditation and Certification Act,
Enacted as 1989 Mississippi Law, Chapter 505

Be it known that

Joshua R Dunn

Having submitted acceptable evidence of qualifications and
training and other appropriate information, is hereby granted this

***Asbestos Inspector
Certification***



*Certificate No.: ABI-00013168
Expiration Date: Oct 17th, 2026
Training Expires on Oct 17th, 2026*

Chief, Asbestos & Lead Branch

88010 LIC20250001

State of Mississippi

*Department of Environmental Quality
Office of Pollution Control*

Certificate of Licensure

In accordance with the Asbestos Abatement Accreditation and Certification Act,
Enacted as 1989 Mississippi Law, Chapter 505

Be it known that

Martin A Cooke

Having submitted acceptable evidence of qualifications and
training and other appropriate information, is hereby granted this




***Asbestos Inspector
Certification***



*Certificate No.: ABI-00002227
Expiration Date: Feb 13th, 2027
Training Expires on Feb 13th, 2027*

Chief, Asbestos & Lead Branch

40586 LIC20260003

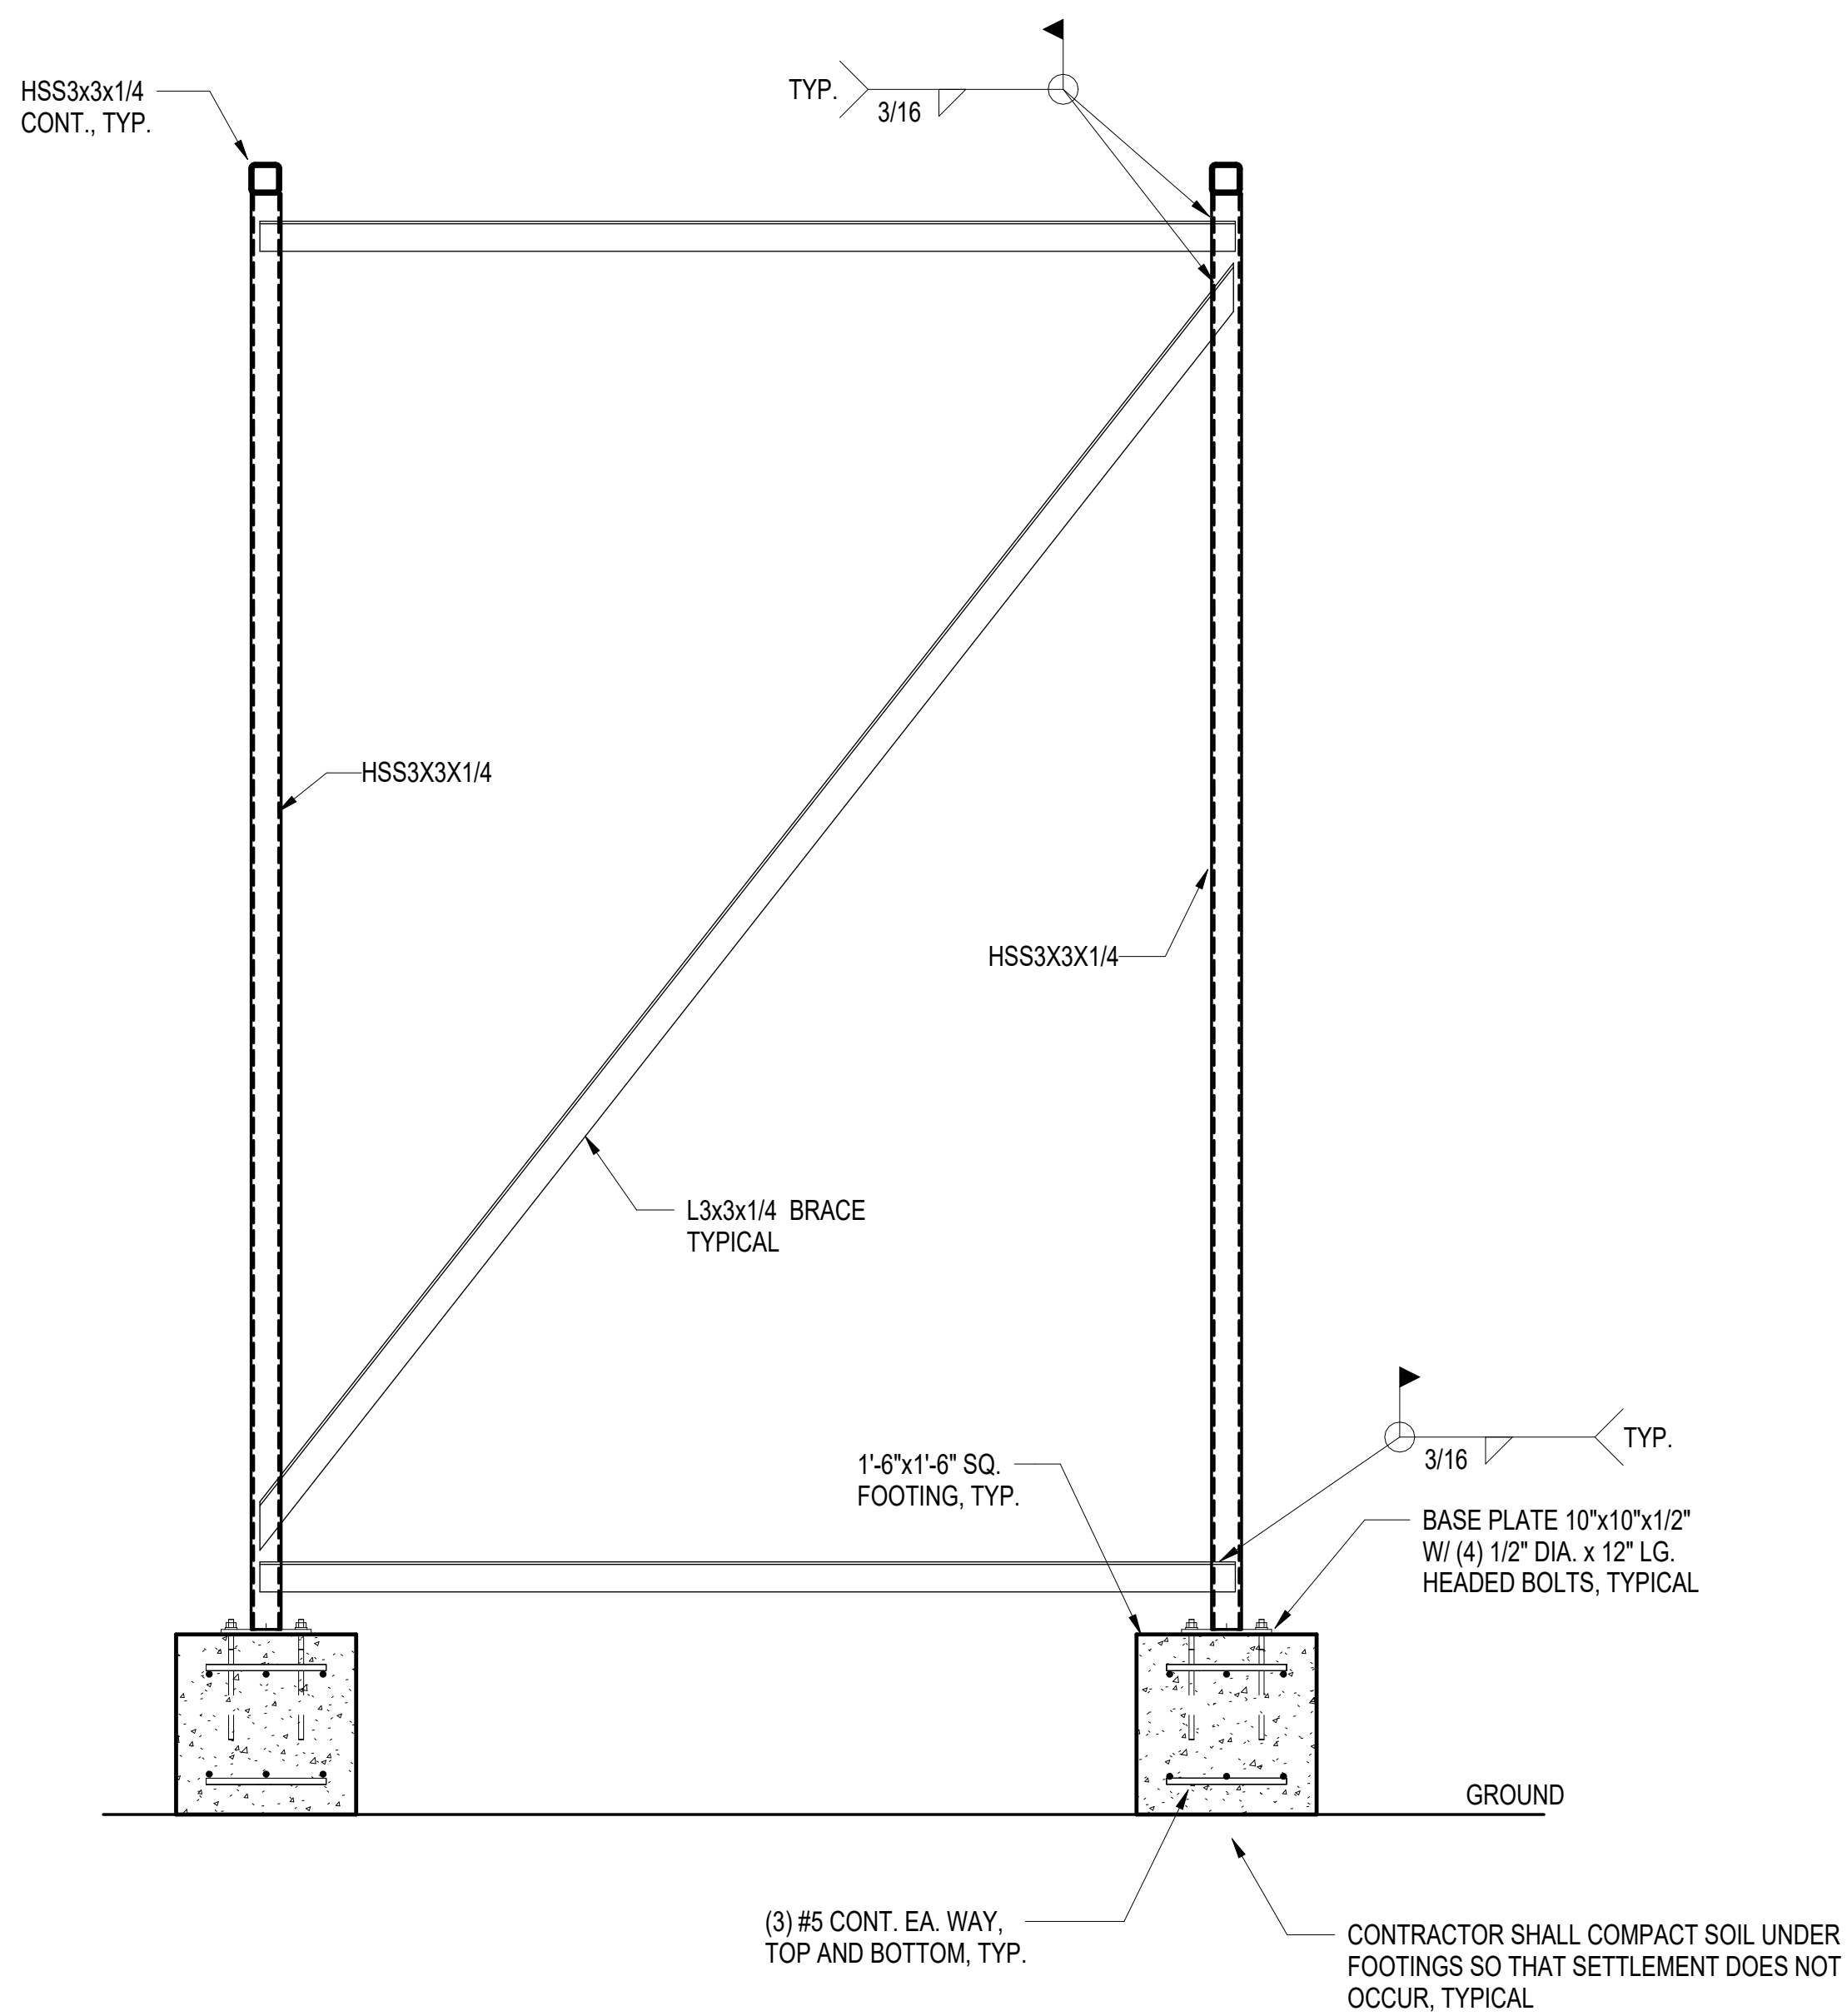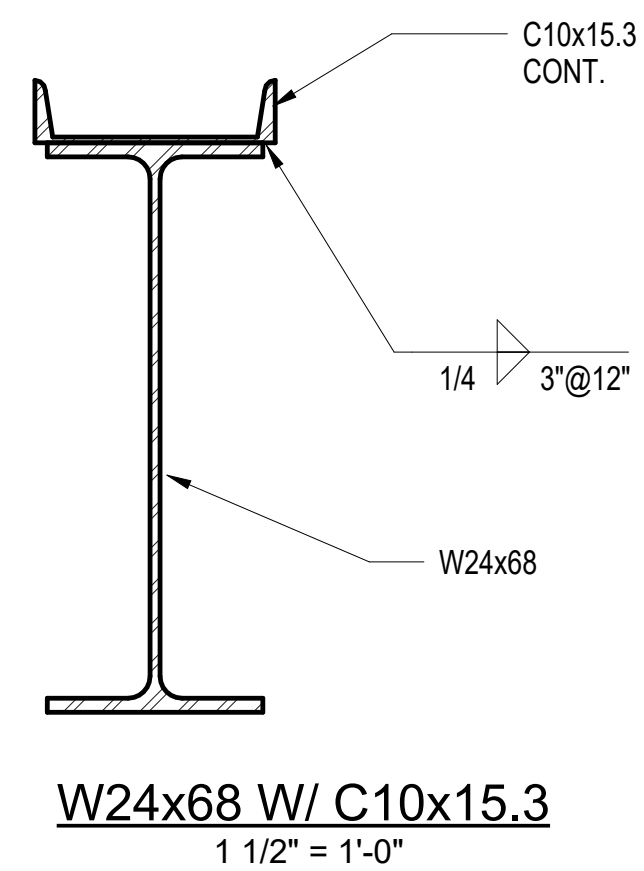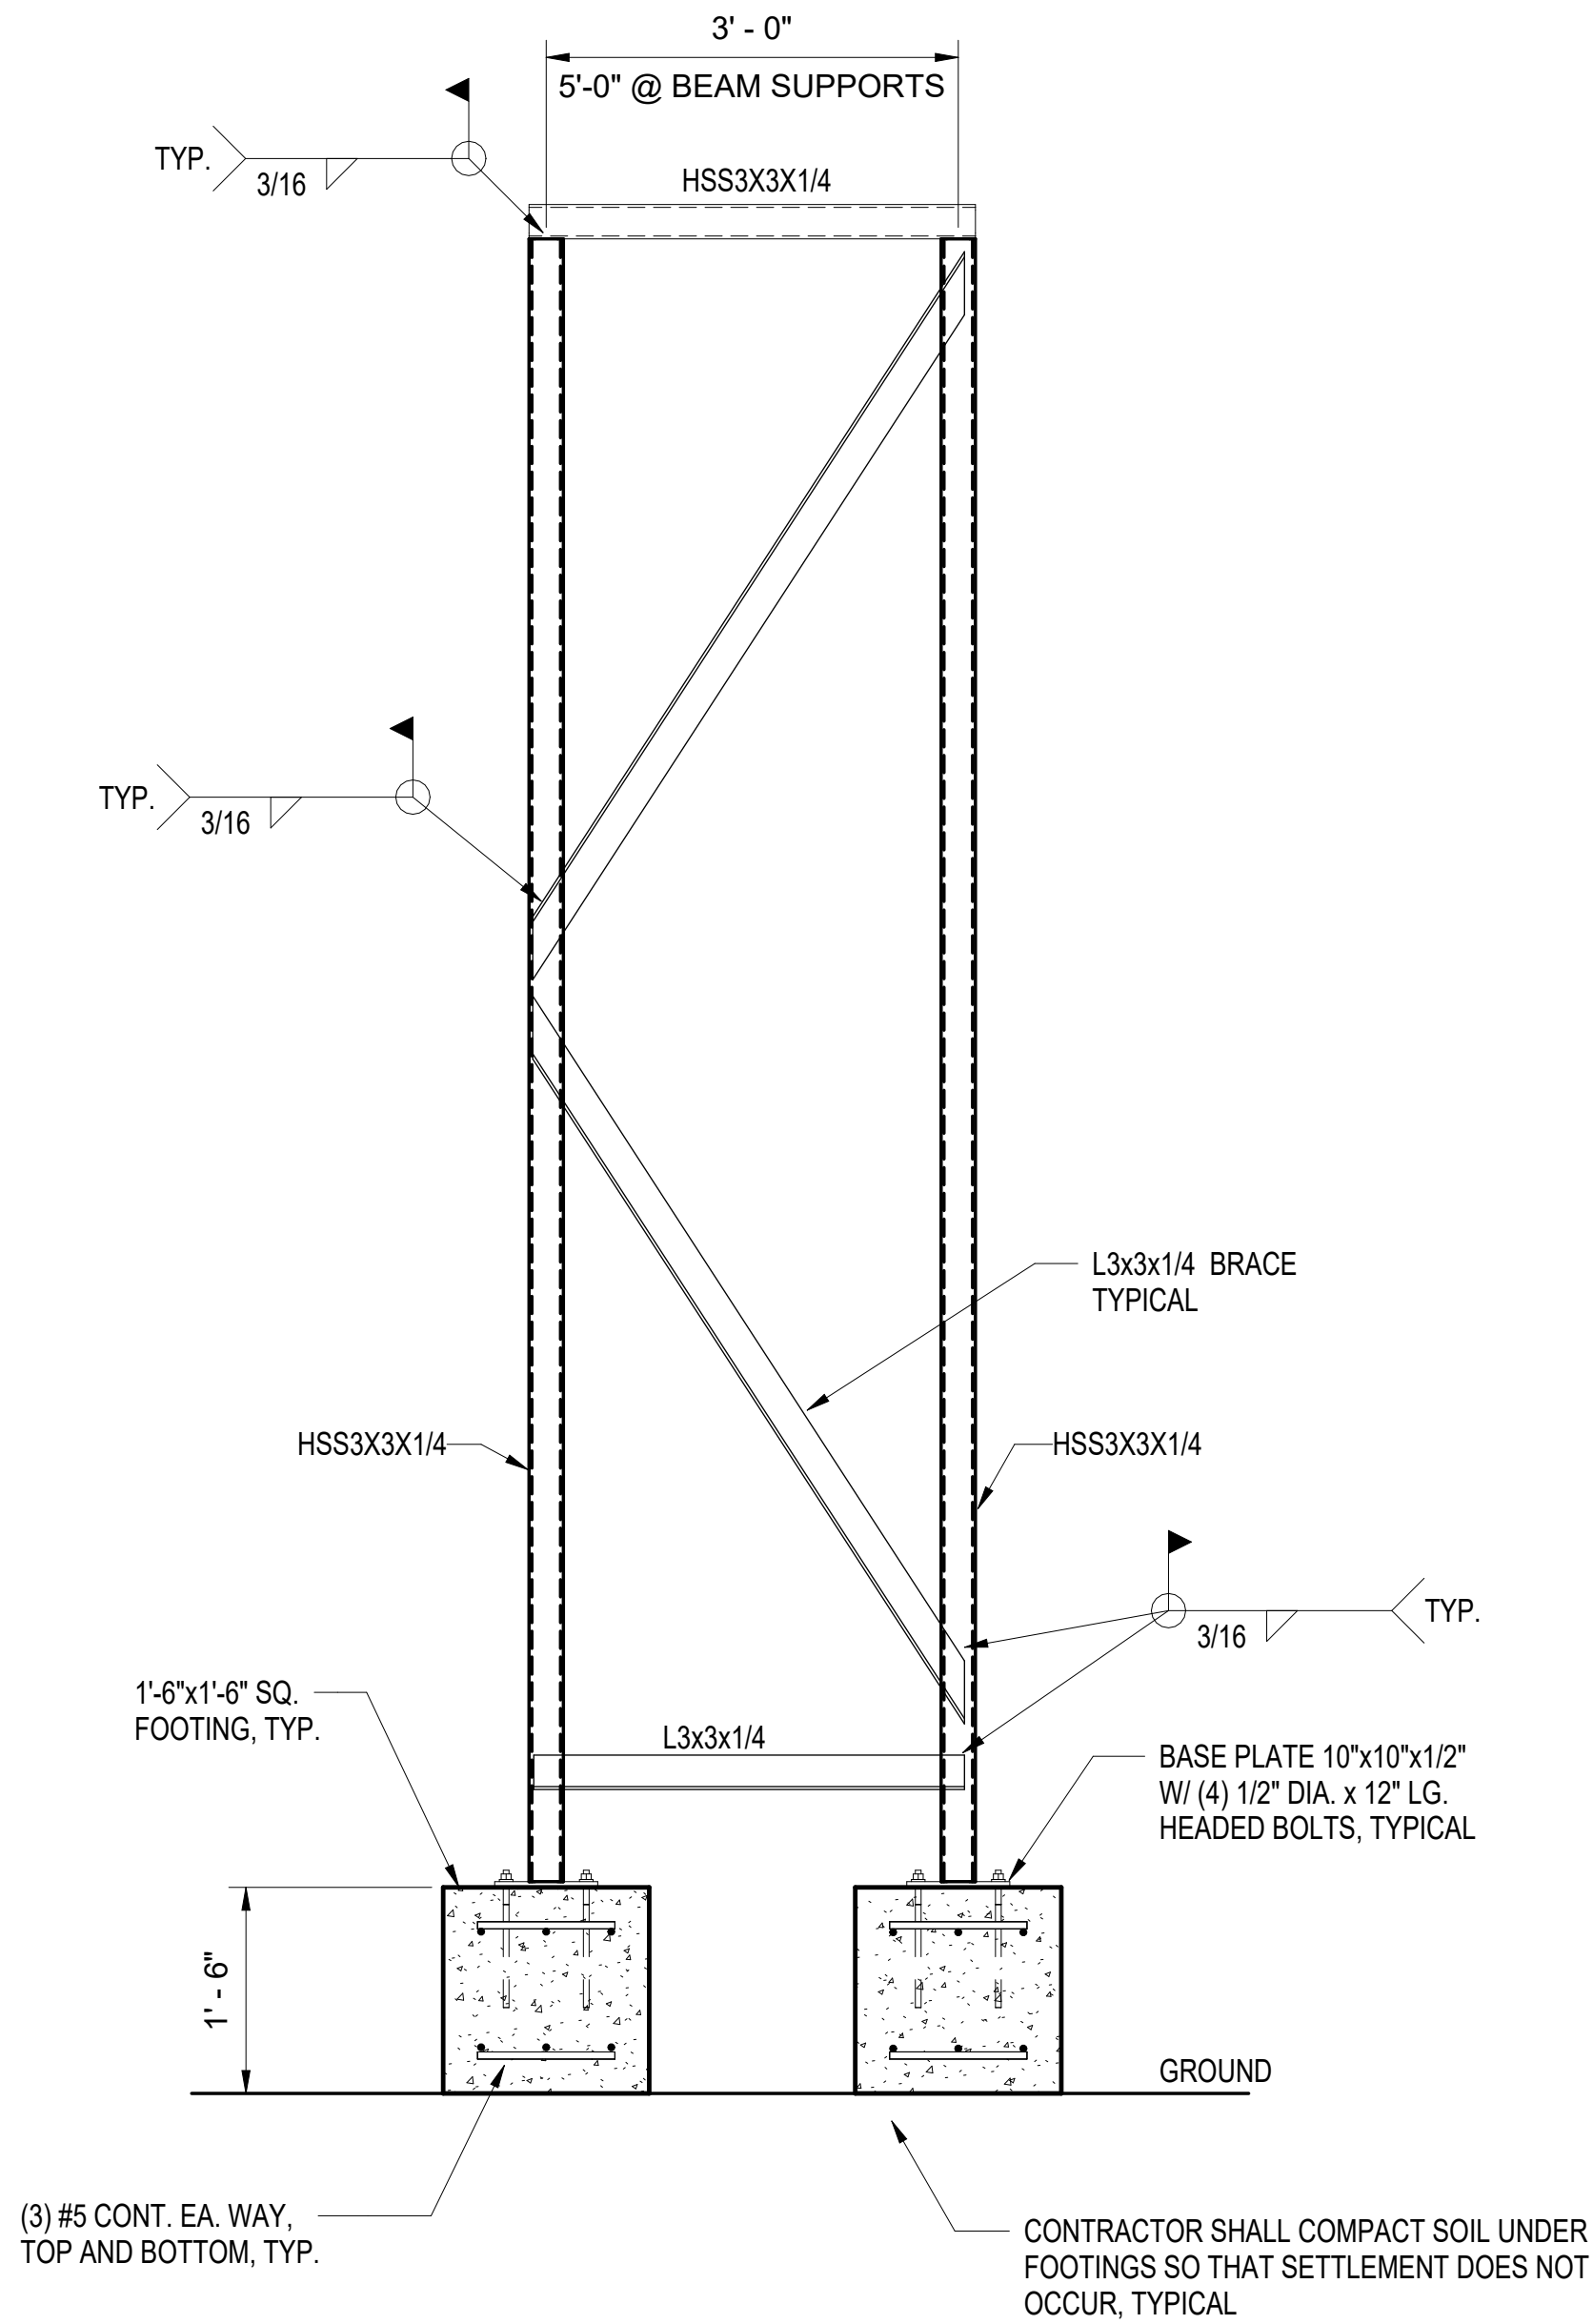

SE 26031

Spencer-Engineers, Inc. Consultants
P.O. BOX 4328 JACKSON, MS 39296
(601) 982-7766

NOT FOR CONSTRUCTION

DETAILS

1
sheet no.
S102
of



FIRE PROTECTION CENTRAL CORE
UNIVERSITY OF MISSISSIPPI MEDICAL CENTER
UMMC 409-007
JACKSON MISSISSIPPI

project no.
1686-24
date
15 JULY 2026
revised
7-29-26 ADD. #1
drawn by
KSM

FoilWatt
Architects & Planners, PLLC
SUITE 400
1001 S. GULF BLVD.
JACKSON, MS 39201
TEL: (601) 335-3070
FAX: (601) 335-3071
WWW.FOILWATT.COM

To the Drawings:

- A. Sheet FP201, Sub-Basement Overall New Work:
 - 1. New sprinkler zone scope boundary added.
- B. Sheet FP201-D, Sub-Basement Overall Demolition
 - 1. Pressure relief drainpipe demolished back to exterior wall.
- C. Sheet FP202, Basement Overall New Work
 - 1. Stair N-01 new 6" standpipe connected into existing basement loop feed main.
- D. Sheet FP211, Penthouse Overall New Work
 - 1. New sprinkler zone scope boundary added.
- E. Sheet FP401, Fire Pump Enlargement Plans New Work
 - 1. New pressure relief piping removed.
 - 2. PRVs and connected piping increased in size from 6" to 8".
- F. Sheet FP401-D, Fire Pump Enlargement Plans Demolition
 - 1. Existing pressure relief piping demolished back to exterior wall and capped.
- G. Sheet FP601, Sections
 - 1. Keyed note #8 updated to make use of existing path of demolished 1" drain line for new 3" drain. Widen cored slab holes and wall penetrations where necessary.
- H. Sheet FP602, Sections
 - 1. Stair N-01 new 6" standpipe connected into existing basement loop feed main.

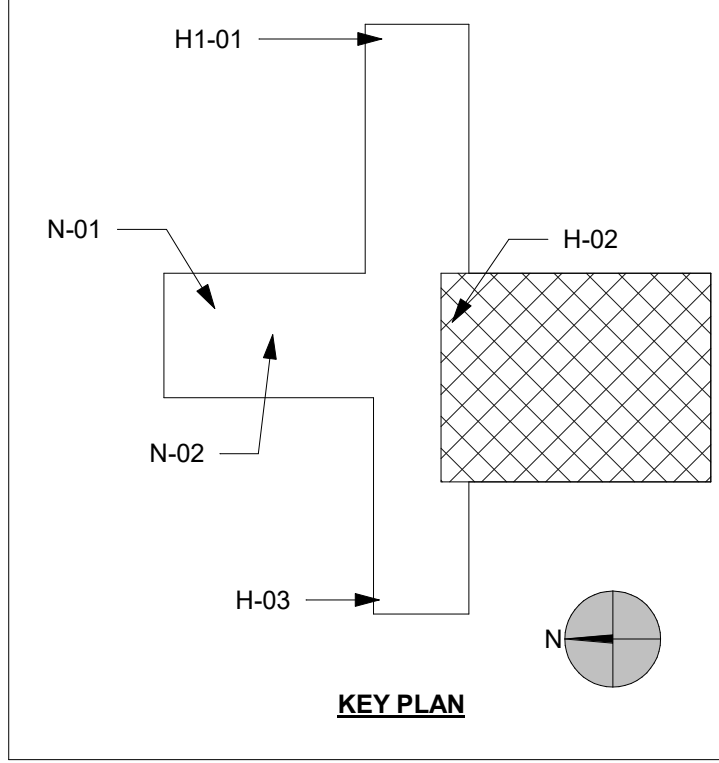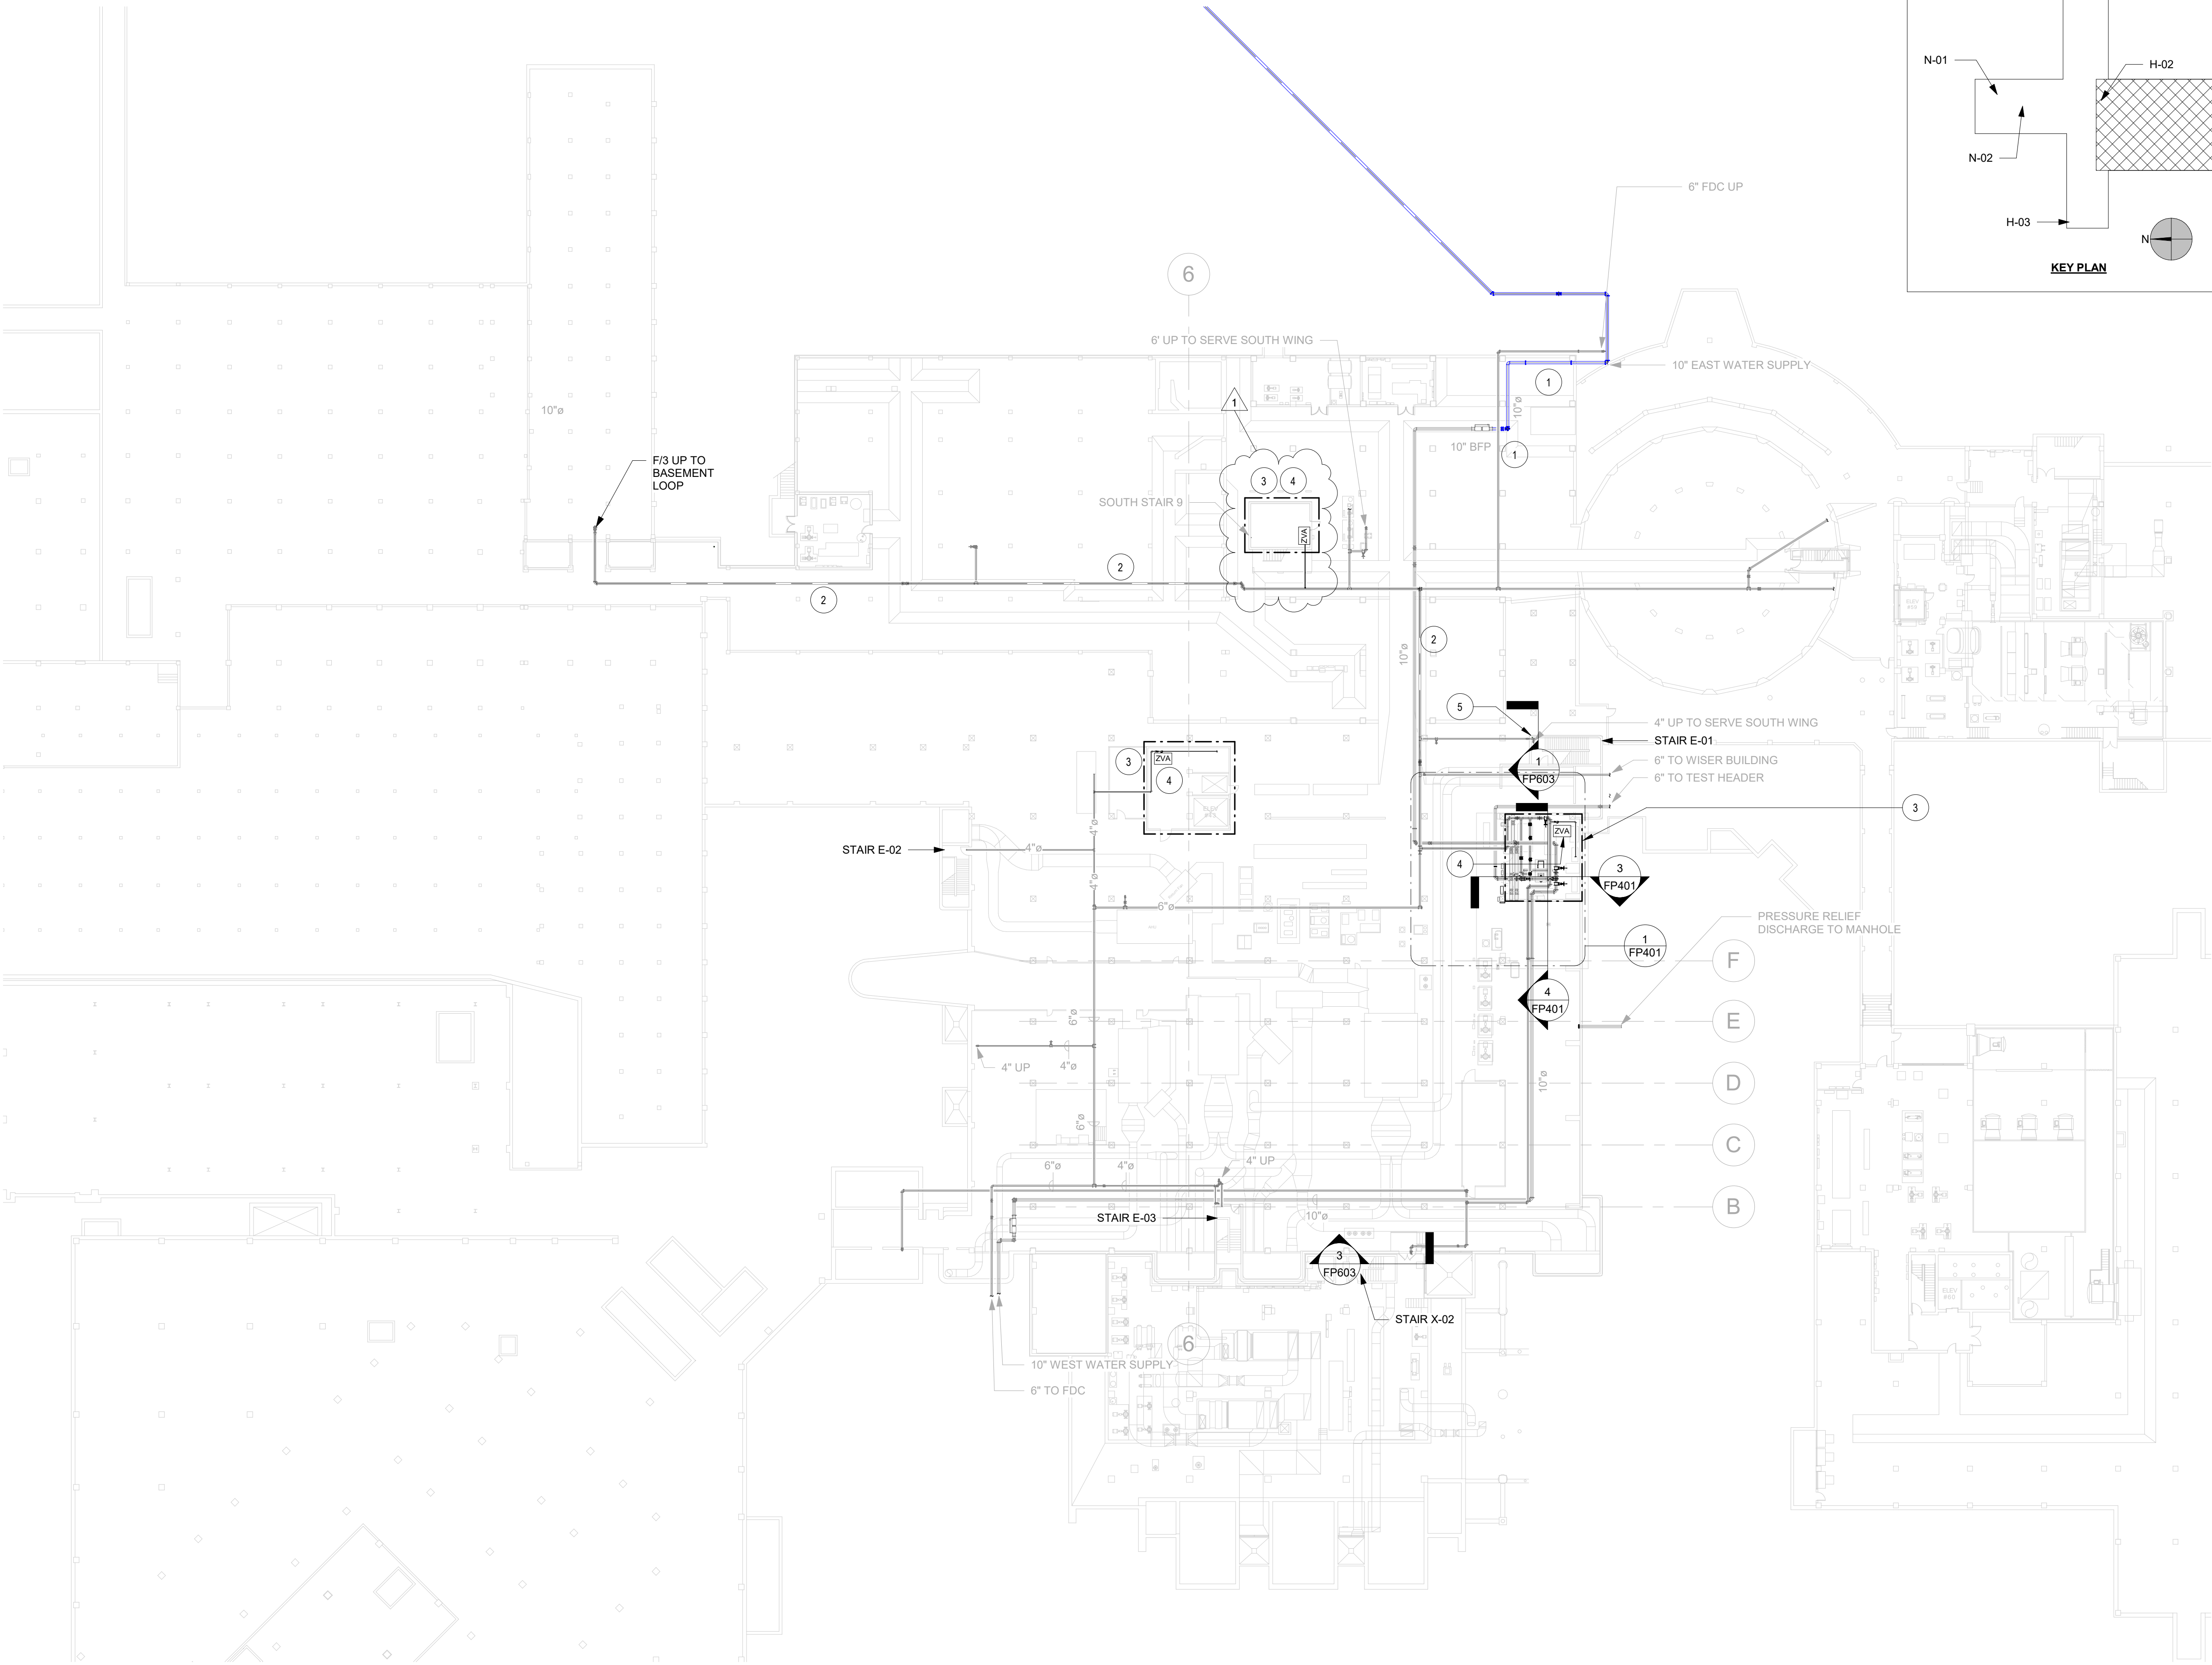

- GENERAL NOTES:
- A. REFERENCE COVER SHEET FP100 FOR ADDITIONAL GENERAL NOTES AND REQUIREMENTS.
 - B. COORDINATE FIRE WATCH WITH FACILITY SECURITY STAFF WHEN SPRINKLER SYSTEMS ARE IMPAIRED.

- KEYED NOTES
- 1. INSTALL NEW 10" SUPPLY PIPING AS INDICATED.
 - 2. NEW 8" PUMP DISCHARGE PIPING.
 - 3. NEW SPRINKLER ZONE BOUNDARY.
 - 4. NEW SPRINKLER ZONE VALVE.
 - 5. NEW 3" EXPRESS DRAIN. CONNECT IN NEW AND EXISTING ZONE VALVES DRAINS. ROUTE 3" EXPRESS DRAIN PIPE TO APPROVED DRAIN LOCATION.

1 SUB-BASEMENT FLOOR OVERALL - NEW WORK
1" = 30'-0"

CONSTRUCTION DOCUMENTS

FIRE PROTECTION CENTRAL CORE
UNIVERSITY OF MISSISSIPPI MEDICAL CENTER

JACKSON MISSISSIPPI
UMMC 409-007

project no.
1686-24
date
12 JUNE 2026
revised
05 AUGUST 2026



drawn by:
-

SUB-BASEMENT
OVERALL
NEW WORK

sheet no.
FP201

FoilWATT
Architects & Planners, PLLC
SUITE 101
436 OLD CANTON ROAD
JACKSON, MS 39201
TELEPHONE: (601) 353-3071
EMAIL: fwjackson@foilwatt.com
WEB: www.foilwatt.com



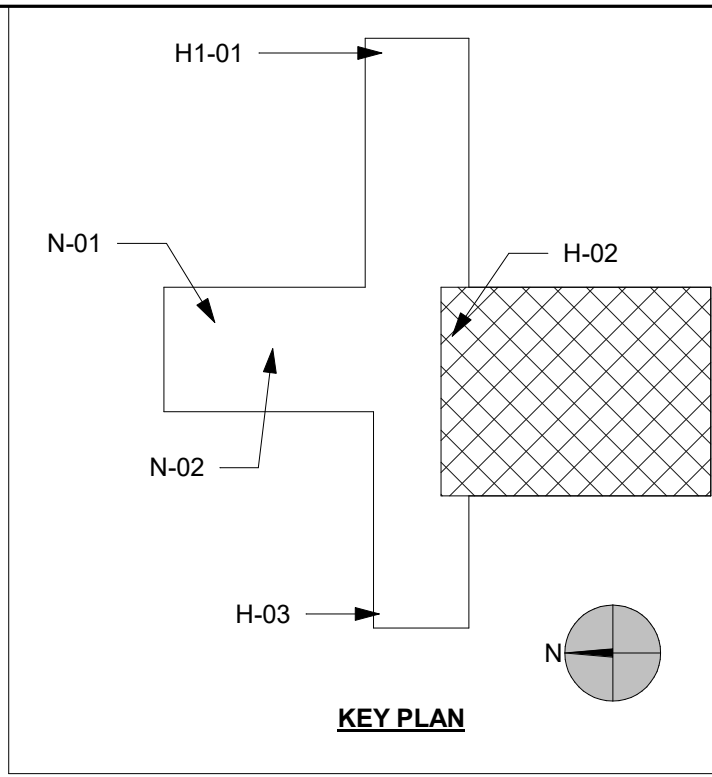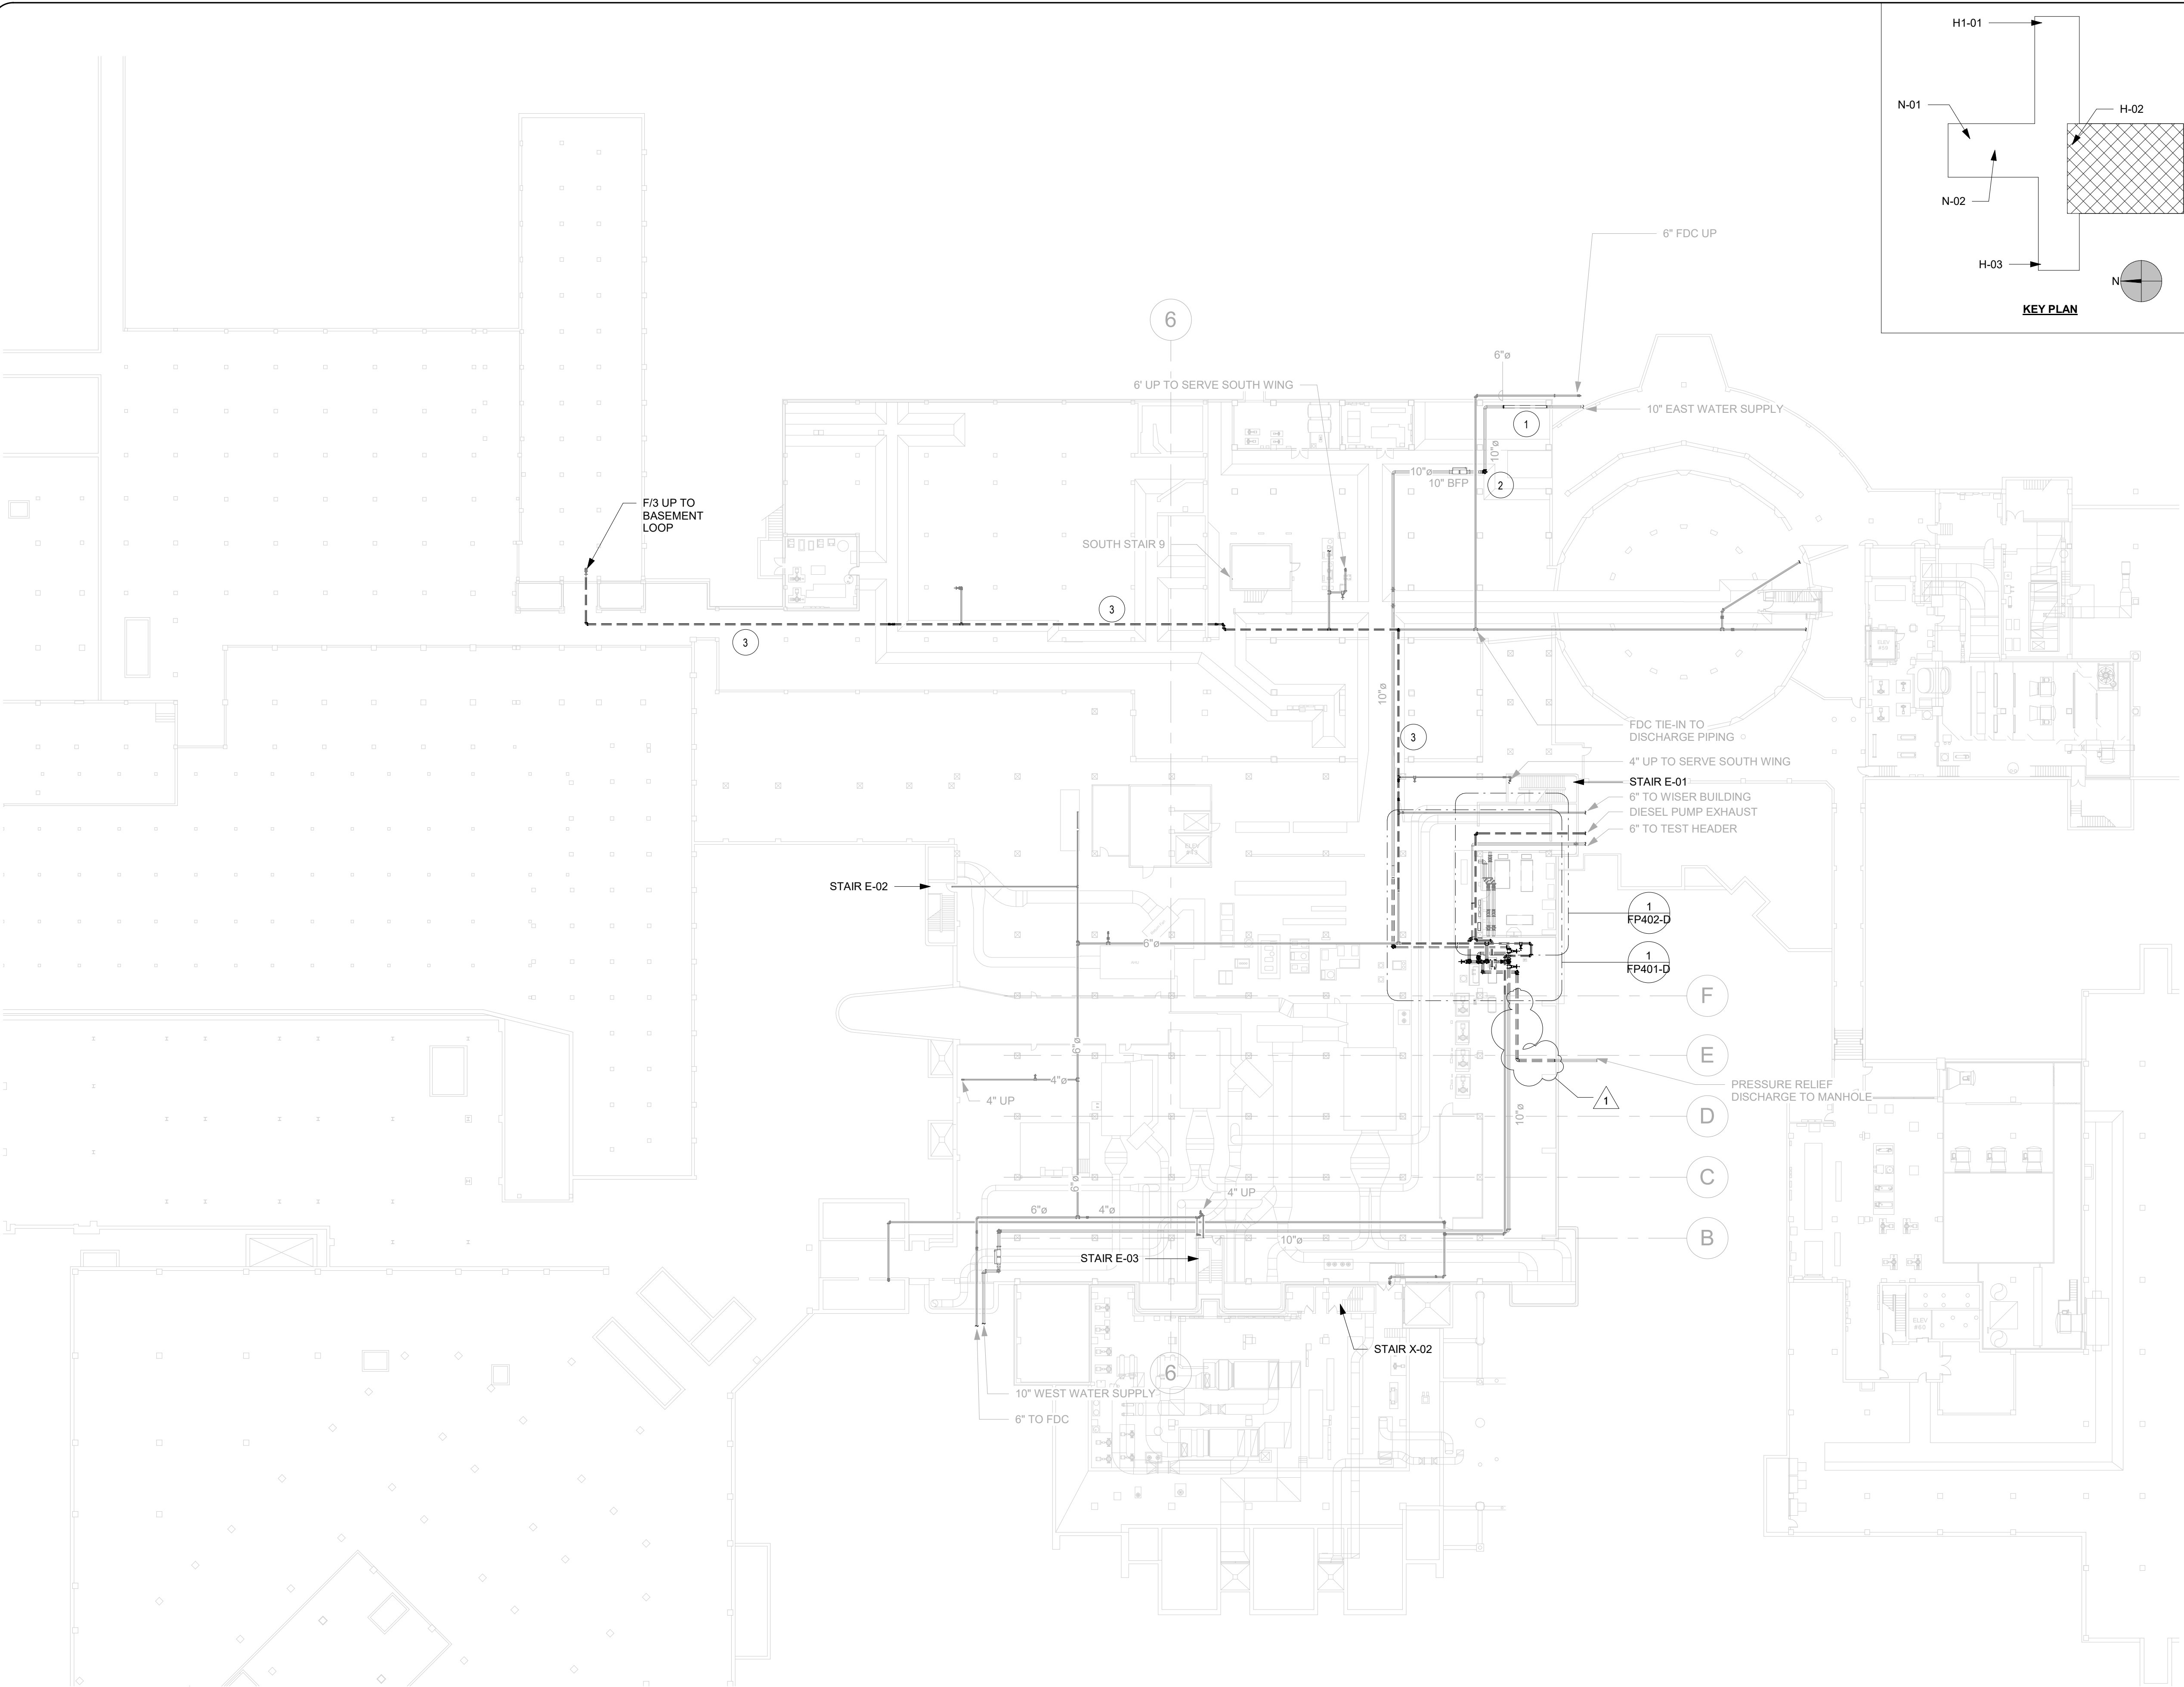

- GENERAL NOTES:
- A. REFERENCE COVER SHEET FP100 FOR ADDITIONAL GENERAL NOTES AND REQUIREMENTS.
 - B. COORDINATE FIRE WATCH WITH FACILITY SECURITY STAFF WHEN SPRINKLER SYSTEMS ARE IMPAIRED.

- KEYED NOTES
- 1. DEMOLISH INDICATED PORTION OF 10" SUPPLY PIPE AND FITTINGS.
 - 2. DEMOLISH VERTICAL PORTION OF CORRODED 10" PIPE.
 - 3. DEMOLISH INDICATED PORTION OF 6" PUMP DISCHARGE PIPING. SEE PHASING PLAN ON SHEET FP102.

1 SUB-BASEMENT FLOOR PLAN - DEMOLITION
1" = 30'-0"

CONSTRUCTION DOCUMENTS

FIRE PROTECTION CENTRAL CORE
UNIVERSITY OF MISSISSIPPI MEDICAL CENTER
JACKSON

MISSISSIPPI
UMMC 409-007

project no.
1686-24
date
12 JUNE 2026
revised
05 AUGUST 2026

SUB-BASEMENT
OVERALL
DEMOLITION

sheet no.
FP201-D

FoilWYATT
Architects & Planners, PLLC
SUITE 101
436 OLD CANTON ROAD
JACKSON, MS 39201
TELEPHONE: (601) 353-3071
EMAIL: fwjackson@foilwyatt.com
WEB: www.foilwyatt.com



1. CONNECT INTO EXISTING CROSS MAIN WITH NEW CROSS MAIN FOR NEW SPRINKLER ZONE TO THE NORTH.
2. NEW SPRINKLER ZONE BOUNDARY.
3. MAIN HOISTWAY AND ACCESS FOR MATERIAL DELIVERY FOR SPRINKLER CONTRACTOR.
4. TEMPORARY FIRE PUMP PIPING. SEE SHEET FP101 FOR CONTINUATION.
5. ROUTE 3" EXPRESS DRAIN PIPE TO APPROVED DRAIN LOCATION.
6. PROPOSED CROSS MAIN.
7. NEW 2.5" ANGLED HOSE VALVE.
8. ENSURE NO PIPING OR FITTINGS PROTRUDE ON EGRESS PATH; WHERE NECESSARY, REMOVE COLORED CORNERS OF STAIR TO INSTALL RISER, DRAIN PIPE, HOSE VALVES AND SPRINKLER ZONE VALVES.

FIRE PROTECTION CENTRAL CORE
UNIVERSITY OF MISSISSIPPI MEDICAL CENTER


MISSISSIPPI

FOILWYATT
Architects & Planners, PLLC

SUITE 101
4316 OLD CANTON ROAD
JACKSON, MS 39211
TELEPHONE (601) 352-3071
FAX (601) 352-3071
EMAIL: twjackson@foilwyatt.com
WWW: www.foilwyatt.com

FOIL WYATT

SUITE 101
4316 OLD CANTON ROAD
JACKSON, MS 39211
TELEPHONE: (601) 352-3071
FAX: (601) 352-3071
EMAIL: fjackson@oilwatt.com
WEB: www.oilwatt.com

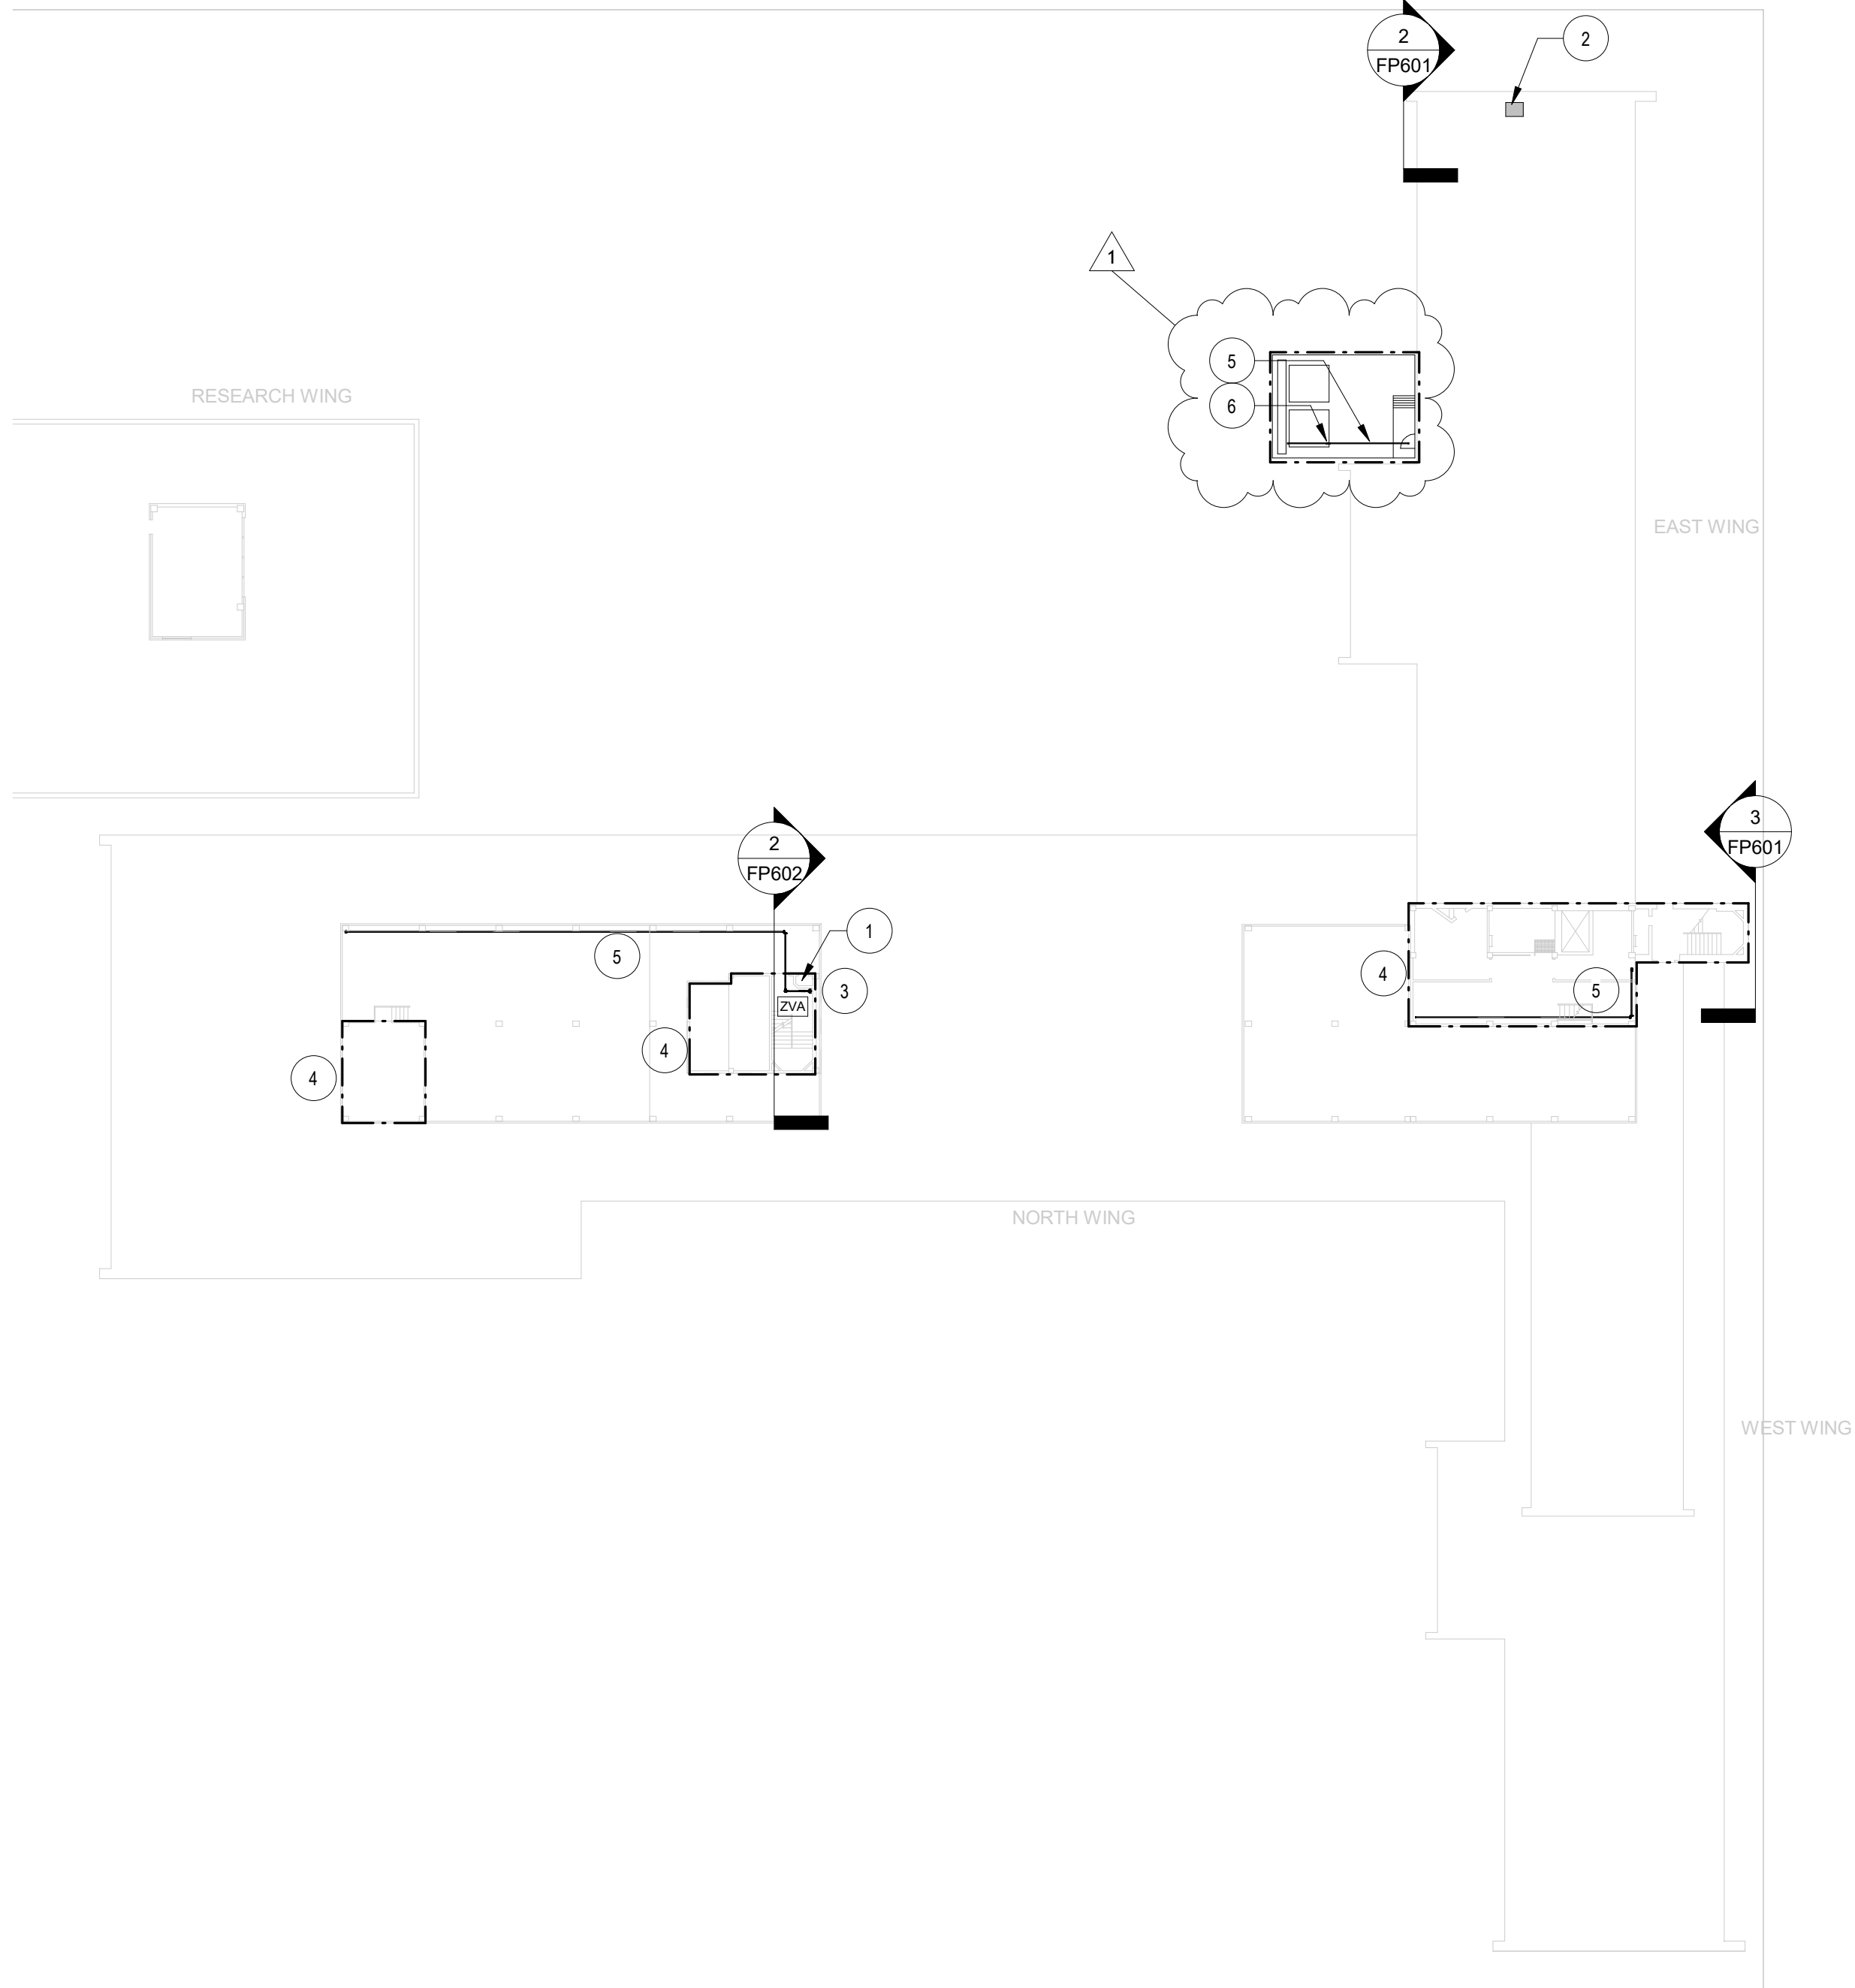

1 NINTH FLOOR OVERALL PLAN - NEW WORK
1" = 30'-0"

- GENERAL NOTES:
- A. REFERENCE COVER SHEET FP100 FOR ADDITIONAL GENERAL NOTES AND REQUIREMENTS.
- B. COORDINATE FIRE WATCH WITH FACILITY SECURITY STAFF WHEN SPRINKLER SYSTEMS ARE IMPAIRED.

- KEYED NOTES
1. NEW 6" STANDPIPE WITH 2.5" ANGLED HOSE VALVE
2. CEILING HATCH WITH LADDER UP TO ROOF FOR FIRE FIGHTER ACCESS (BY OTHERS).
3. NEW SPRINKLER ZONE VALVE.
4. NEW SPRINKLER ZONE BOUNDARY.
5. PROPOSED CROSS MAIN.
6. 2.5" LINE UP TO SERVE PENTHOUSE.

CONSTRUCTION DOCUMENTS

FIRE PROTECTION CENTRAL CORE
UNIVERSITY OF MISSISSIPPI MEDICAL CENTER
JACKSON, MISSISSIPPI
UMMC 409-007


project no.
1686-24
date
12 JUNE 2026
revised
05 AUGUST 2026

drawn by:
-


PENTHOUSE
OVERALL
NEW WORK

sheet no.
FP211


FoilWATT
Architect & Planners, PLLC
SUITE 101
436 OLD CANTON ROAD
JACKSON, MISSISSIPPI 39201
TELEPHONE: (601) 353-3071
FAX: (601) 353-3072
EMAIL: fwjackson@foilwatt.com
WEB: www.foilwatt.com

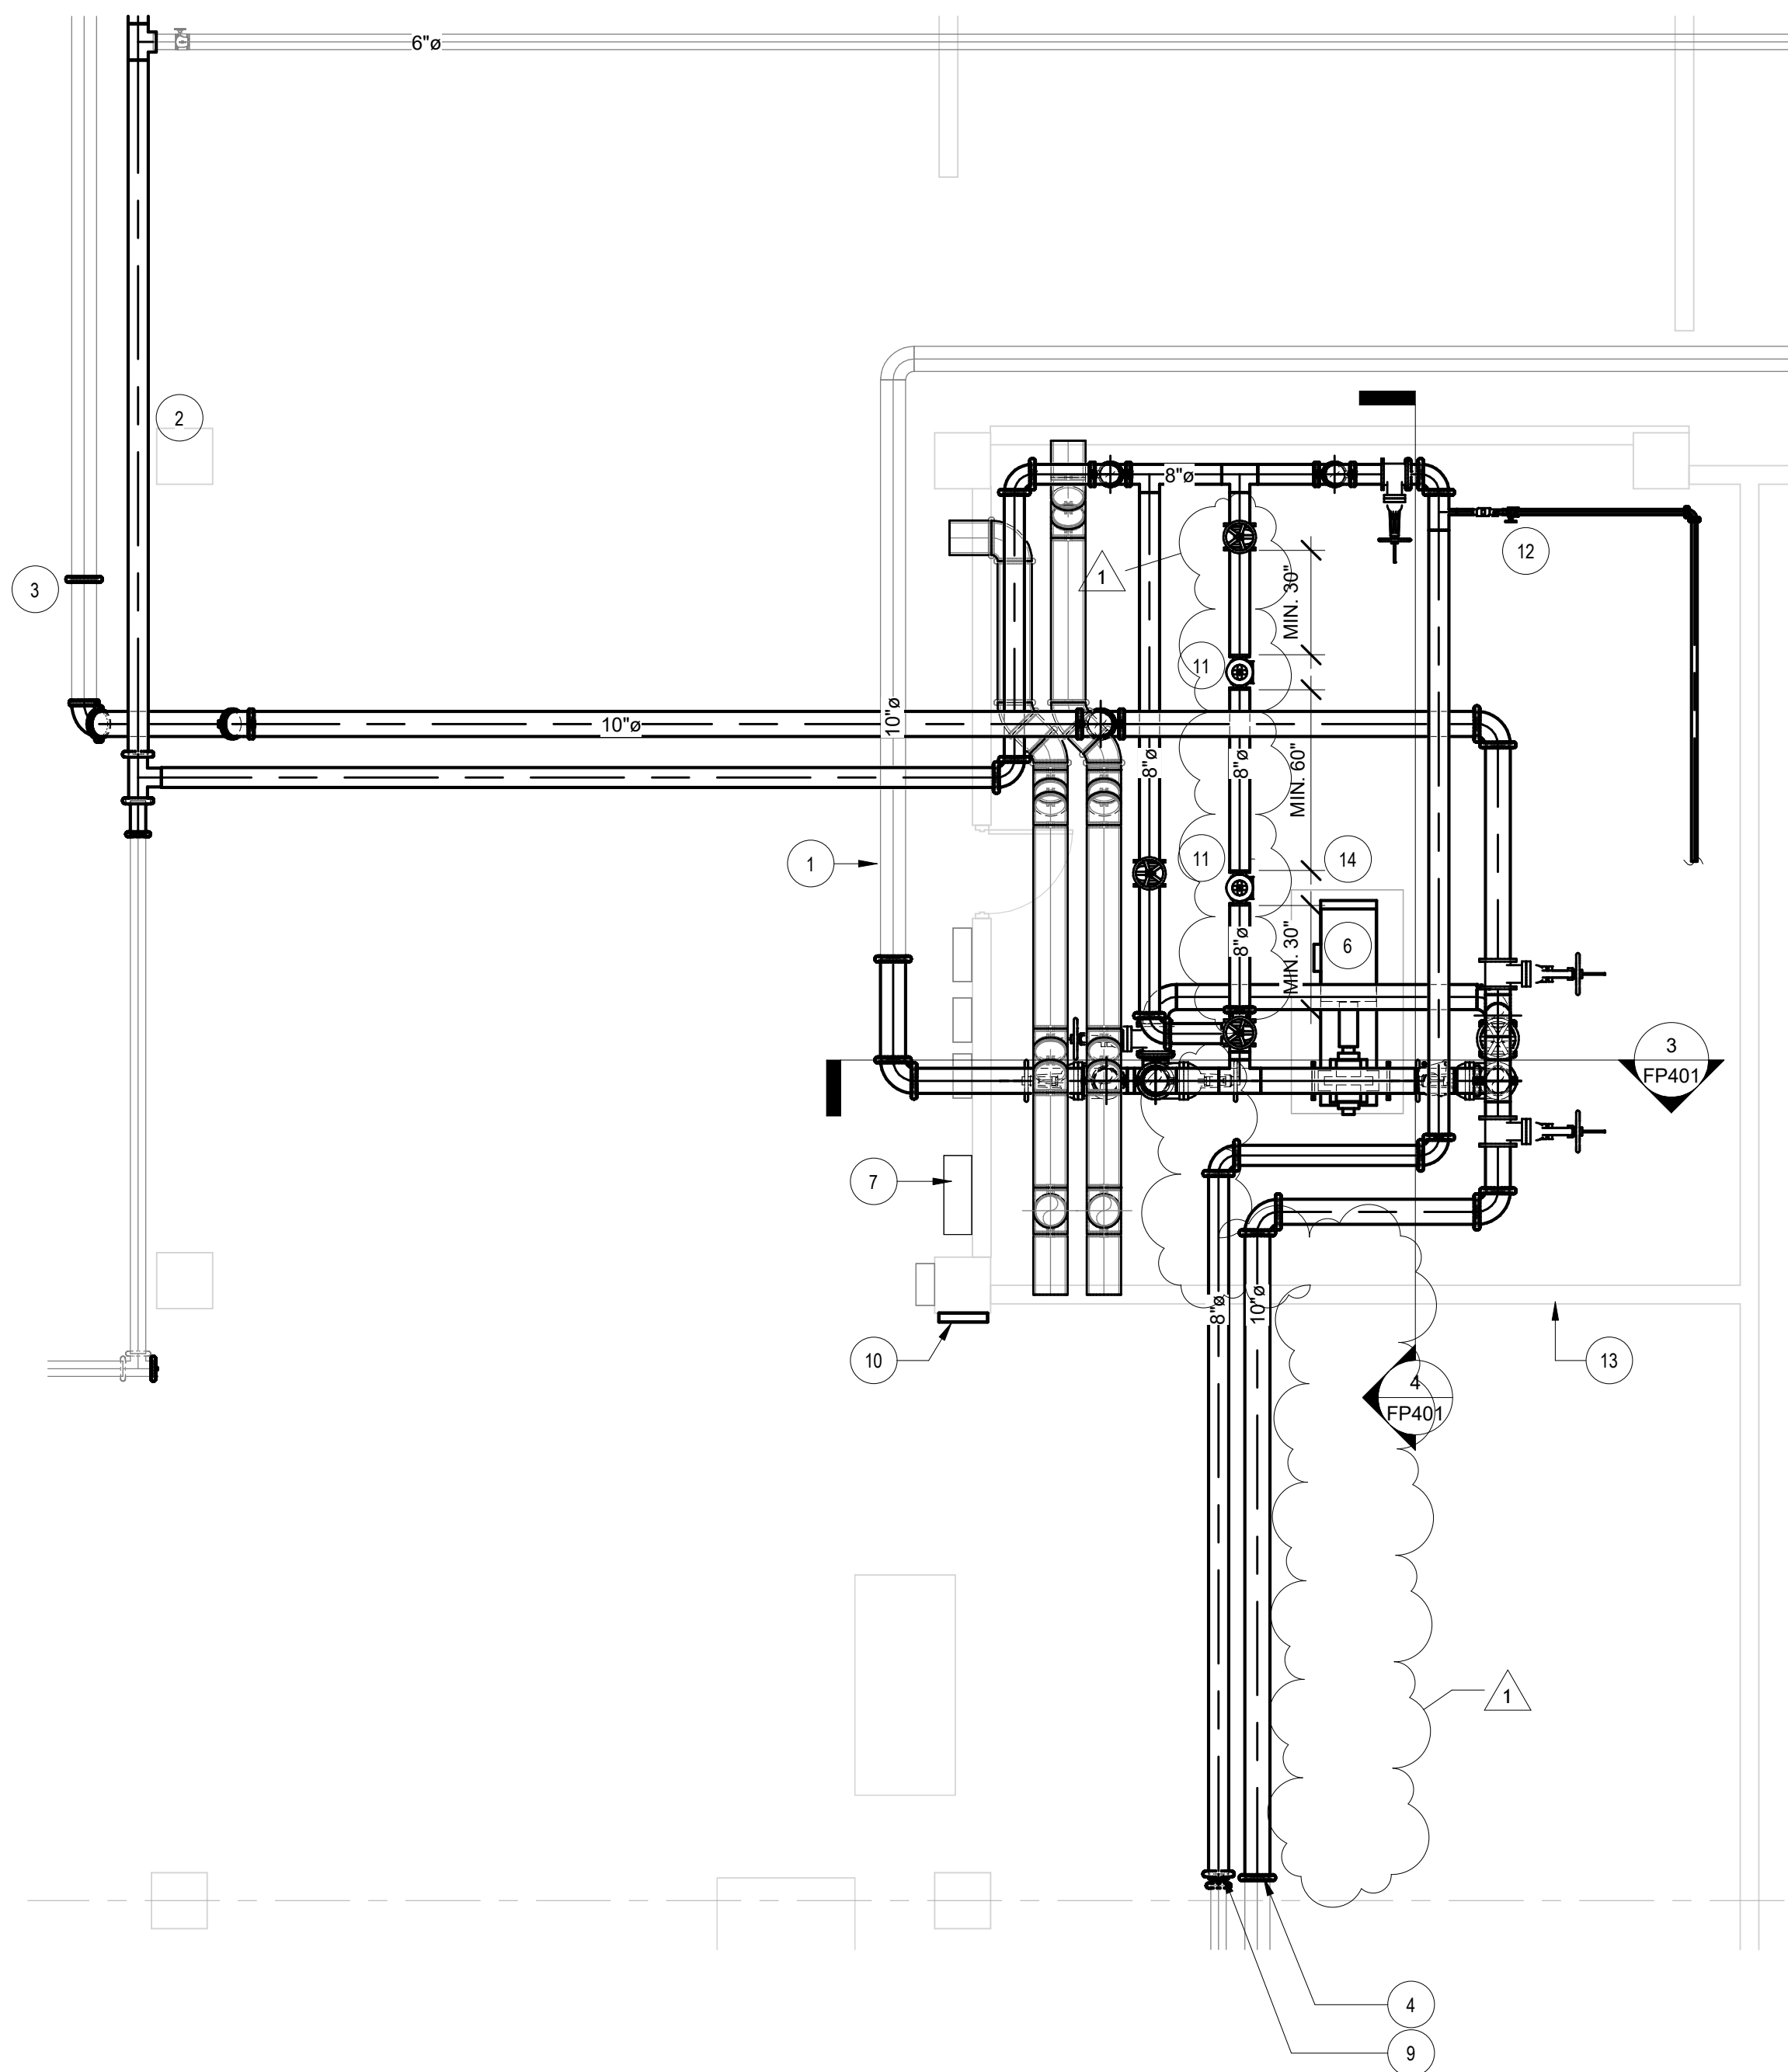


1 SUB-BASEMENT - PUMP ROOM PARTIAL FLOOR PLAN - NEW WORK
3/16" = 1'-0"

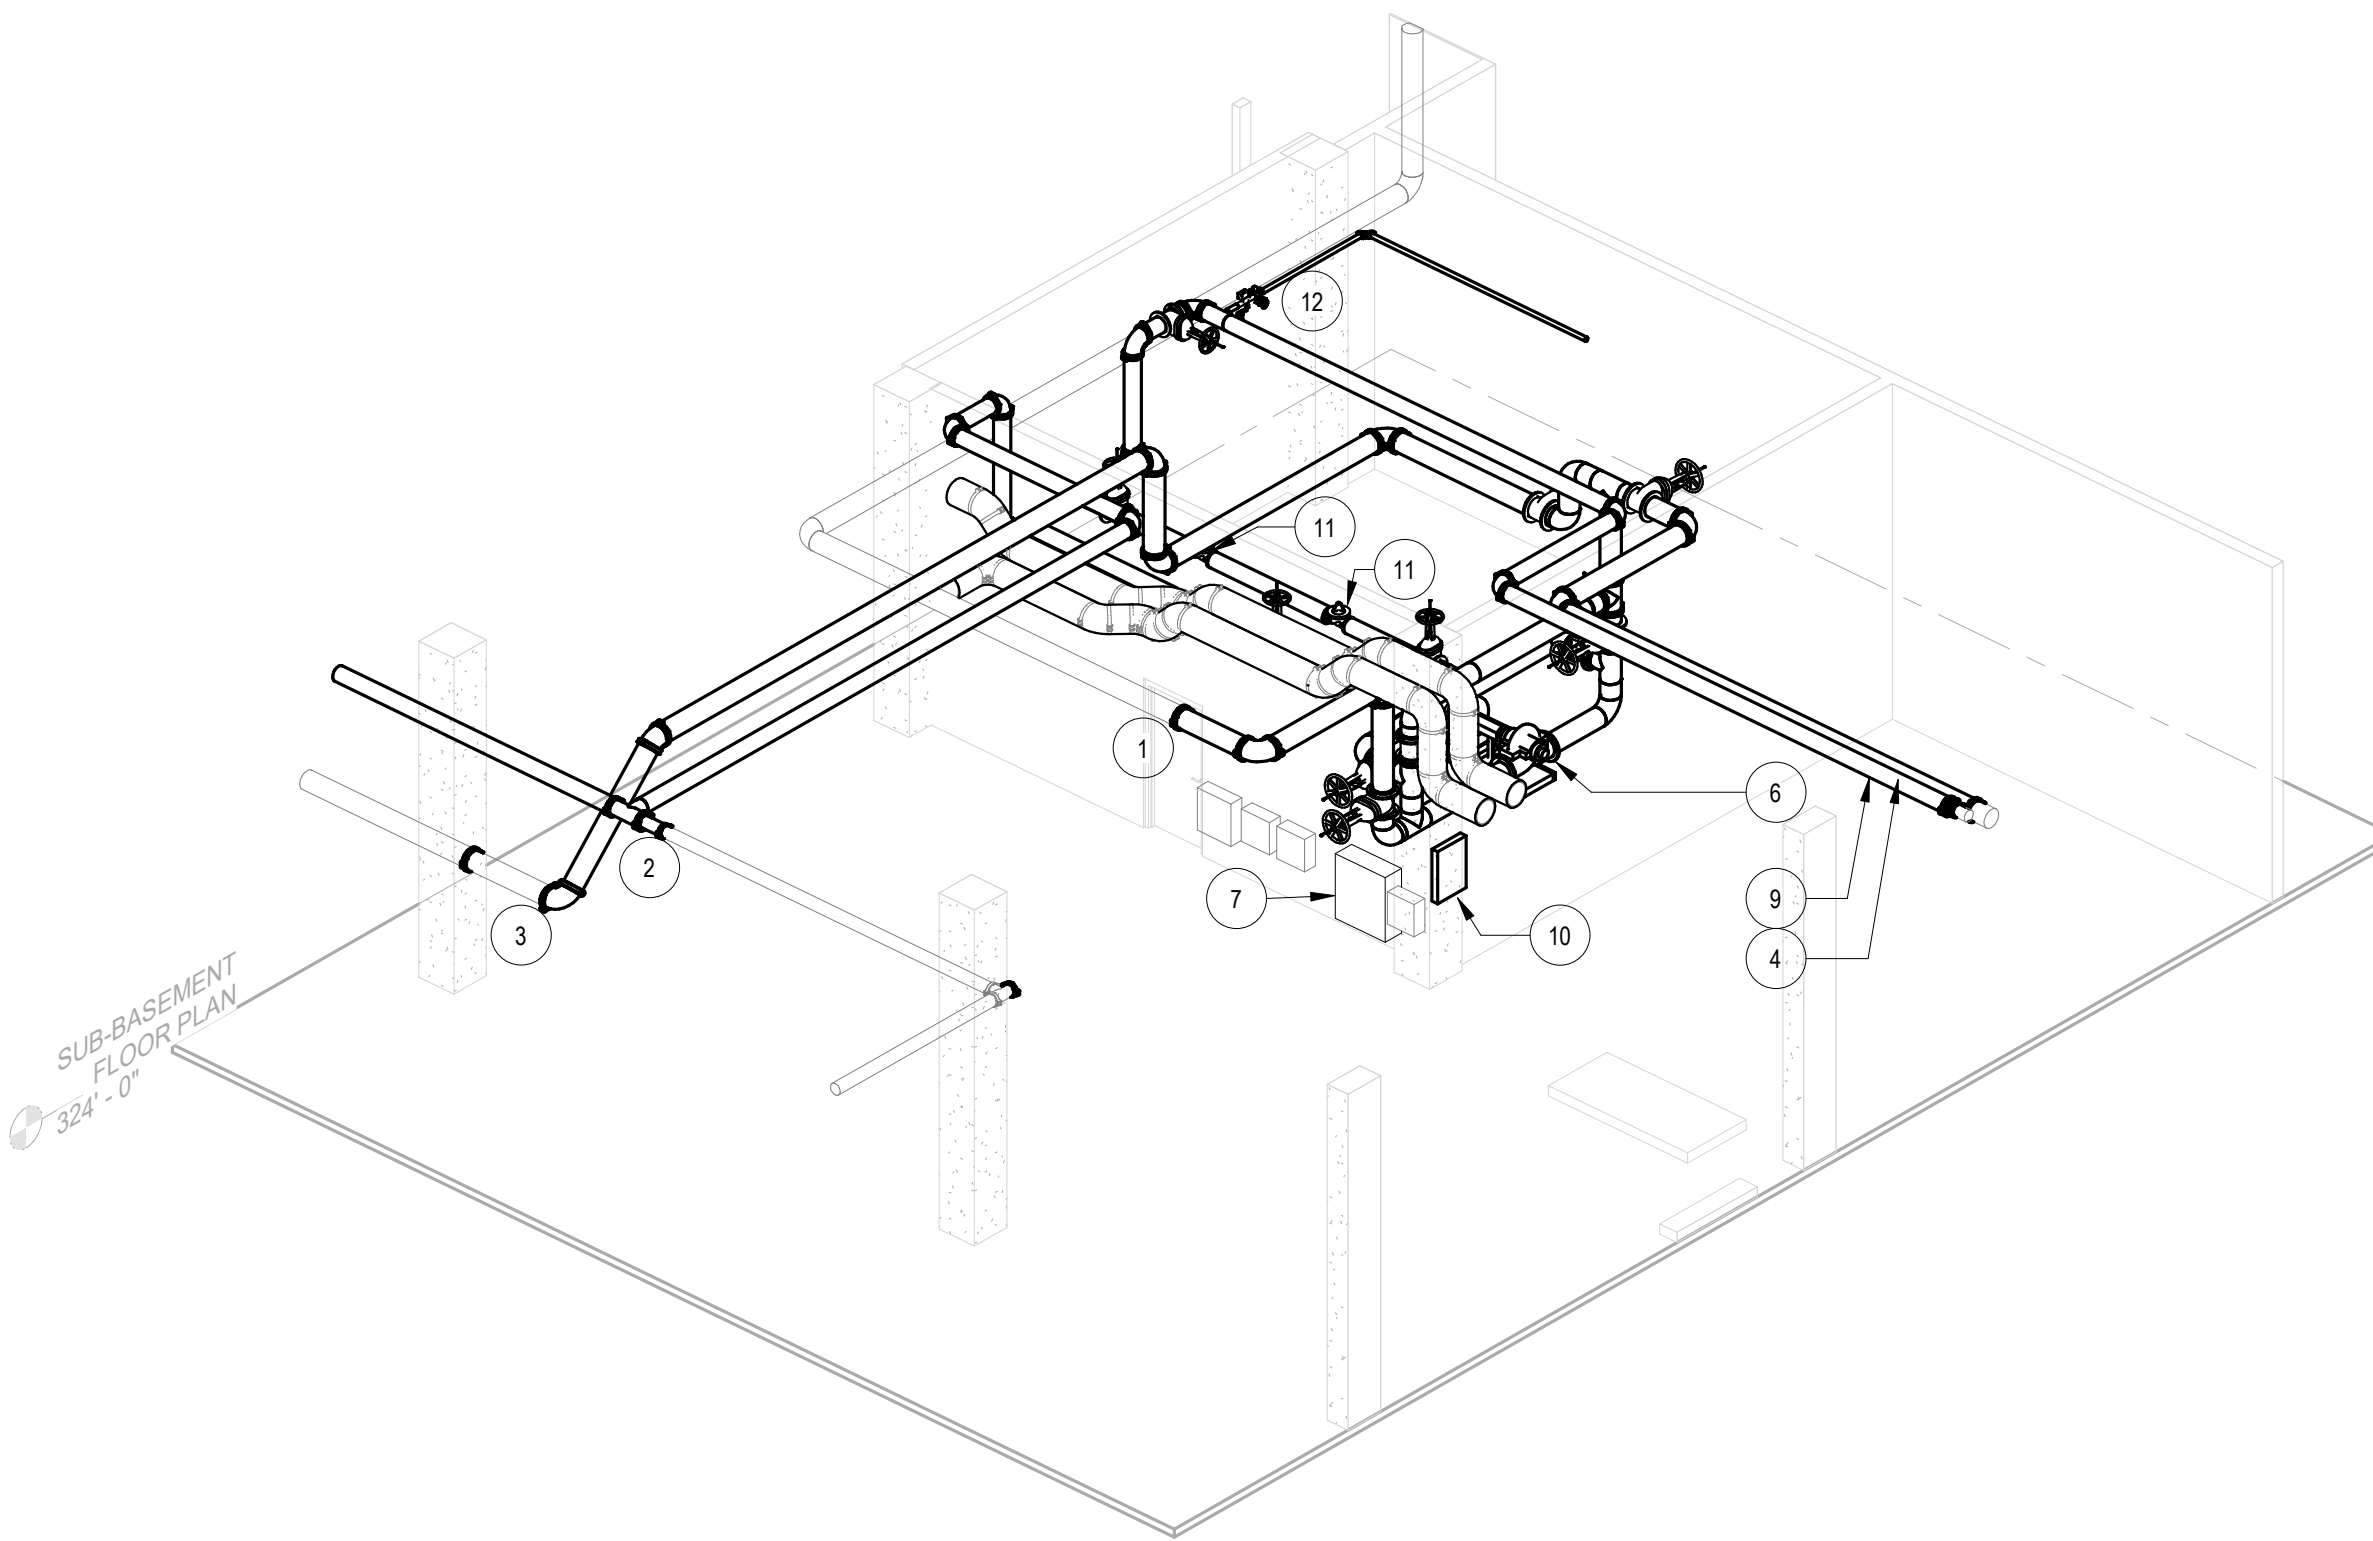

2 FIRE PUMP OVERALL 3D VIEW - NEW WORK

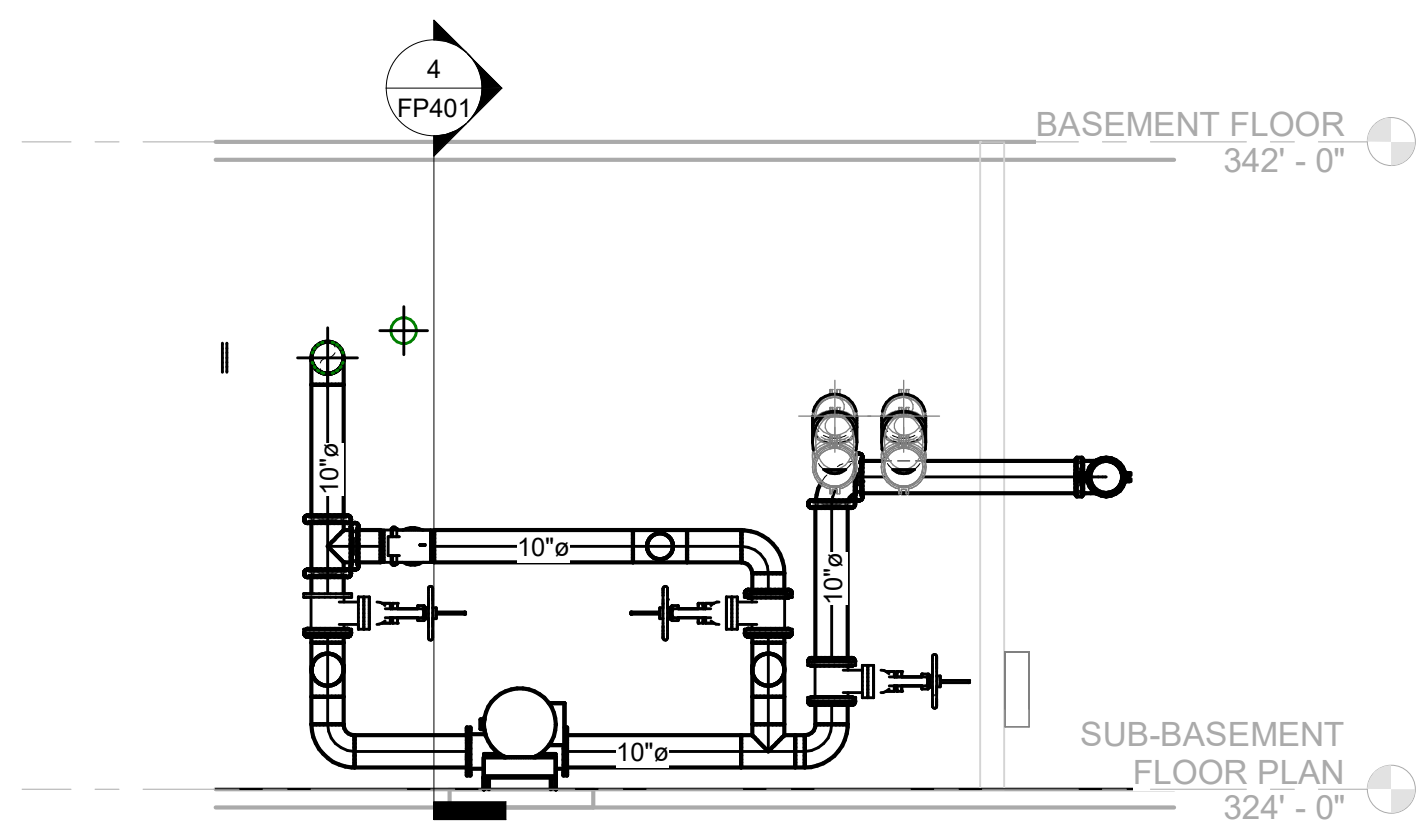

3 FIRE PUMP - SECTION - NEW WORK
3/16" = 1'-0"

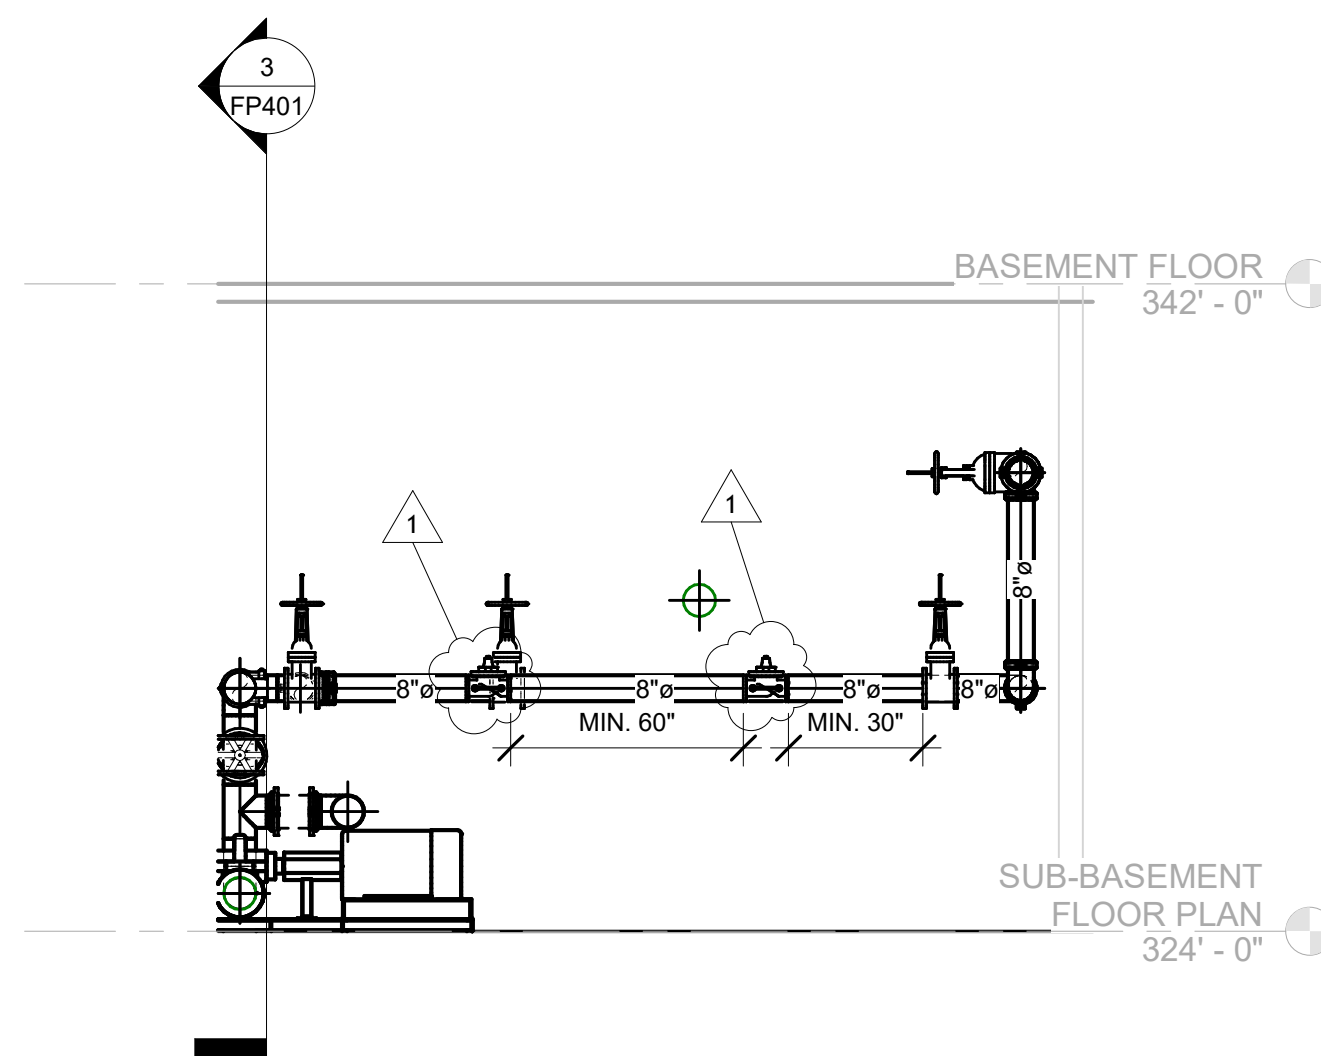

4 FIRE PUMP ROOM - PRV SECTION - NEW WORK
3/16" = 1'-0"

GENERAL NOTES:

- REFERENCE COVER SHEET FP100 FOR ADDITIONAL GENERAL NOTES AND REQUIREMENTS.
- COORDINATE FIRE WATCH WITH FACILITY SECURITY STAFF WHEN SPRINKLER SYSTEMS ARE IMPAIRED.

KEYED NOTES

- CONNECT INTO EXISTING 6" PIPE TO TEST HEADER
- CONNECT INTO EXISTING 6" DISCHARGE PIPE SERVING BASEMENT LOOP
- CONNECT INTO EXISTING 10" SUPPLY PIPE EAST
- CONNECT INTO EXISTING 10" SUPPLY PIPE WEST
- NOT USED
- NEW ELECTRIC 1,500 GPM FIRE PUMP PROVIDING 155 PSI AT 1,500 GPM
- NEW FIRE PUMP CONTROL PANEL
- NEW CONCRETE HOUSEKEEPING PAD (BY OTHERS)
- CONNECT INTO EXISTING 6" PUMP DISCHARGE PIPE SERVING ACUTE CARE AND ADULT TOWER STAIRS
- NEW JOCKEY PUMP CONTROL PANEL
- 8" CLA-VAL 90-21 PRESSURE REDUCING VALVES. MINIMUM 60" BETWEEN VALVES FLANGE-TO-FLANGE. MINIMUM 30" BEFORE PRV-1 AND MINIMUM 30" AFTER PRV-2. MOUNT PRVs NO HIGHER THAN 7'6" AFF.
- NEW ZONE VALVE FOR PUMP ROOM SPRINKLERS.
- ARCHITECT TO ENSURE PUMP ROOM HAS A MINIMUM 1-HOUR FIRE RATING.
- ELECTRICAL TO PROVIDE POWER TO FIRE PUMP. ENSURE CABLING IS PROVIDED WITH APPROPRIATE FIRE RATING PER NFPA 70.

CONSTRUCTION DOCUMENTS

FIRE PROTECTION CENTRAL CORE
UNIVERSITY OF MISSISSIPPI MEDICAL CENTER
JACKSON

UMMC 409-007

MISSISSIPPI

FoilWYATT
Architects & Planners, PLLC
SUITE 101
4316 OLD CANTON ROAD
JACKSON, MS 39201
TELEPHONE: (601) 352-3071
EMAIL: foilw@foilwatt.com
WEB: www.foilwatt.com


project no.
1686-24
date
12 JUNE 2026
revised
05 AUGUST 2026

drawn by:


**FIRE PUMP
ENLARGED
PLANS - NEW
WORK**

sheet no.

FP401

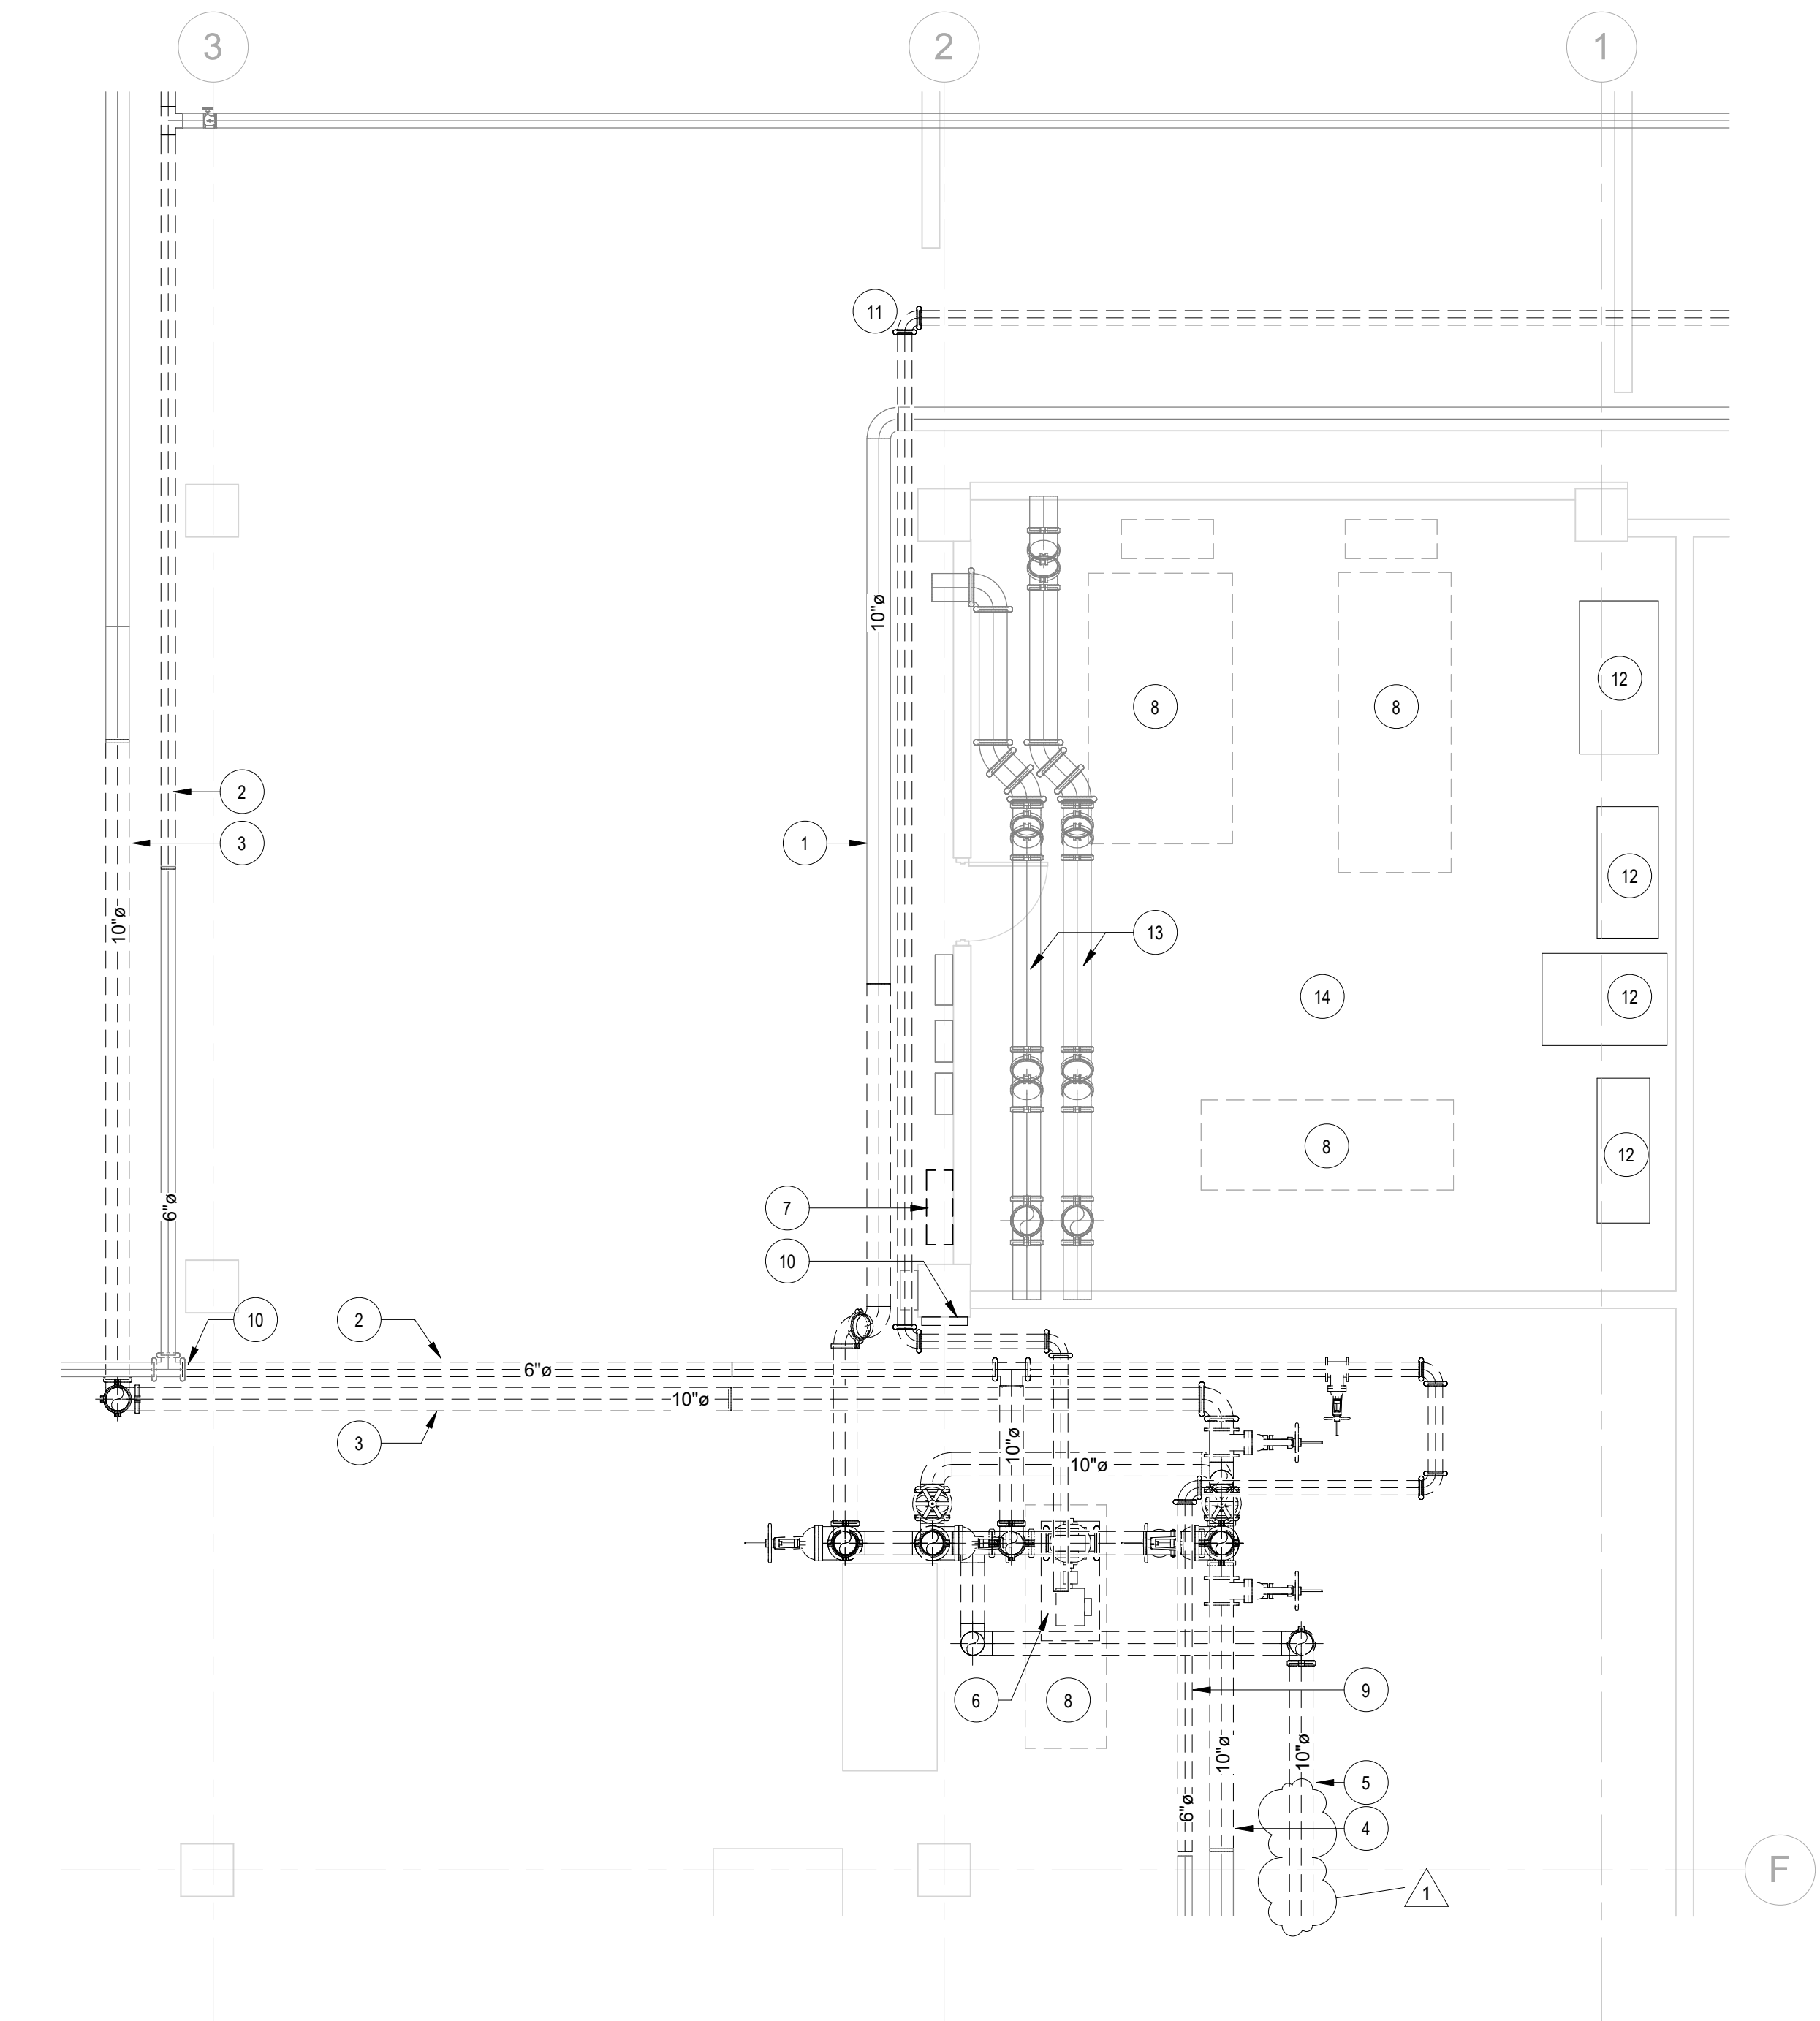

1 SUB-BASEMENT - EXISTING PUMP ROOM PARTIAL FLOOR PLAN - DEMOLITION
3/16" = 1'-0"

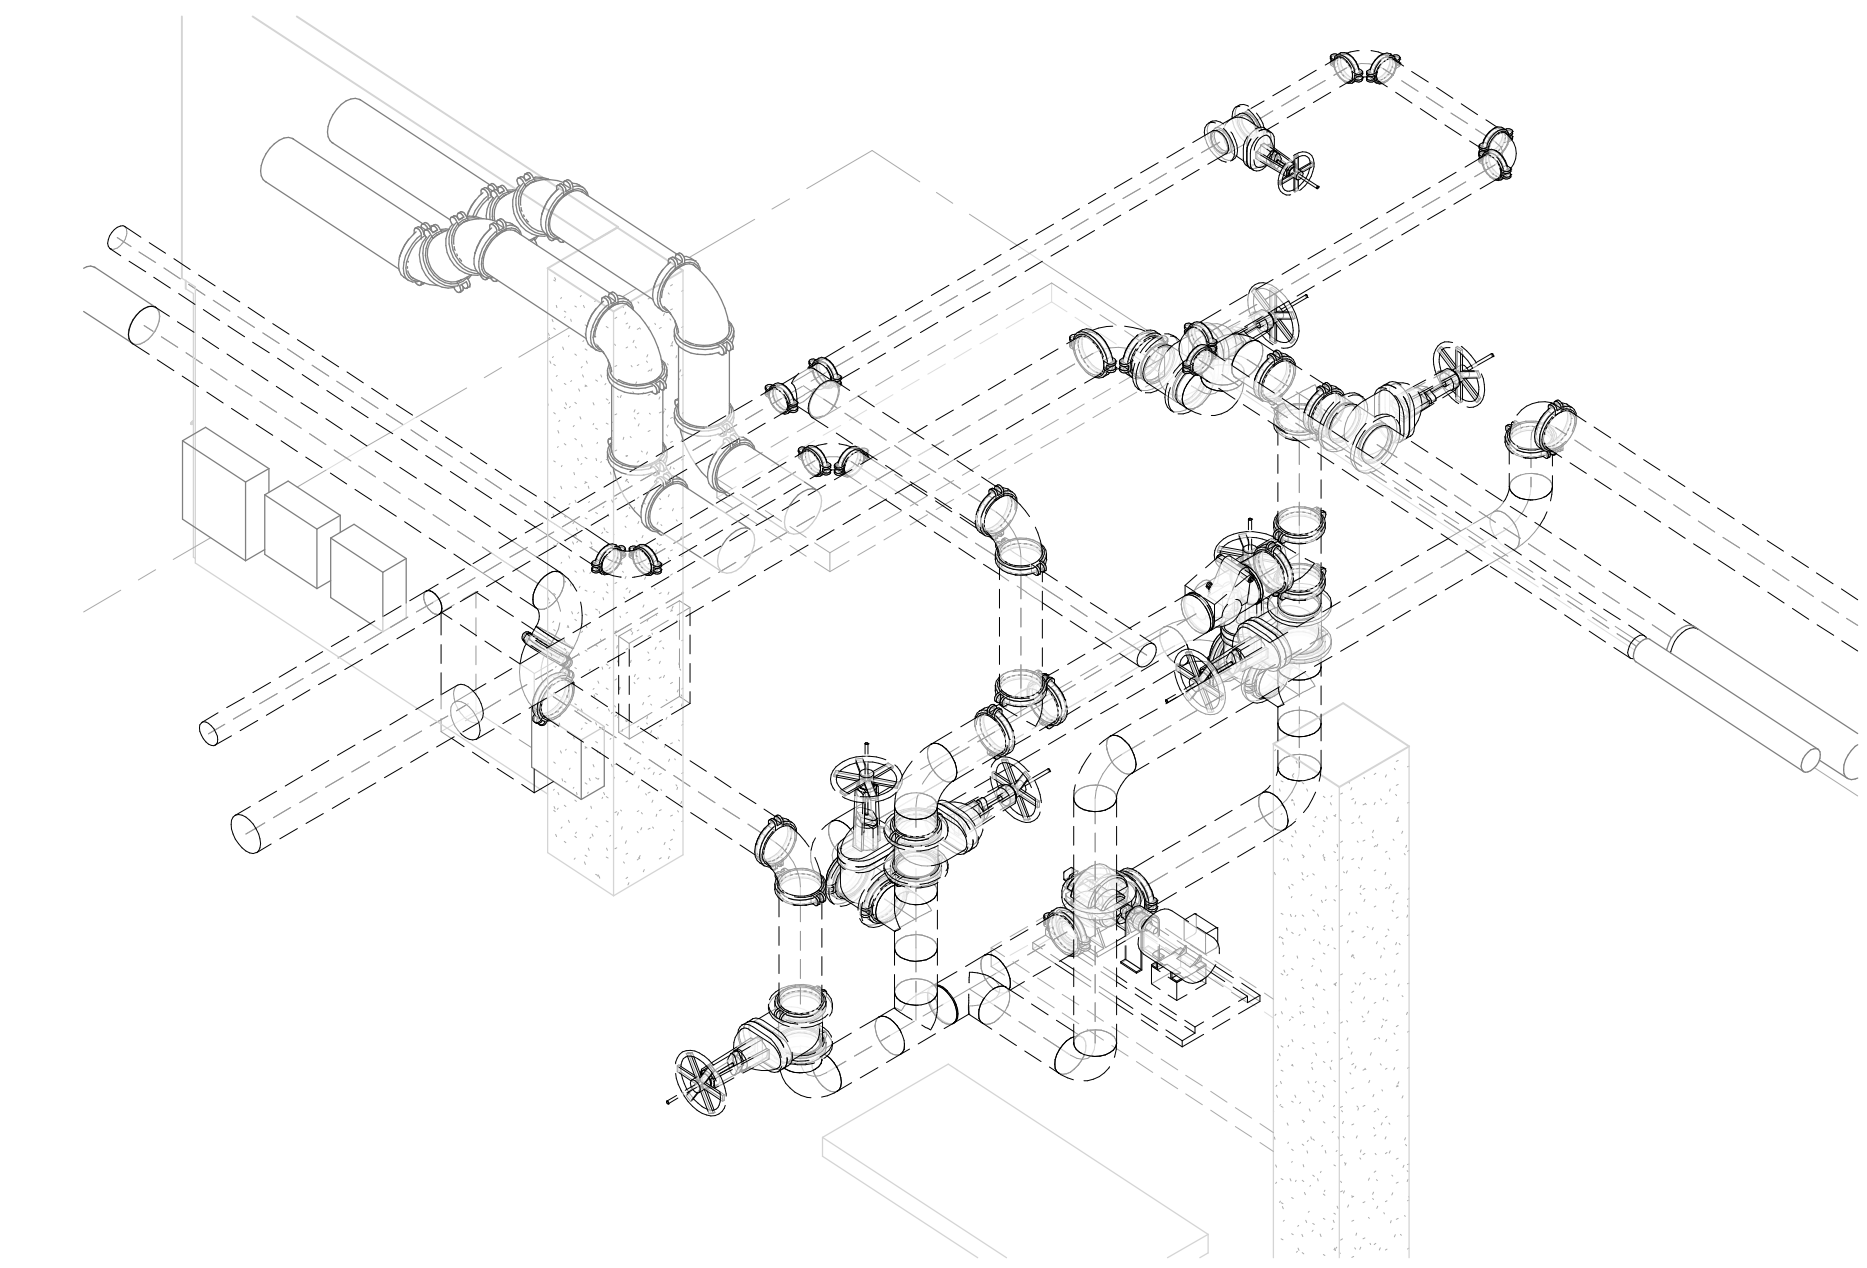

2 FIRE PUMP AREA 3D VIEW - DEMOLITION

GENERAL NOTES:

- REFERENCE COVER SHEET FP100 FOR ADDITIONAL GENERAL NOTES AND REQUIREMENTS.
- COORDINATE FIRE WATCH WITH FACILITY SECURITY STAFF WHEN SPRINKLER SYSTEMS ARE IMPAIRED.

KEYED NOTES

- REMOVE INDICATED PORTION OF EXISTING 6" PIPE TO TEST HEADER
- REMOVE INDICATED PORTION OF EXISTING 6" DISCHARGE PIPE SERVING BASEMENT LOOP
- REMOVE INDICATED PORTION OF EXISTING 10" SUPPLY PIPE EAST
- REMOVE INDICATED PORTION OF EXISTING 10" SUPPLY PIPE WEST
- REMOVE EXISTING 10" PRESSURE RELIEF PIPE BACK TO EXTERIOR WALL AND CAP
- EXISTING FIRE PUMP TO BE REMOVED ALONG WITH INDICATED PIPING
- REMOVE & REPLACE EXISTING FIRE PUMP CONTROL PANEL
- EXISTING CONCRETE PAD TO BE DEMOLISHED (BY OTHERS)
- REMOVE INDICATED PORTION OF EXISTING 6" PUMP DISCHARGE PIPE SERVING ACUTE CARE AND ADULT TOWER STAIRS
- REMOVE & REPLACE EXISTING JOCKEY PUMP & CONTROLLER
- REMOVE 6" EXHAUST PIPE AS INDICATED
- DIESEL TANKS, PIPING AND RELATED COMPONENTS TO REMAIN
- INSULATED PROCESS PIPING TO REMAIN
- MECHANICAL TO IDENTIFY AND DEMOLISH APPLICABLE PIPING IN NEW FIRE PUMP ROOM ON MECHANICAL PLANS.

CONSTRUCTION DOCUMENTS

FIRE PROTECTION CENTRAL CORE
UNIVERSITY OF MISSISSIPPI MEDICAL CENTER


JACKSON MISSISSIPPI UMMC 409-007

FoilWatt
Architects & Planners, PLLC
SUITE 101
4316 OLD CANTON ROAD
JACKSON, MS 39207
TELEPHONE: (601) 352-3071
EMAIL: foilwatt@foilwatt.com
WEB: www.foilwatt.com

project no.
1686-24
date
12 JUNE 2026
revised
05 AUGUST 2026

drawn by:
-


FIRE PUMP
ENLARGED
PLANS -
DEMOLITION
sheet no.
FP401-D

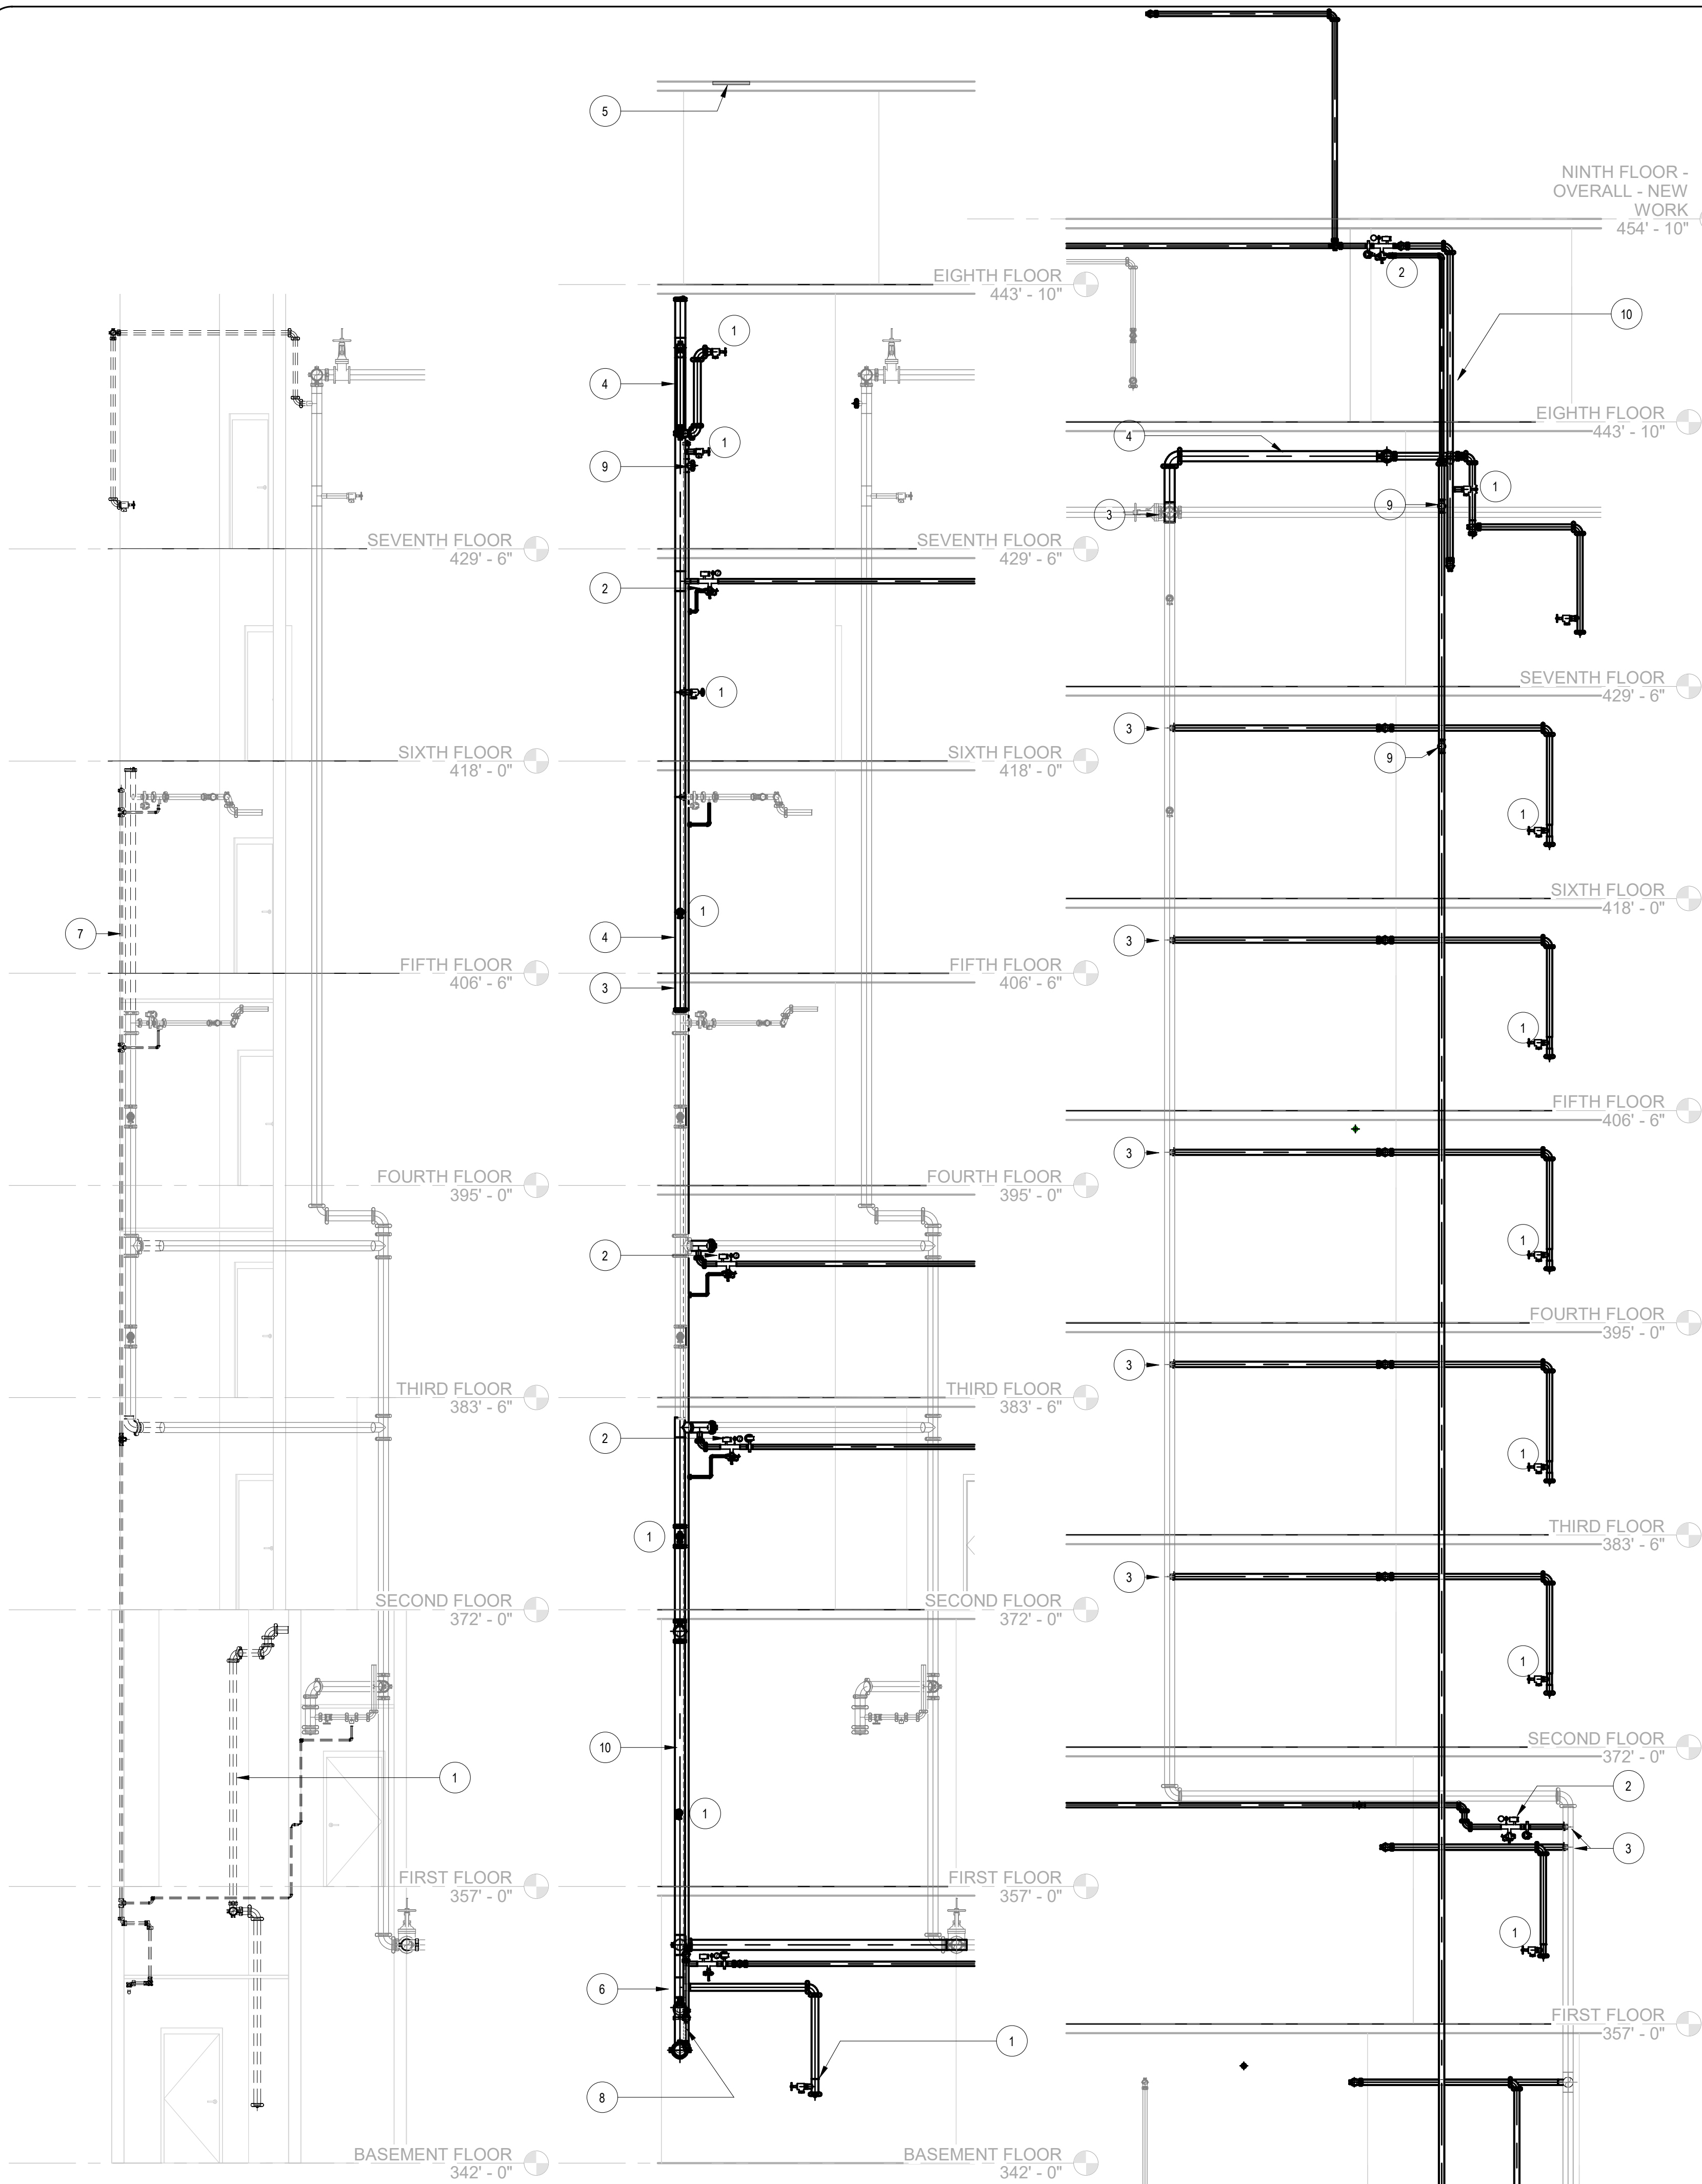

1 STAIR H-01 - SECTION - DEMOLITION
3/16" = 1'-0"

2 STAIR H-01 - SECTION - NEW WORK
3/16" = 1'-0"

3 STAIR H-02 - SECTION - NEW WORK
3/16" = 1'-0"

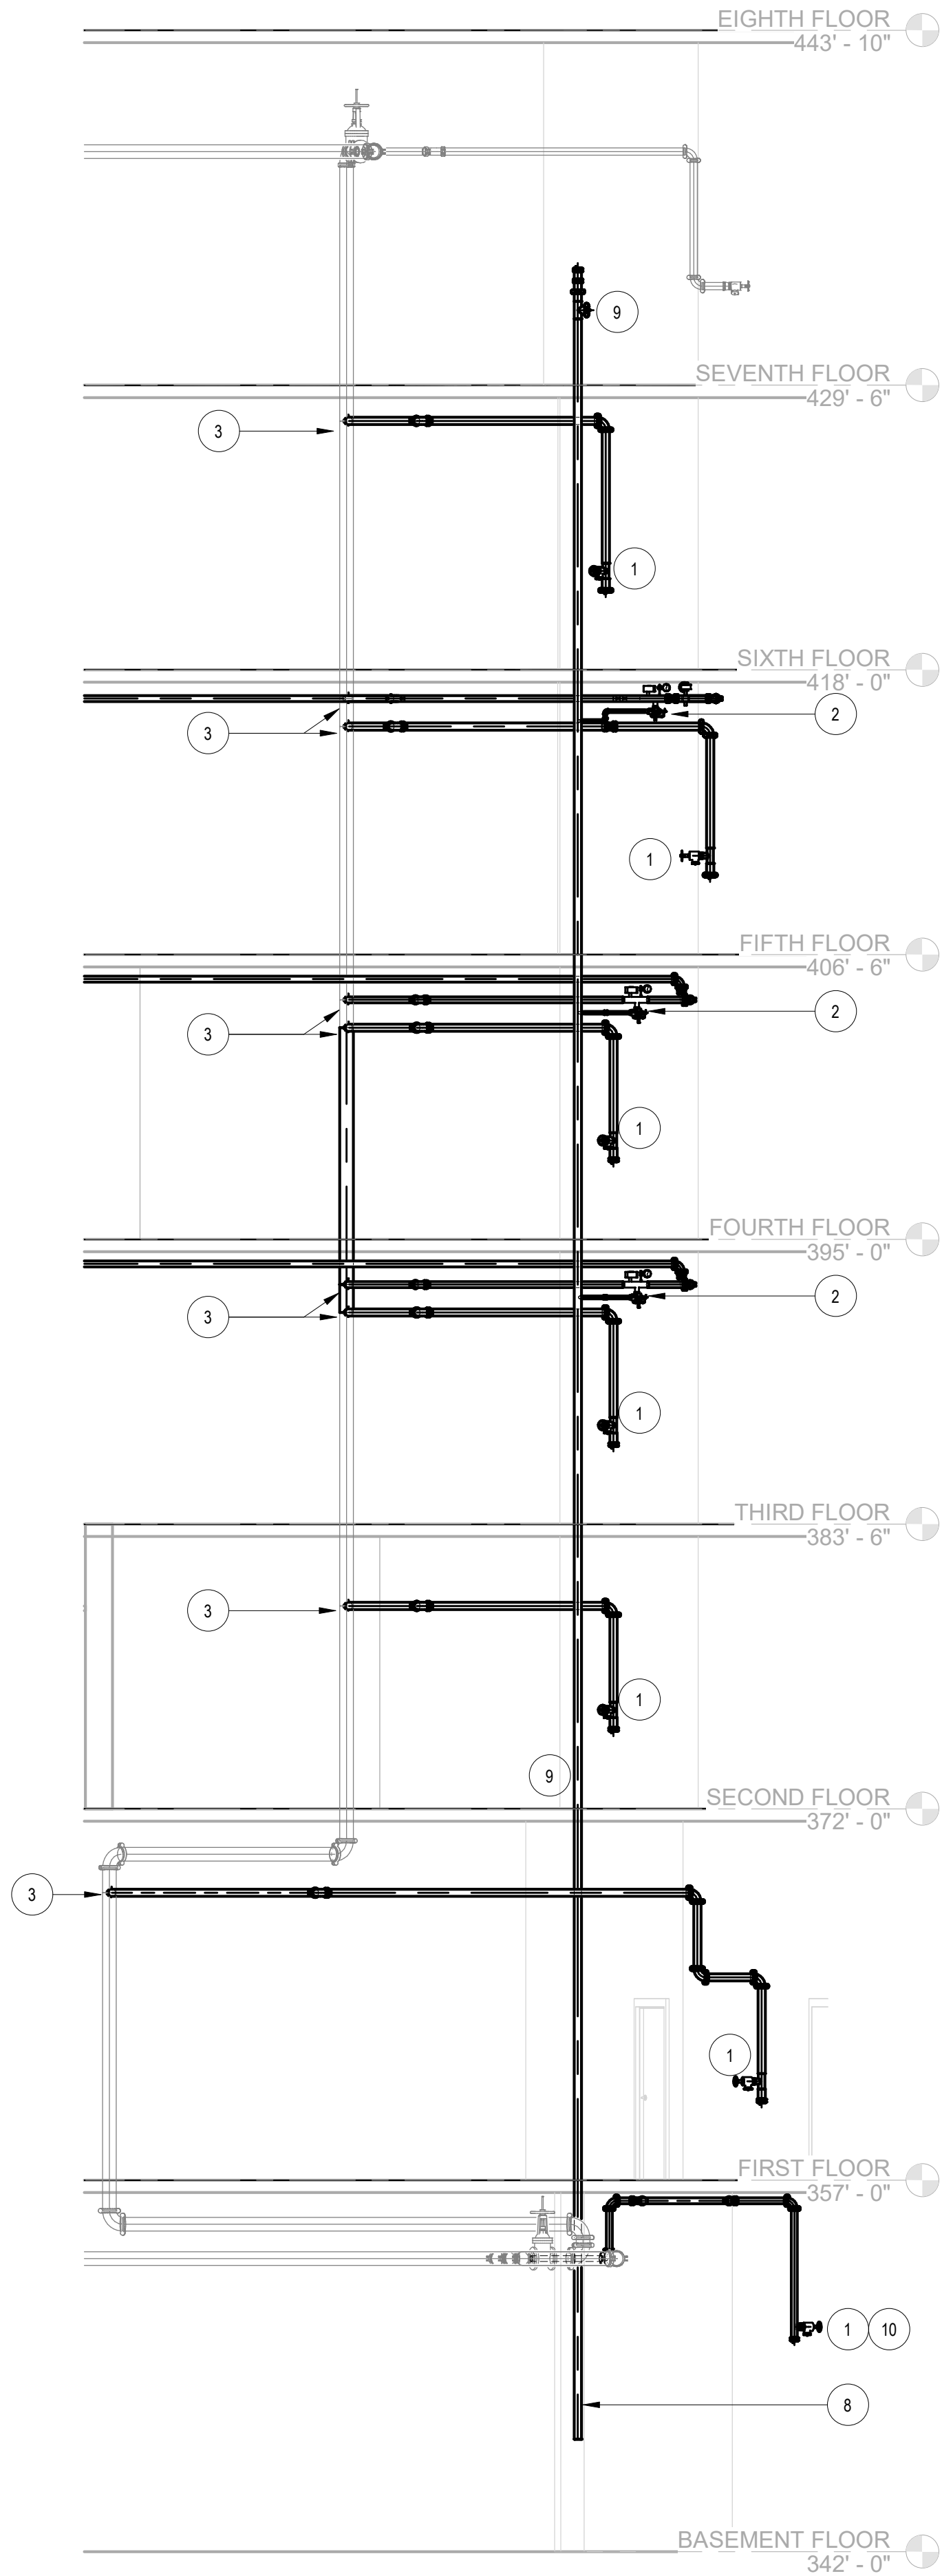

4 STAIR H-03 - SECTION - NEW WORK
3/16" = 1'-0"

GENERAL NOTES:

- A. REFERENCE COVER SHEET FP100 FOR ADDITIONAL GENERAL NOTES AND REQUIREMENTS.
- B. COORDINATE FIRE WATCH WITH FACILITY SECURITY STAFF WHEN SPRINKLER SYSTEMS ARE IMPAIRED.

KEYED NOTES

- 1. NEW 2.5" ANGLED HOSE VALVE.
- 2. NEW ZONE VALVE.
- 3. TIE-IN TO EXISTING 6" RISER. WHERE TIE-IN PIPE IS 4" OR SMALLER, USE MECHANICAL TEES TO REDUCE REQUIRED WORK SPACE.
- 4. NEW 6" RISER.
- 5. NEW FIRE FIGHTER ACCESS HATCH WITH LADDER, UP TO ROOF (BY OTHERS).
- 6. CONNECT NEW 6" TEMPORARY FIRE PUMP LINE INTO NEW 6" STANDPIPE HERE. ENSURE PIPING DOES NOT IMPEDE EGRESS ROUTE IN STAIR.
- 7. REMOVE EXISTING DRAIN PIPING.
- 8. NEW 3" EXPRESS DRAIN. CONNECT IN NEW AND EXISTING ZONE VALVES DRAINS. ROUTE 3" EXPRESS DRAIN PIPE TO APPROVED DRAIN LOCATION USING EXISTING PATH OF DEMOLISHED 1" DRAIN LINE. WIDEN CORED SLAB HOLES AND WALL PENETRATIONS WHERE NECESSARY.
- 9. 2.5" THREADED CONNECTION IN 3" EXPRESS DRAIN FOR STANDPIPE TESTING.
- 10. ENSURE NO PIPING OR FITTINGS PROTRUDE ON EGRESS PATH. WHERE NECESSARY, REMOVE CHAMFERED CORNERS OF STAIR TO INSTALL RISER, DRAIN PIPE, HOSE VALVES AND SPRINKLER ZONE VALVES.

CONSTRUCTION DOCUMENTS

FIRE PROTECTION CENTRAL CORE
UNIVERSITY OF MISSISSIPPI MEDICAL CENTER
UMMC 409-007


FoilWYATT
Architects & Planners, PLLC
SUITE 101
4316 OLD CANTON ROAD
JACKSON, MS 39211
TELEPHONE: (601) 352-3071
FAX: (601) 352-3072
EMAIL: foilw@foilwyatt.com
WEB: www.foilwyatt.com

project no.
1686-24
date
12 JUNE 2026
revised
05 AUGUST 2026


drawn by:
-

SECTIONS


sheet no.
FP601

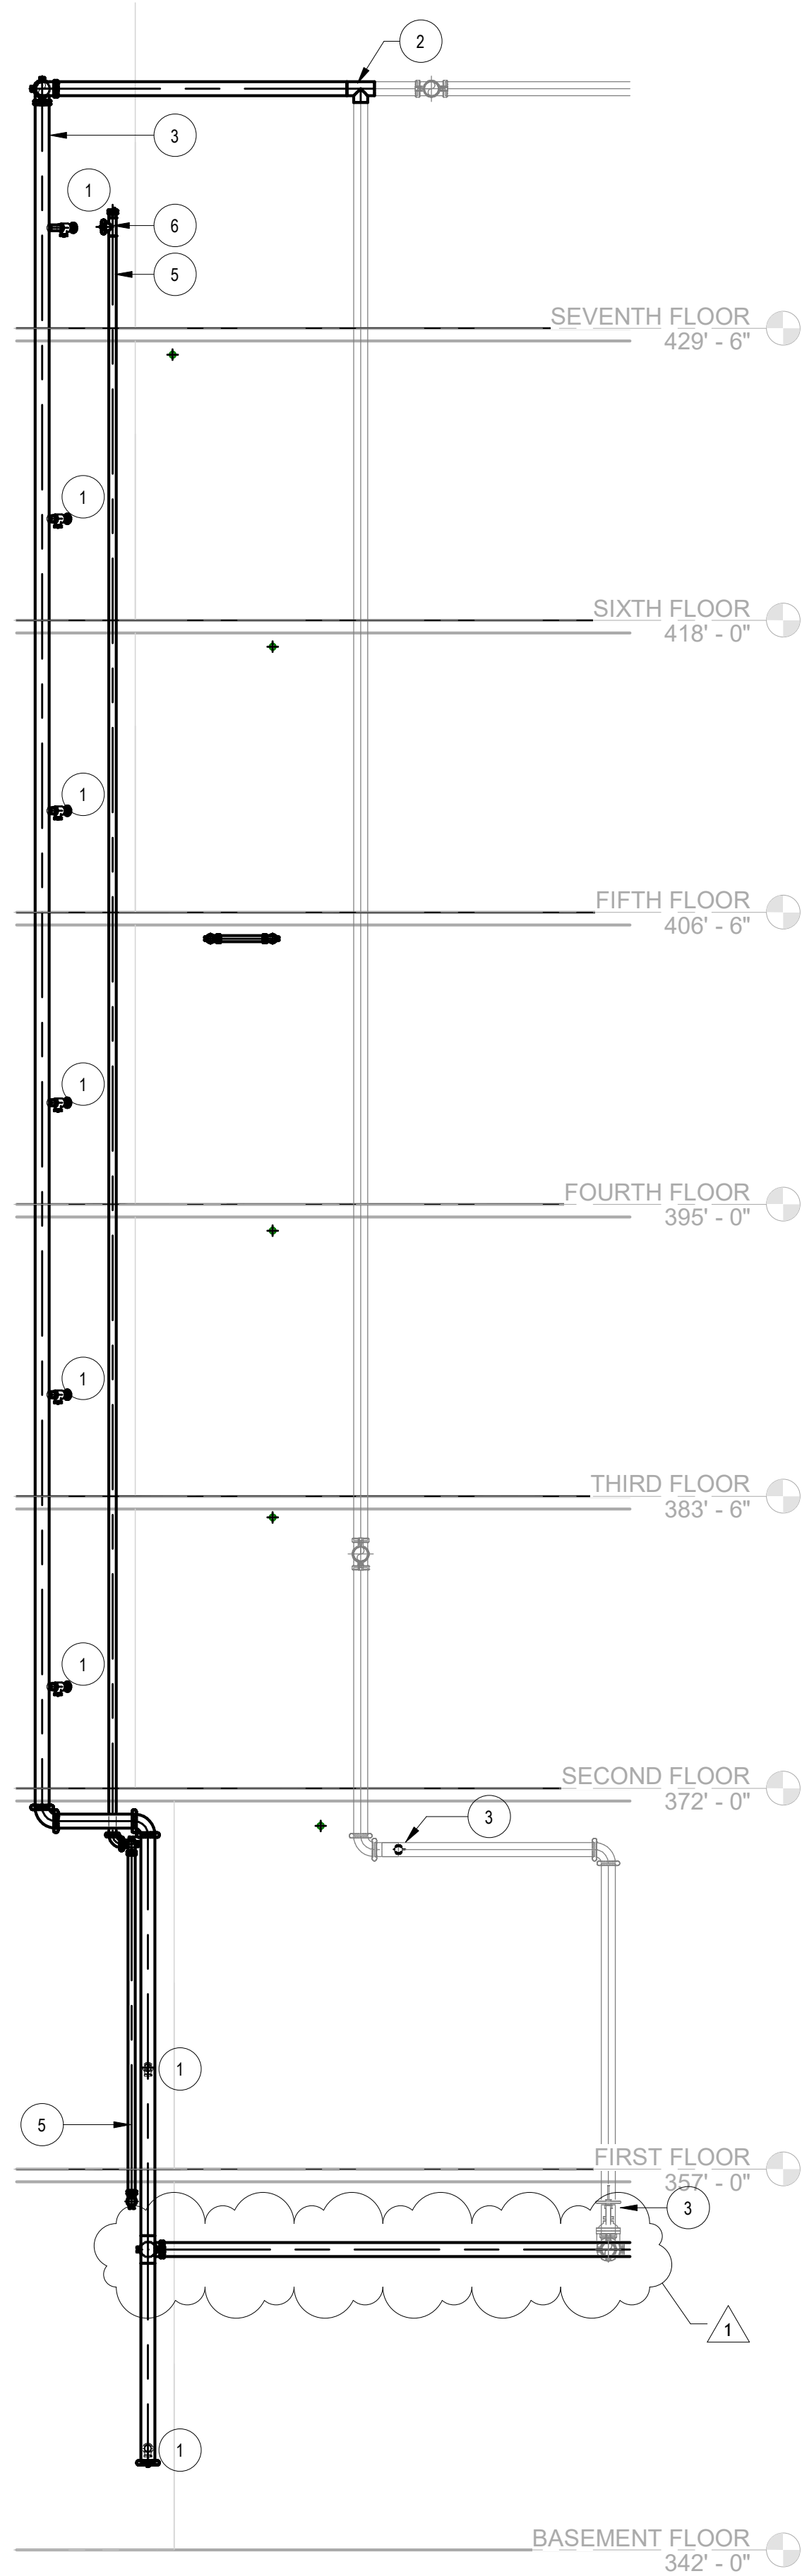

1 STAIR N-01 - SECTION - NEW WORK
3/16" = 1'-0"

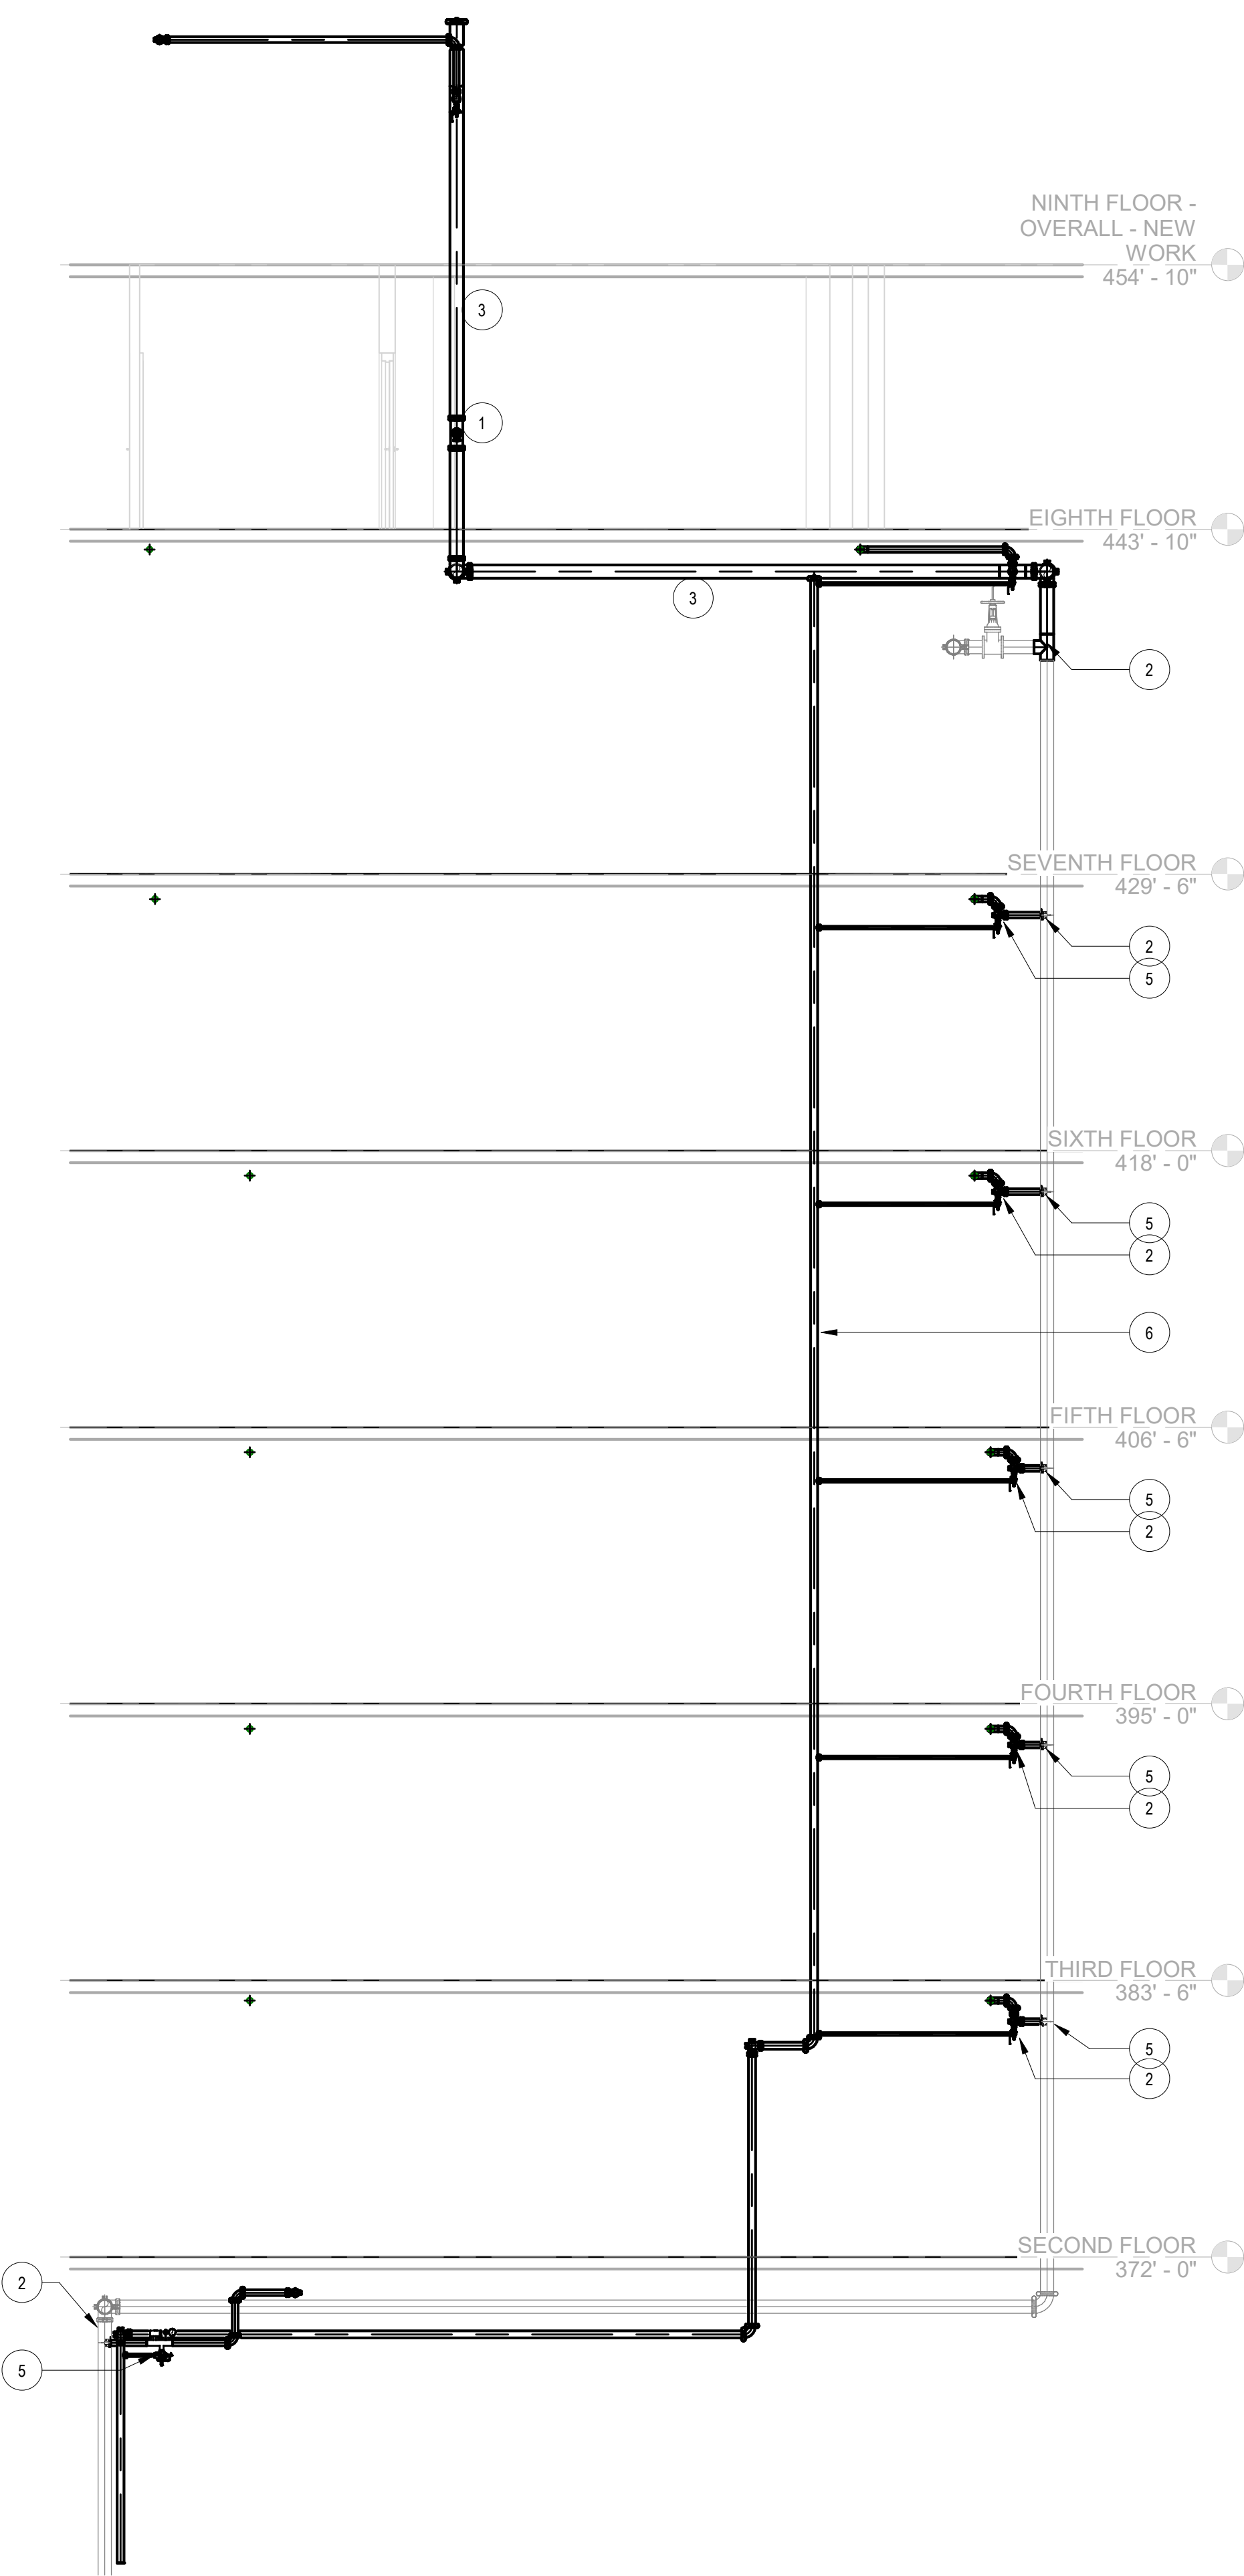

2 STAIR N-02 - SECTION - NEW WORK
3/16" = 1'-0"

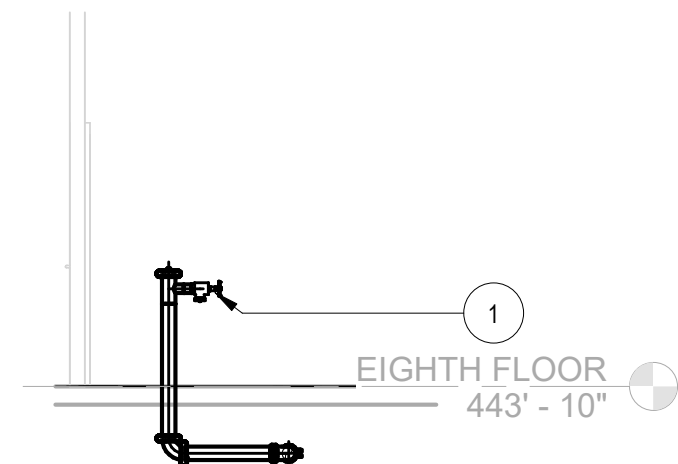

3 CENTRAL CORE PENTHOUSE - SECTION - NEW WORK
3/16" = 1'-0"

GENERAL NOTES:

- A. REFERENCE COVER SHEET FP100 FOR ADDITIONAL GENERAL NOTES AND REQUIREMENTS.
- B. COORDINATE FIRE WATCH WITH FACILITY SECURITY STAFF WHEN SPRINKLER SYSTEMS ARE IMPAIRED.

KEYED NOTES

- 1. NEW 2.5" ANGLED HOSE VALVE.
- 2. TIE-IN TO EXISTING 6" RISER, WHERE TIE-IN PIPE IS 4" OR SMALLER, USE MECHANICAL TEES TO REDUCE REQUIRED WORK SPACE.
- 3. NEW 6" RISER.
- 4. NEW FIRE FIGHTER ACCESS HATCH WITH LADDER, UP TO ROOF (BY OTHERS).
- 5. NEW 3" EXPRESS DRAIN. CONNECT IN NEW AND EXISTING ZONE VALVES DRAINS. ROUTE 3" EXPRESS DRAIN PIPE TO APPROVED DRAIN LOCATION
- 6. 2.5" THREADED OUTLET FOR HOSE VALVE TESTING.

CONSTRUCTION DOCUMENTS

FIRE PROTECTION CENTRAL CORE
UNIVERSITY OF MISSISSIPPI MEDICAL CENTER
JACKSON
UMMC 409-007
MISSISSIPPI

project no.
1686-24
date
12 JUNE 2026
revised
05 AUGUST 2026
drawn by:
-

SECTIONS
sheet no.
FP602

FoilWATT
Architects & Planners, PLLC
SUITE 101
4316 OLD CANTON ROAD
JACKSON, MS 39211
TELEPHONE: (601) 352-3071
FAX: (601) 352-3071
EMAIL: jw@foilwatt.com
WEB: www.foilwatt.com

To the Drawings:

A). Sheet ADE001, Partial Site Plan:

1. See new added sheet ADE001, Partial Site Plan, for connection to temporary fire pump.

B). Sheet E200, Schematic One-Line Diagram (M.V. and L.V. Electrical Service and Distribution System):

1. Replace sheet "E200" with attached sheet "ADE200".

C). Sheet E300, Partial floor plan – Sub-Basement:

1. Replace sheet "E300" with attached sheet "ADE300".


D). Sheet E400, Tasks To Modify Lights and Devices In Ceilings for Fire Sprinkler Work:

1. Replace sheet "E400" with attached sheet "ADE400".

POWER CONNECTION SCHEDULE									
MARK ⬡	EQUIPMENT	VOLTAGE /PHASE	FLA	KW	HP	PANEL CKT. NO.	BRANCH CIRCUIT ①	DISC. SW/ FUSE ②	REMARKS
3	TEMPORARY FIRE PUMP	208/1	50	—	—	"LLSBR"	2 — #6, 1 — #8G, 1" c.	—	3,4,5
.									



- POWER CONNECTION REMARKS:
- CIRCUIT TO INCLUDE ONE (1) GREEN GROUNDING CONDUCTOR (G) SIZED PER BRANCH CIRCUIT SIZE UNLESS SHOWN TO BE SIZED DIFFERENTLY. MINIMUM CONDUCTOR REQUIREMENT 2—#12, 1—#12G, 1/2" c.
 - DUAL ELEMENT TYPE FUSE AND SWITCH OF PROPER VOLTAGE. IF FUSE SIZE NOT SHOWN, UNIT TO BE UNFUSED.
 - PROVIDE NEW 50A2P BREAKER IN EXISTING PANEL "LLSBR" AND CONNECT FEEDER FOR TEMPORARY FIRE PUMP.
 - PROVIDE 50AMP, L14—50R RECEPTACLE FOR FINAL CONNECTION TO TEMPORARY FIRE PUMP.
 - FINAL CONNECTION TO TEMPORARY FIRE PUMP SHALL BE IN FLEXIBLE SEALTIGHT CONDUIT.

LEGEND	
①	POWER CONNECTION SCHEDULE MARK. SEE POWER CONNECTION SCHEDULE.

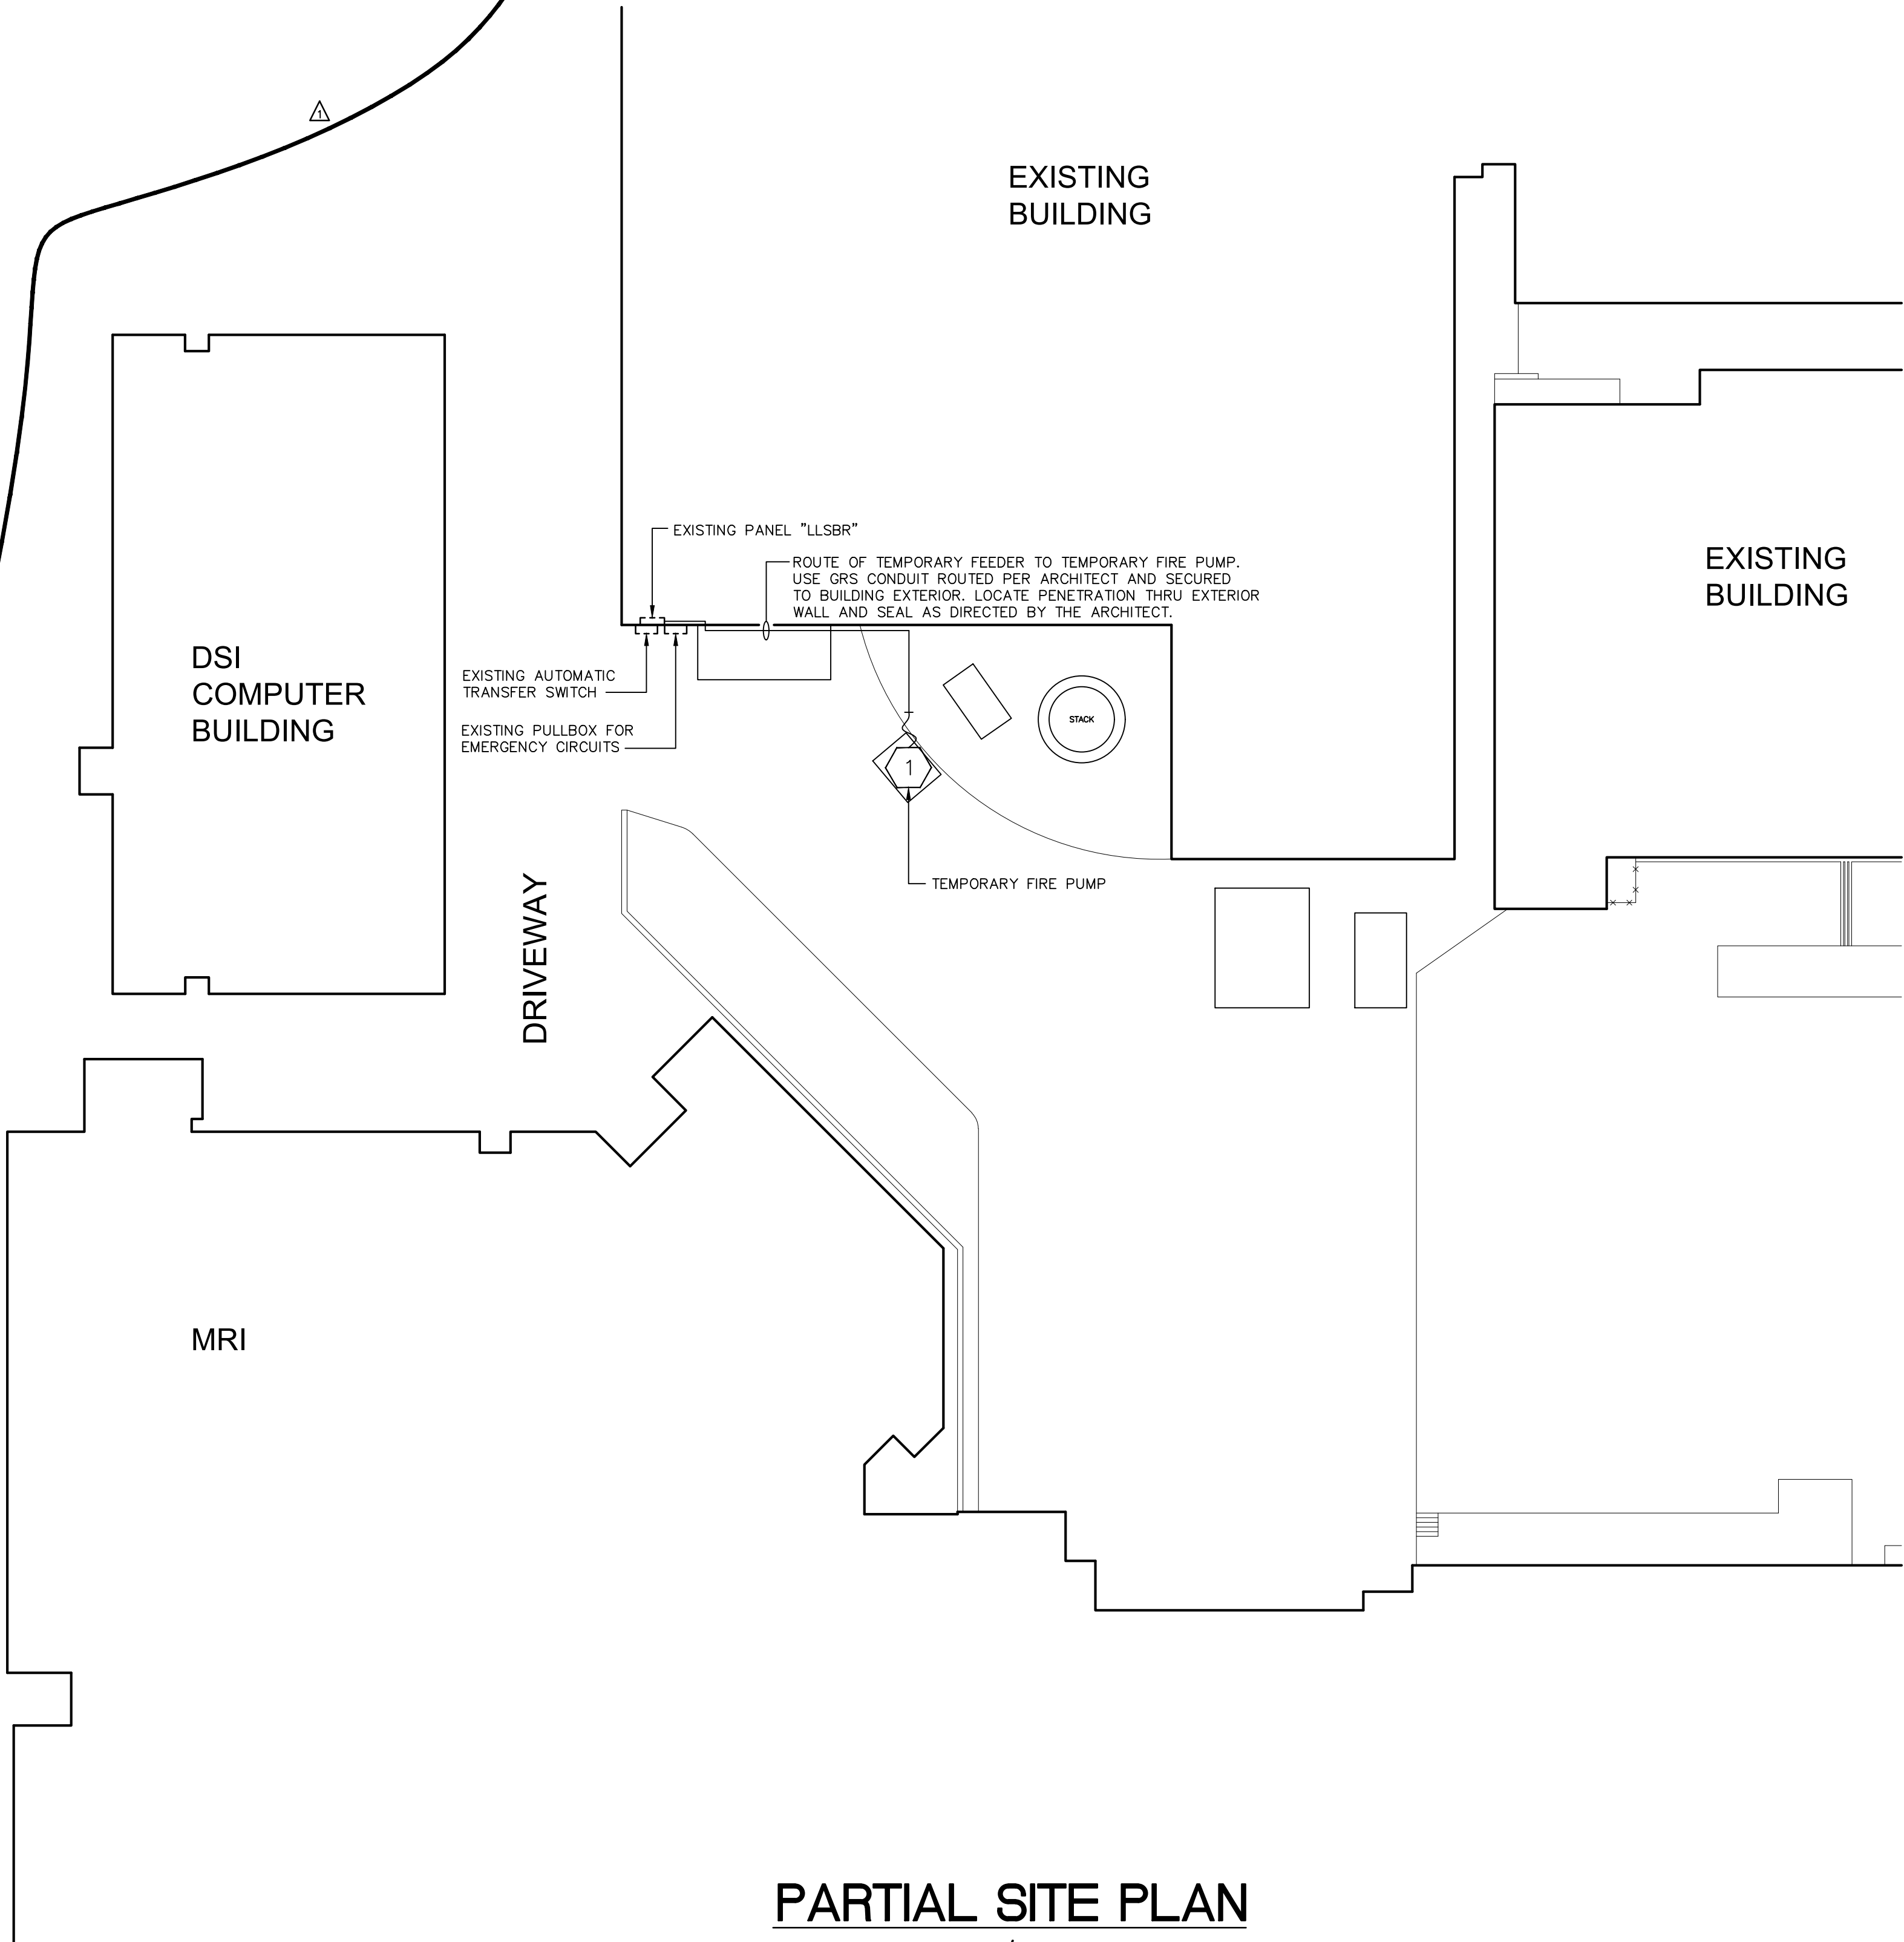

PARTIAL SITE PLAN

SCALE: 3/32" = 1'-0"

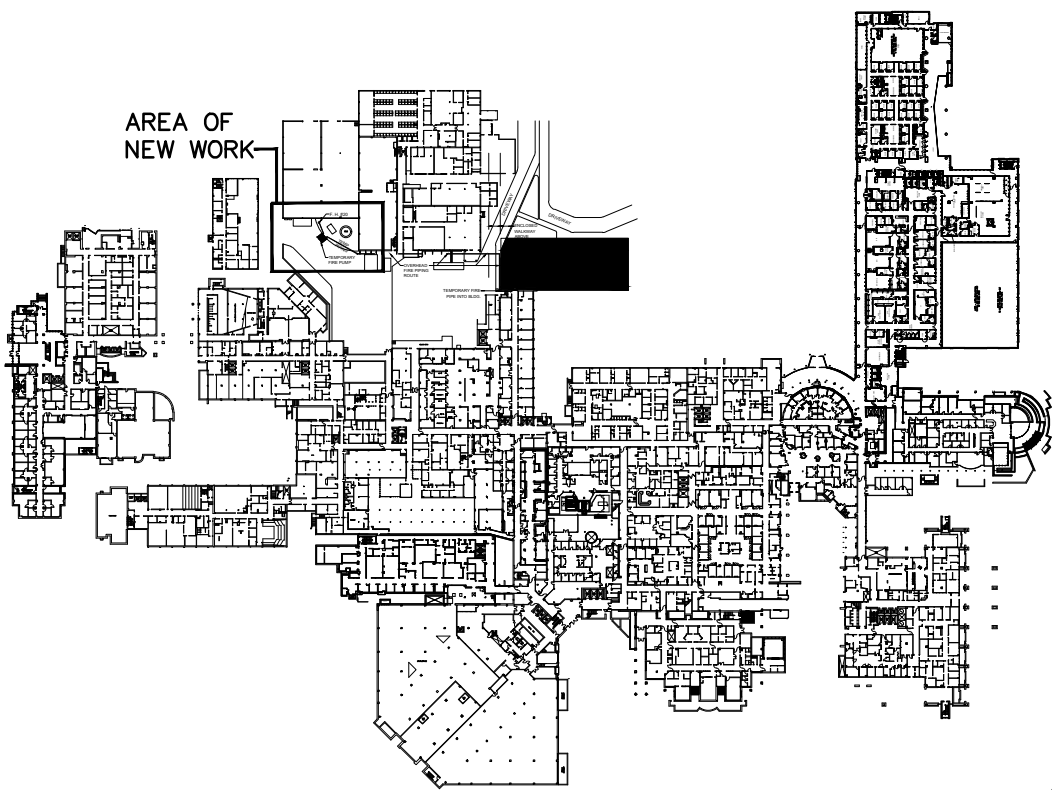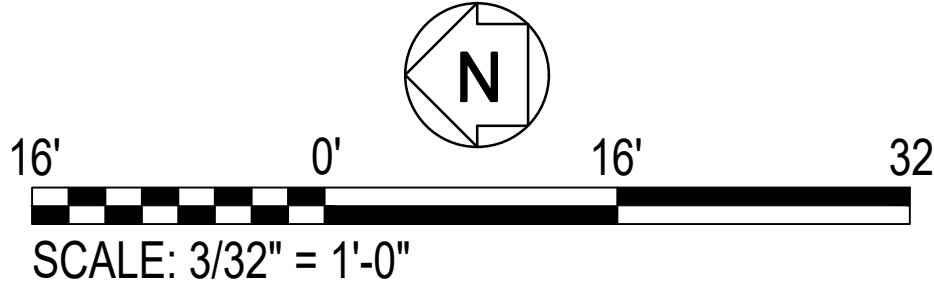

KEY PLAN

NO SCALE


**Schultz & Wynne**
Consulting Electrical Engineers
A PROFESSIONAL ASSOCIATION


4523 Office Park Drive, Jackson, MS 39206 Post
Office Box 16074, Jackson, MS 39236
TEL: 601-982-3313 FAX: 601-982-7685

FINAL DRAWINGS

S/W JOB NO. 225025

CONSTRUCTION DOCUMENTS

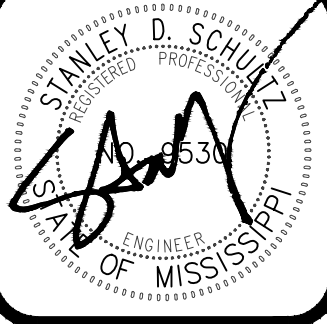**FoalWYATT**
Architects & Planners, PLLC
SUITE 200
1515 NORTH STATE STREET
JACKSON, MISSISSIPPI 39201
TELEPHONE: 601.532.3071
FAX: 601.532.3071
EMAIL: fwalsh@foalwyatt.com
WWW.FOALWYATT.COM





FIRE PROTECTION CENTRAL CORE
UNIVERSITY OF MISSISSIPPI MEDICAL CENTER
JACKSON, MISSISSIPPI
UMMC 409-007

project no.
1682-24
date
12 JUNE 2026
revised
5 AUGUST 2026

drawn by:
J.G.H.

sheet no.
ADE-001
of

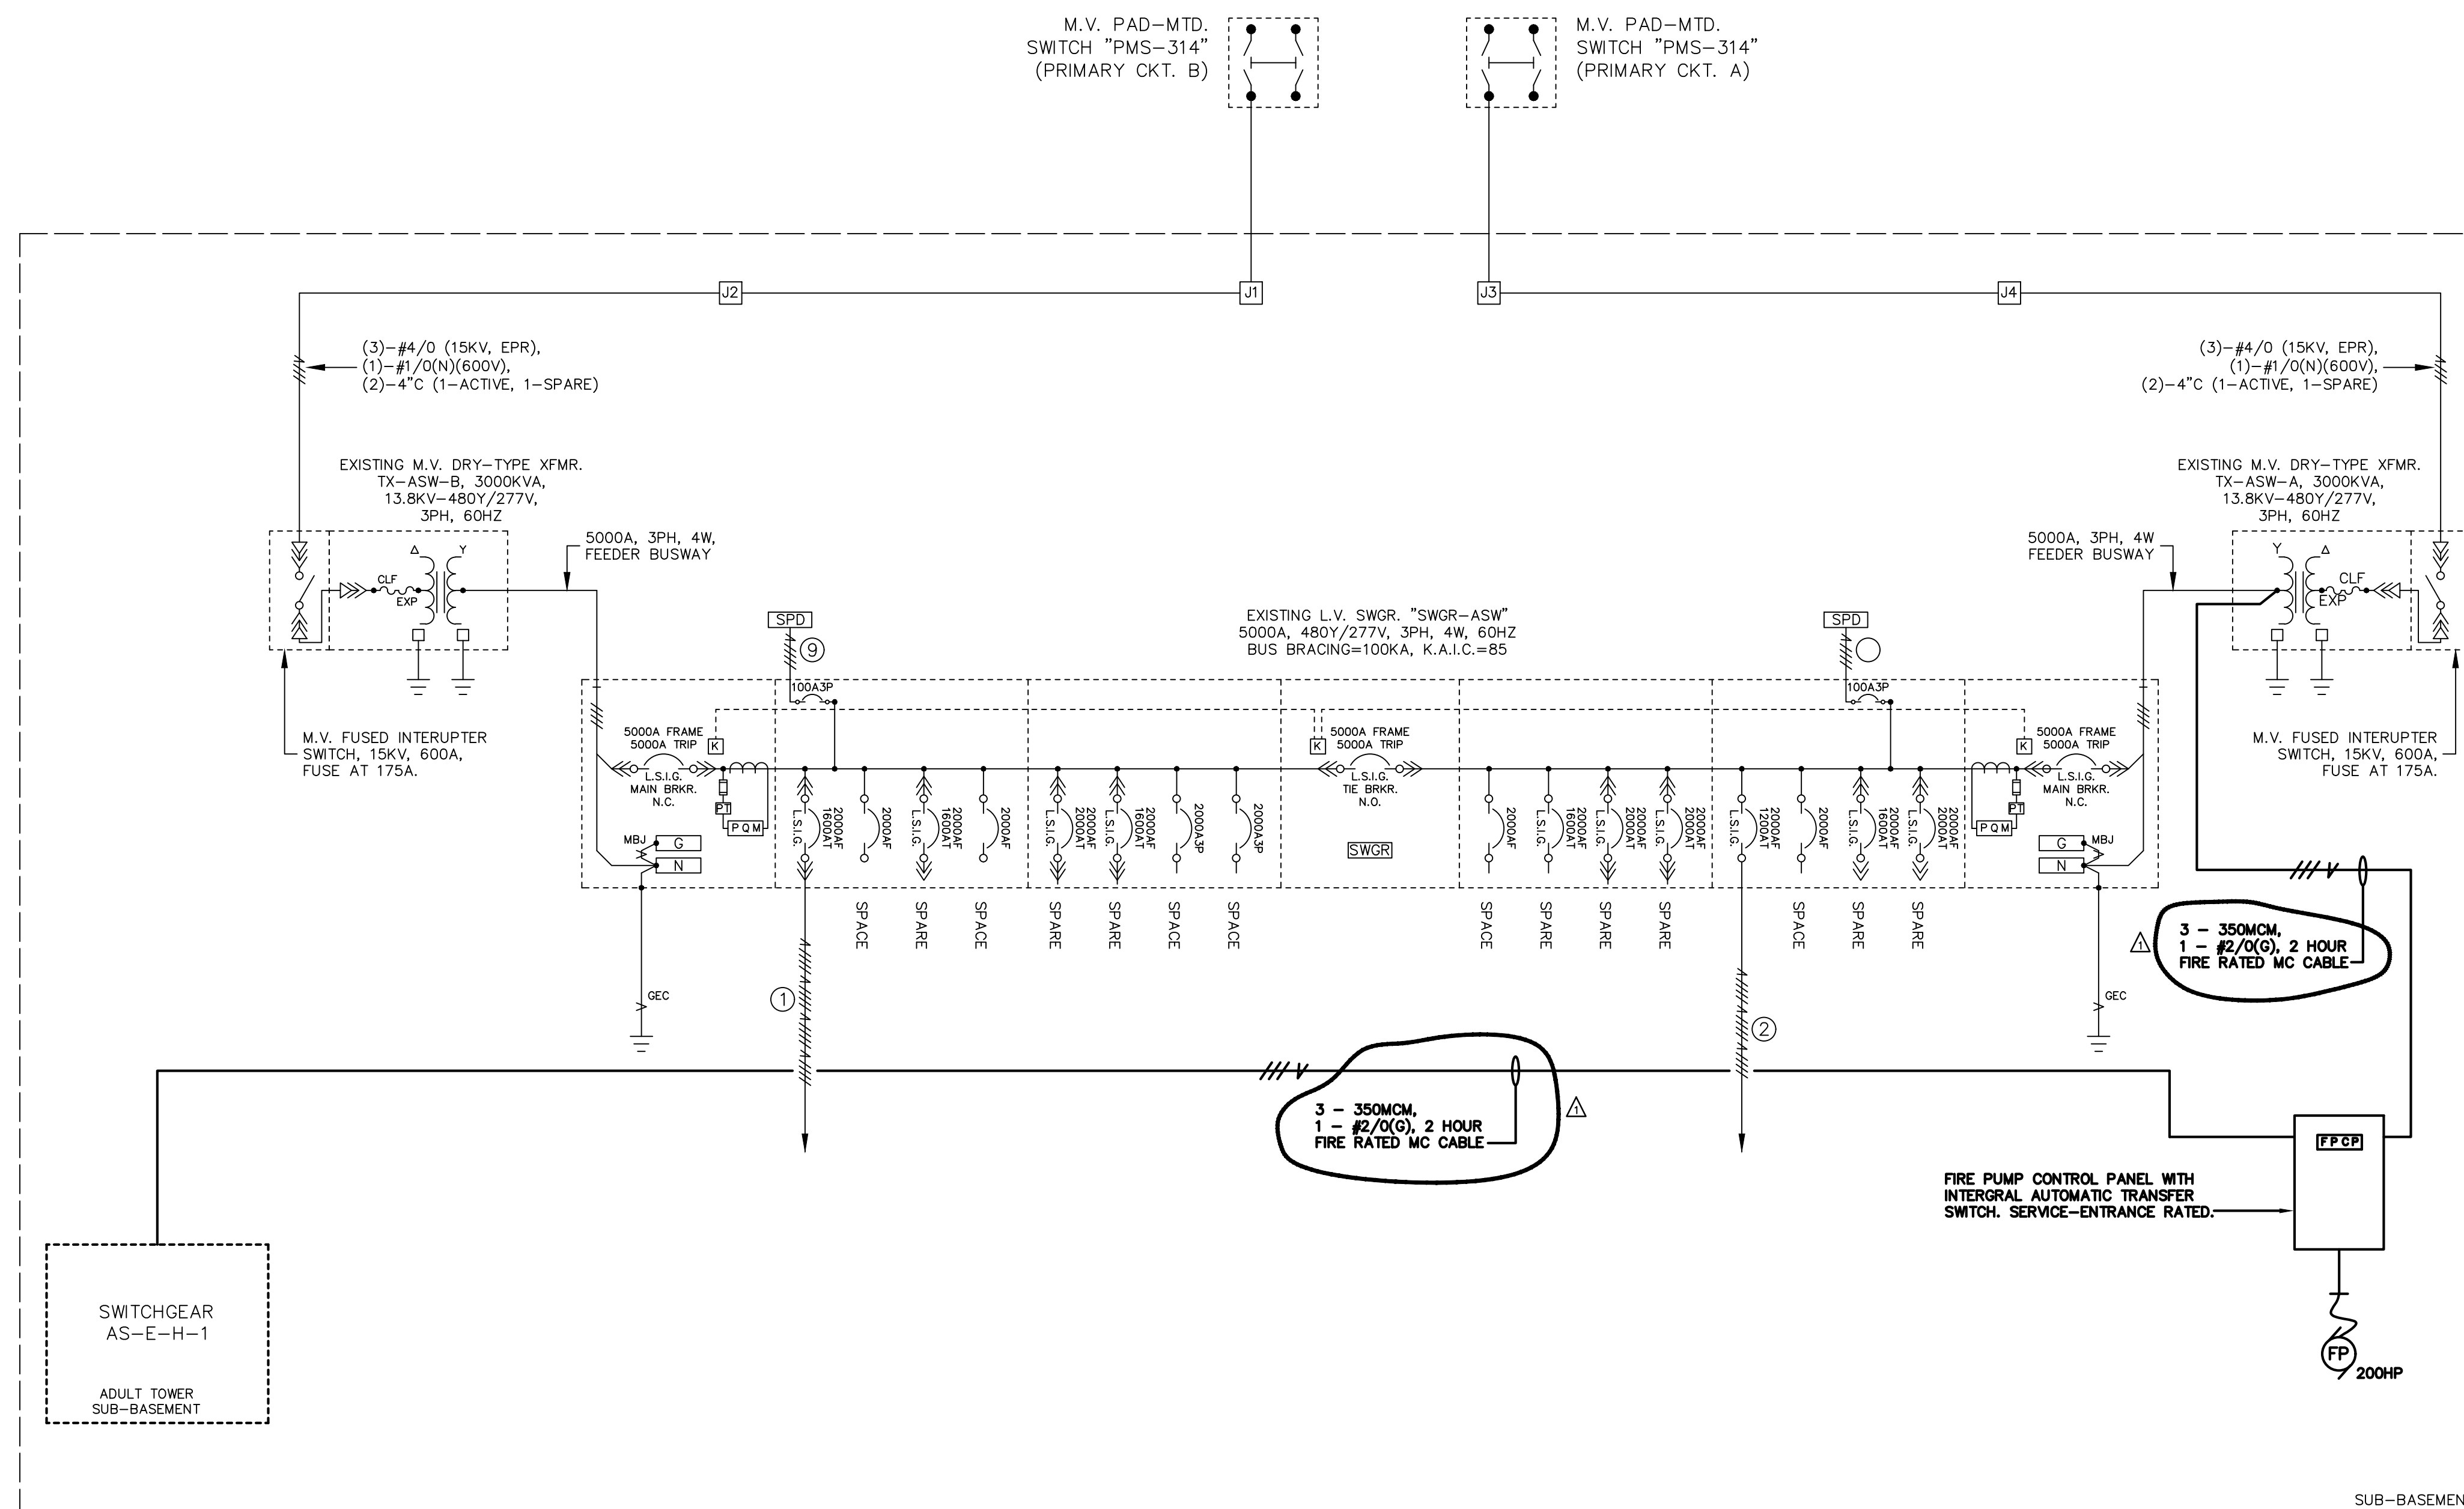

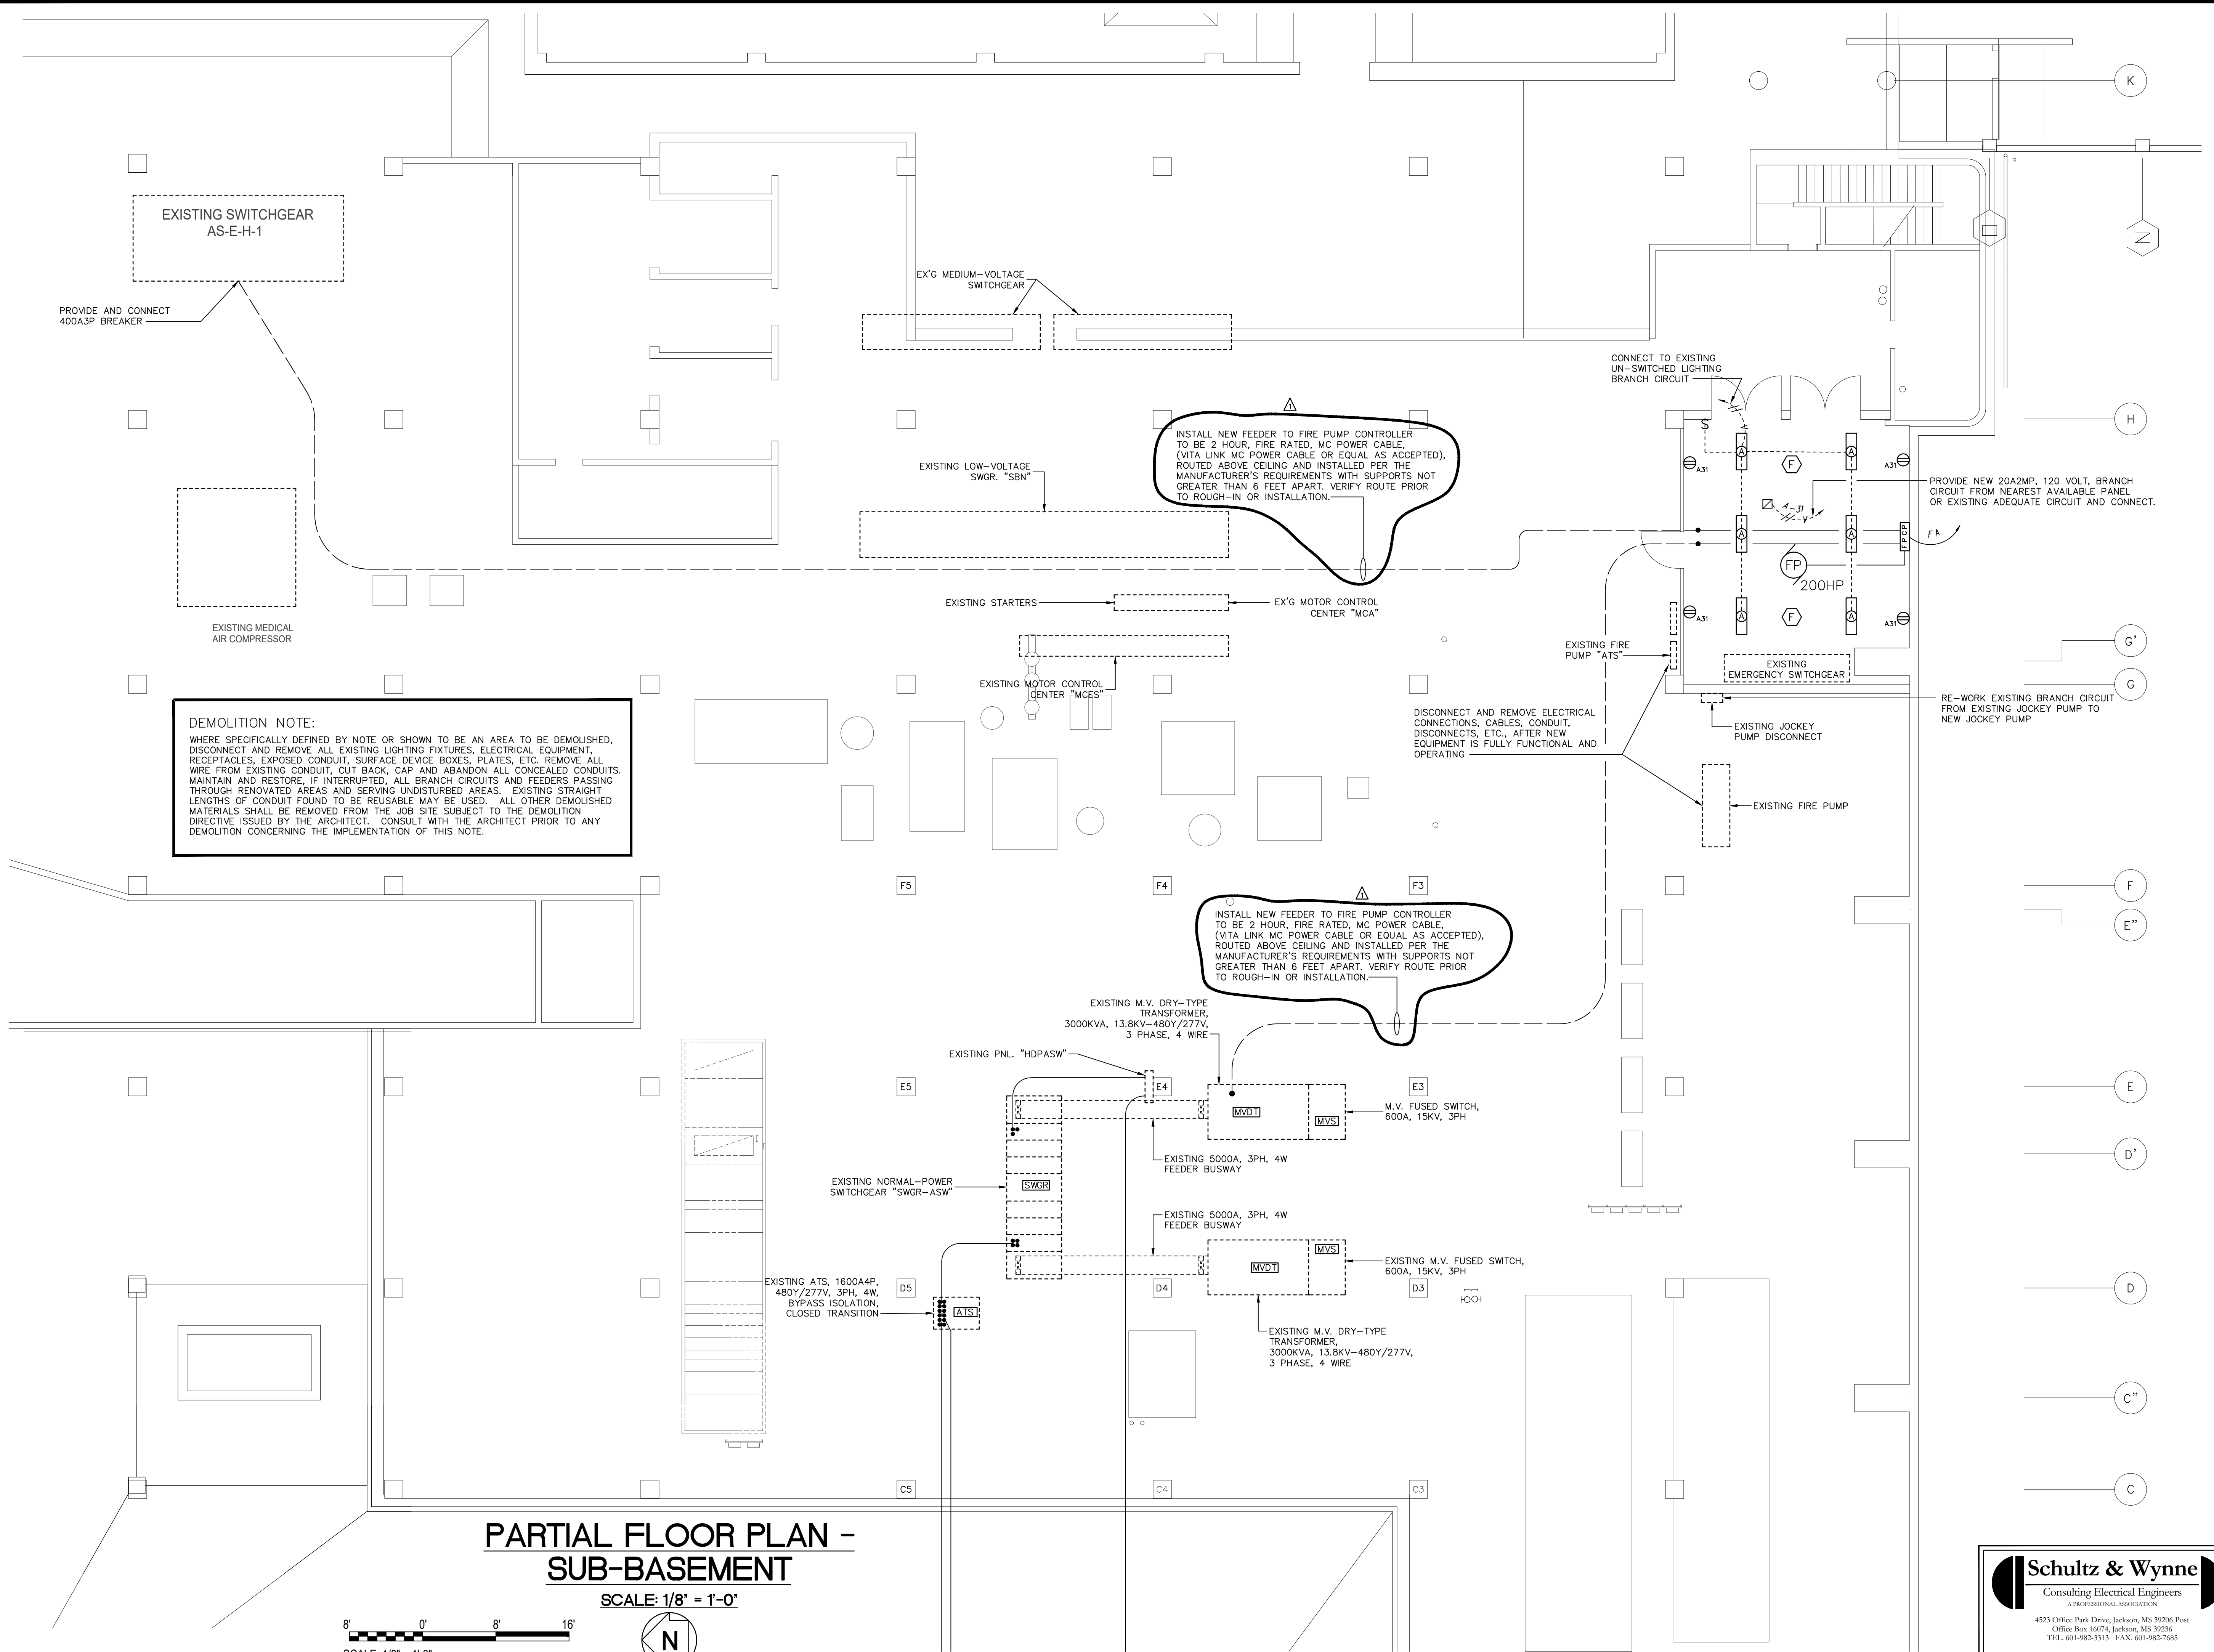

DEMOLITION NOTE:
WHERE SPECIFICALLY DEFINED BY NOTE OR SHOWN TO BE AN AREA TO BE DEMOLISHED, DISCONNECT AND REMOVE ALL EXISTING LIGHTING FIXTURES, ELECTRICAL EQUIPMENT, RECEPTACLES, EXPOSED CONDUIT, SURFACE DEVICE BOXES, PLATES, ETC. REMOVE ALL WIRE FROM EXISTING CONDUIT, CUT BACK, CAP AND ABANDON ALL CONCEALED CONDUITS. MAINTAIN AND RESTORE, IF INTERRUPTED, ALL BRANCH CIRCUITS AND FEEDERS PASSING THROUGH RENOVATED AREAS AND SERVING UNDISTURBED AREAS. EXISTING STRAIGHT LENGTHS OF CONDUIT FOUND TO BE REUSABLE MAY BE USED. ALL OTHER DEMOLISHED MATERIALS SHALL BE REMOVED FROM THE JOB SITE SUBJECT TO THE DEMOLITION DIRECTIVE ISSUED BY THE ARCHITECT. CONSULT WITH THE ARCHITECT PRIOR TO ANY DEMOLITION CONCERNING THE IMPLEMENTATION OF THIS NOTE.

**PARTIAL FLOOR PLAN -
SUB-BASEMENT**

SCALE: 1/8" = 1'-0"






Schultz & Wynne
Consulting Electrical Engineers
A PROFESSIONAL ASSOCIATION

4523 Office Park Drive, Jackson, MS 39206 Post
Office Box 16074, Jackson, MS 39216
TEL: 601-982-3313 FAX: 601-982-7685

FINAL DRAWINGS S/W JOB NO. 225025

CONSTRUCTION DOCUMENTS

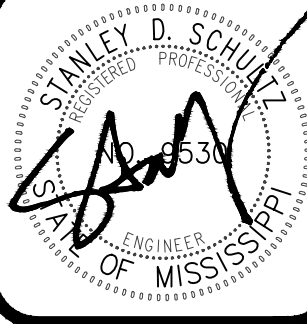

FoalWYATT
Architects & Planners, PLLC
SUITE 200
1515 NORTH STATE STREET
JACKSON, MISSISSIPPI 39201
TELEPHONE: 601-552-3971
FAX: 601-552-3971
EMAIL: foalw@foalw.com
WWW: www.foalw.com

JACKSON

FIRE PROTECTION CENTRAL CORE
UNIVERSITY OF MISSISSIPPI MEDICAL CENTER
UMMC 409-007

project no.
1682-24
date
12 JUNE 2026
revised
5 AUGUST 2026

drawn by:
J.G.H.




sheet no.
E-300
of

POWER CONNECTION SCHEDULE									
MARK 	EQUIPMENT	VOLTAGE /PHASE	FLA	KW	HP	PANEL CKT. NO.	BRANCH CIRCUIT 	DISC. SW / FUSE 	REMARKS
1	TEMPORARY FIRE PUMP	208/1	30	—	6	—	2 — #6, 1 — #8G, 1" c.	—	—
—	—	—	—	—	—	—	—	—	—

POWER CONNECTION REMARKS:

- CIRCUIT TO INCLUDE ONE (1) GREEN GROUNDING CONDUCTOR (G) SIZED PER BRANCH CIRCUIT SIZE UNLESS SHOWN TO BE SIZED DIFFERENTLY. MINIMUM CONDUCTOR REQUIREMENT 2-#12, 1-#12G, 1/2" c.
- DUAL ELEMENT TYPE FUSE AND SWITCH OF PROPER VOLTAGE. IF FUSE SIZE NOT SHOWN, UNIT TO BE UNFUSED.
- PROVIDE L14-30R RECEPTACLE FOR DISCONNECT.
- SEE SHEET FP101 FOR EXACT LOCATION.

LIGHTING FIXTURE SCHEDULE						
VOLTS	SYMBOL	WATTS	DESCRIPTION	MANUFACTURER	CAT. NO.	MOUNTING
277	A	21	LED STRIP, 48", 3500°K, 3000 LUMENS, FLAT DIFFUSE LENS	LITHONIA	CLX-L48-3000LM -SEF-FDL-MVOLT -G210-35K-80CRI	CEILING
277	B	34.9	RECESSED LED TROFFER, 2' X 2', 4,322 LUMENS, 3500°K, 80CRI	LITHONIA	CPX-2X2-AL07 -80CRI-SWW7- SWL-MVOLT	RECESSED

LEGEND	
	BRANCH CIRCUIT (CONDUIT AND WIRING) CONCEALED ABOVE CEILING OR IN WALL, NUMBER OF CONDUCTORS. (—V—) INDICATES GREEN GROUNDING CONDUCTOR SIZED PER BRANCH CIRCUIT UNLESS OTHERWISE NOTED.
	BRANCH CIRCUIT (CONDUIT AND WIRING) EXPOSED ON CEILING ONLY, NUMBER OF CONDUCTORS.
	HOME RUN, PANEL AND CIRCUIT DESIGNATION, NUMBER OF CONDUCTORS.
	LED FIXTURE WITH FIXTURE SYMBOL AND CIRCUIT NUMBER.
	SWITCH, SINGLE POLE FLUSH TUMBLER. MOUNT CENTER LINE UP 48", UNLESS NOTED OTHERWISE ON THE PLANS OR IN THE SPECIFICATIONS.
	DUPLEX GROUNDABLE RECEPTACLE, 120 VOLTS, NEMA 5-20R, CIRCUIT NUMBER.
	FIRE ALARM SYSTEM CONNECTION TO SPRINKLER SYSTEM FLOW ALARM.
	FIRE ALARM SYSTEM CONNECTION TO SPRINKLER SYSTEM TAMPER SWITCH.
	FIRE ALARM CONTROL PANEL.
	FIRE ALARM SYSTEM MAGNETIC DOOR HOLDER, MOUNT CENTER LINE UP 7"0" OR AS NOTED.
	FIRE ALARM SYSTEM SMOKE DETECTOR, PHOTO ELECTRIC TYPE, MOUNT ON CEILING.
	FIRE ALARM SYSTEM THERMAL DETECTOR UNIT, MOUNT ON CEILING, 135° RATING UNLESS OTHERWISE NOTED (200°).

TASKS TO MODIFY LIGHTS AND DEVICES IN CEILINGS FOR FIRE SPRINKLER WORK

UMMC Fire Protection Central Core – Line Item Electrical Costs SW# 225025
Line Item Costs For Base Bid:

- Light Fixture – temporarily relocate ceiling mounted fixture without disconnecting circuit and reinstall at same location after new work complete.
150 Fixtures each.
- Light Fixture – disconnect & remove one ceiling mounted light fixture, temporarily store it and after new work is complete reinstall the existing fixture to same existing circuit at same location.
125 Fixtures each.
- Light Fixture – disconnect & remove one ceiling mounted light fixture, after new work is complete install a new 2’x 2’ light fixture (Type B) and connect to the same existing circuit at same location.
175 Fixtures each.
- Light Fixture – temporarily relocate ceiling mounted fixture without disconnecting circuit and after new work is complete, extend conduit/ cabling to a new fixture location to be up to 10 feet from initial location and reconnect to the same circuit.
250 Fixtures each.
- Light Fixture – disconnect & remove one ceiling mounted light fixture. After new work is complete, extend conduit/ cabling to a new fixture location to be up to 10 feet from initial location and reconnect a new 2’x 2’ light fixture (Type B) to the same existing circuit.
275 Fixtures each.
- Division 26/27/28 - device mounted in ceiling to be temporarily relocated in the ceiling without disconnecting circuit and reinstall at same or similar location after new work complete.
150 Devices each.
- Division 26/27/28 - device mounted in ceiling to be disconnected and removed from ceiling, temporarily stored and after new work is complete, reinstall and reconnect at original location.
250 Devices each.
- Division 26/27/28 - device mounted in ceiling, disconnected and removed from ceiling, temporarily stored and after new work is complete, extend conduit/ cabling up to 10 feet from original location and reinstall the existing device.
300 Devices each.




Schultz & Wynne
Consulting Electrical Engineers
A PROFESSIONAL ASSOCIATION
4523 Office Park Drive, Jackson, MS 39206 Post
Office Box 16074, Jackson, MS 39236
TEL: 601-982-3313 FAX: 601-982-7985




FINAL DRAWINGS

S/W JOB NO. 225025

CONSTRUCTION DOCUMENTS

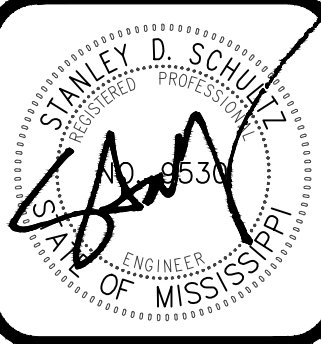

FOILWYATT
Architects & Planners, PLLC
SUITE 200
1510 NORTH STATE STREET
JACKSON, MISSISSIPPI 39201
TELEPHONE: 601.552.3071
FAX: 601.552.3071
EMAIL: fpw@foilwatt.com
WWW: www.foilwatt.com



FIRE PROTECTION CENTRAL CORE
UNIVERSITY OF MISSISSIPPI MEDICAL CENTER
JACKSON, MISSISSIPPI
UMMC 409-007

project no.
1682-24
date
12 JUNE 2026
revised
5 AUGUST 2026

drawn by:
J.G.H.

sheet no.
ADE-400
of